

Jan 18 2022

STATE CLEARINGHOUSE

From: [Charles Palmer](#)
To: Jemberie_Shiferaw@DOT
Cc: [OPR State Clearinghouse](#); gkathan@co.calaveras.us; MFlandreau@co.calaveras.ca.us; Ponce_Gregoria@DOT; [Joe DiGiorgio](#); [Julia Richardson](#)
Subject: RE: Caltrans comment letter - West Point and Wilseyville Wastewater Treatment project
Date: Tuesday, January 18, 2022 8:31:57 AM
Attachments: [Drainage Mods CCWD-WestPoint WWTF.pdf](#)

Shiferaw,

Our design consultant, Nexgen, has evaluated the potential runoff from our project site and determined that a very small amount of the project site does slope toward the property entrance and runoff could potentially reach the highway (State Route 26) right of way and add a small amount of new, additional runoff to pre-existing drainage facilities. Further analysis by Nexgen showed that this runoff could be diverted away from the State's right-of-way and reduced below pre-existing levels by the addition of a small on-site culvert 12" to 16" diameter x 40' long to our project. We intend to include the subject culvert in our project as a result of your comments. Please let us know if you would like to further discuss our project and the information presented herein and we can schedule an online MS Teams meeting with Calaveras County Water District and our consultant, Nexgen.

In regard to encroachment permits, we do not anticipate any work inside the Caltrans highway right of way. If need be, we will secure any necessary permits to complete the project work.

Best Regards,

*Charles Palmer, P.E.
District Engineer
Calaveras County Water District
120 Toma Court
San Andreas, CA 95249
Phone: (209) 642-3209*

From: Jemberie, Shiferaw@DOT <Shiferaw.Jemberie@dot.ca.gov>

Sent: Tuesday, December 28, 2021 12:20 PM

To: Charles Palmer <CharlesP@ccwd.org>

Cc: state.clearinghouse@opr.ca.gov; gkathan@co.calaveras.us; MFlandreau@co.calaveras.ca.us; Ponce, Gregoria@DOT <gregoria.ponce@dot.ca.gov>

Subject: Caltrans comment letter - West Point and Wilseyville Wastewater Treatment project

CAUTION: This email originated from outside the organization. Do not click links or open attachments unless you recognize the sender and know the content is safe.

Good afternoon Mr. Palmer,

Attached please find Caltrans comment letter for the West Point and Wilseyville Wastewater Treatment Plant project.

Please let me know if you have any questions.

Kind regards,


Shiferaw Jemberie

Transportation Planner

District 10 Rural Planning

Work Phone (209) 941-1947

1976 E. Dr. Martin Luther King Jr Blvd, Stockton CA 95205

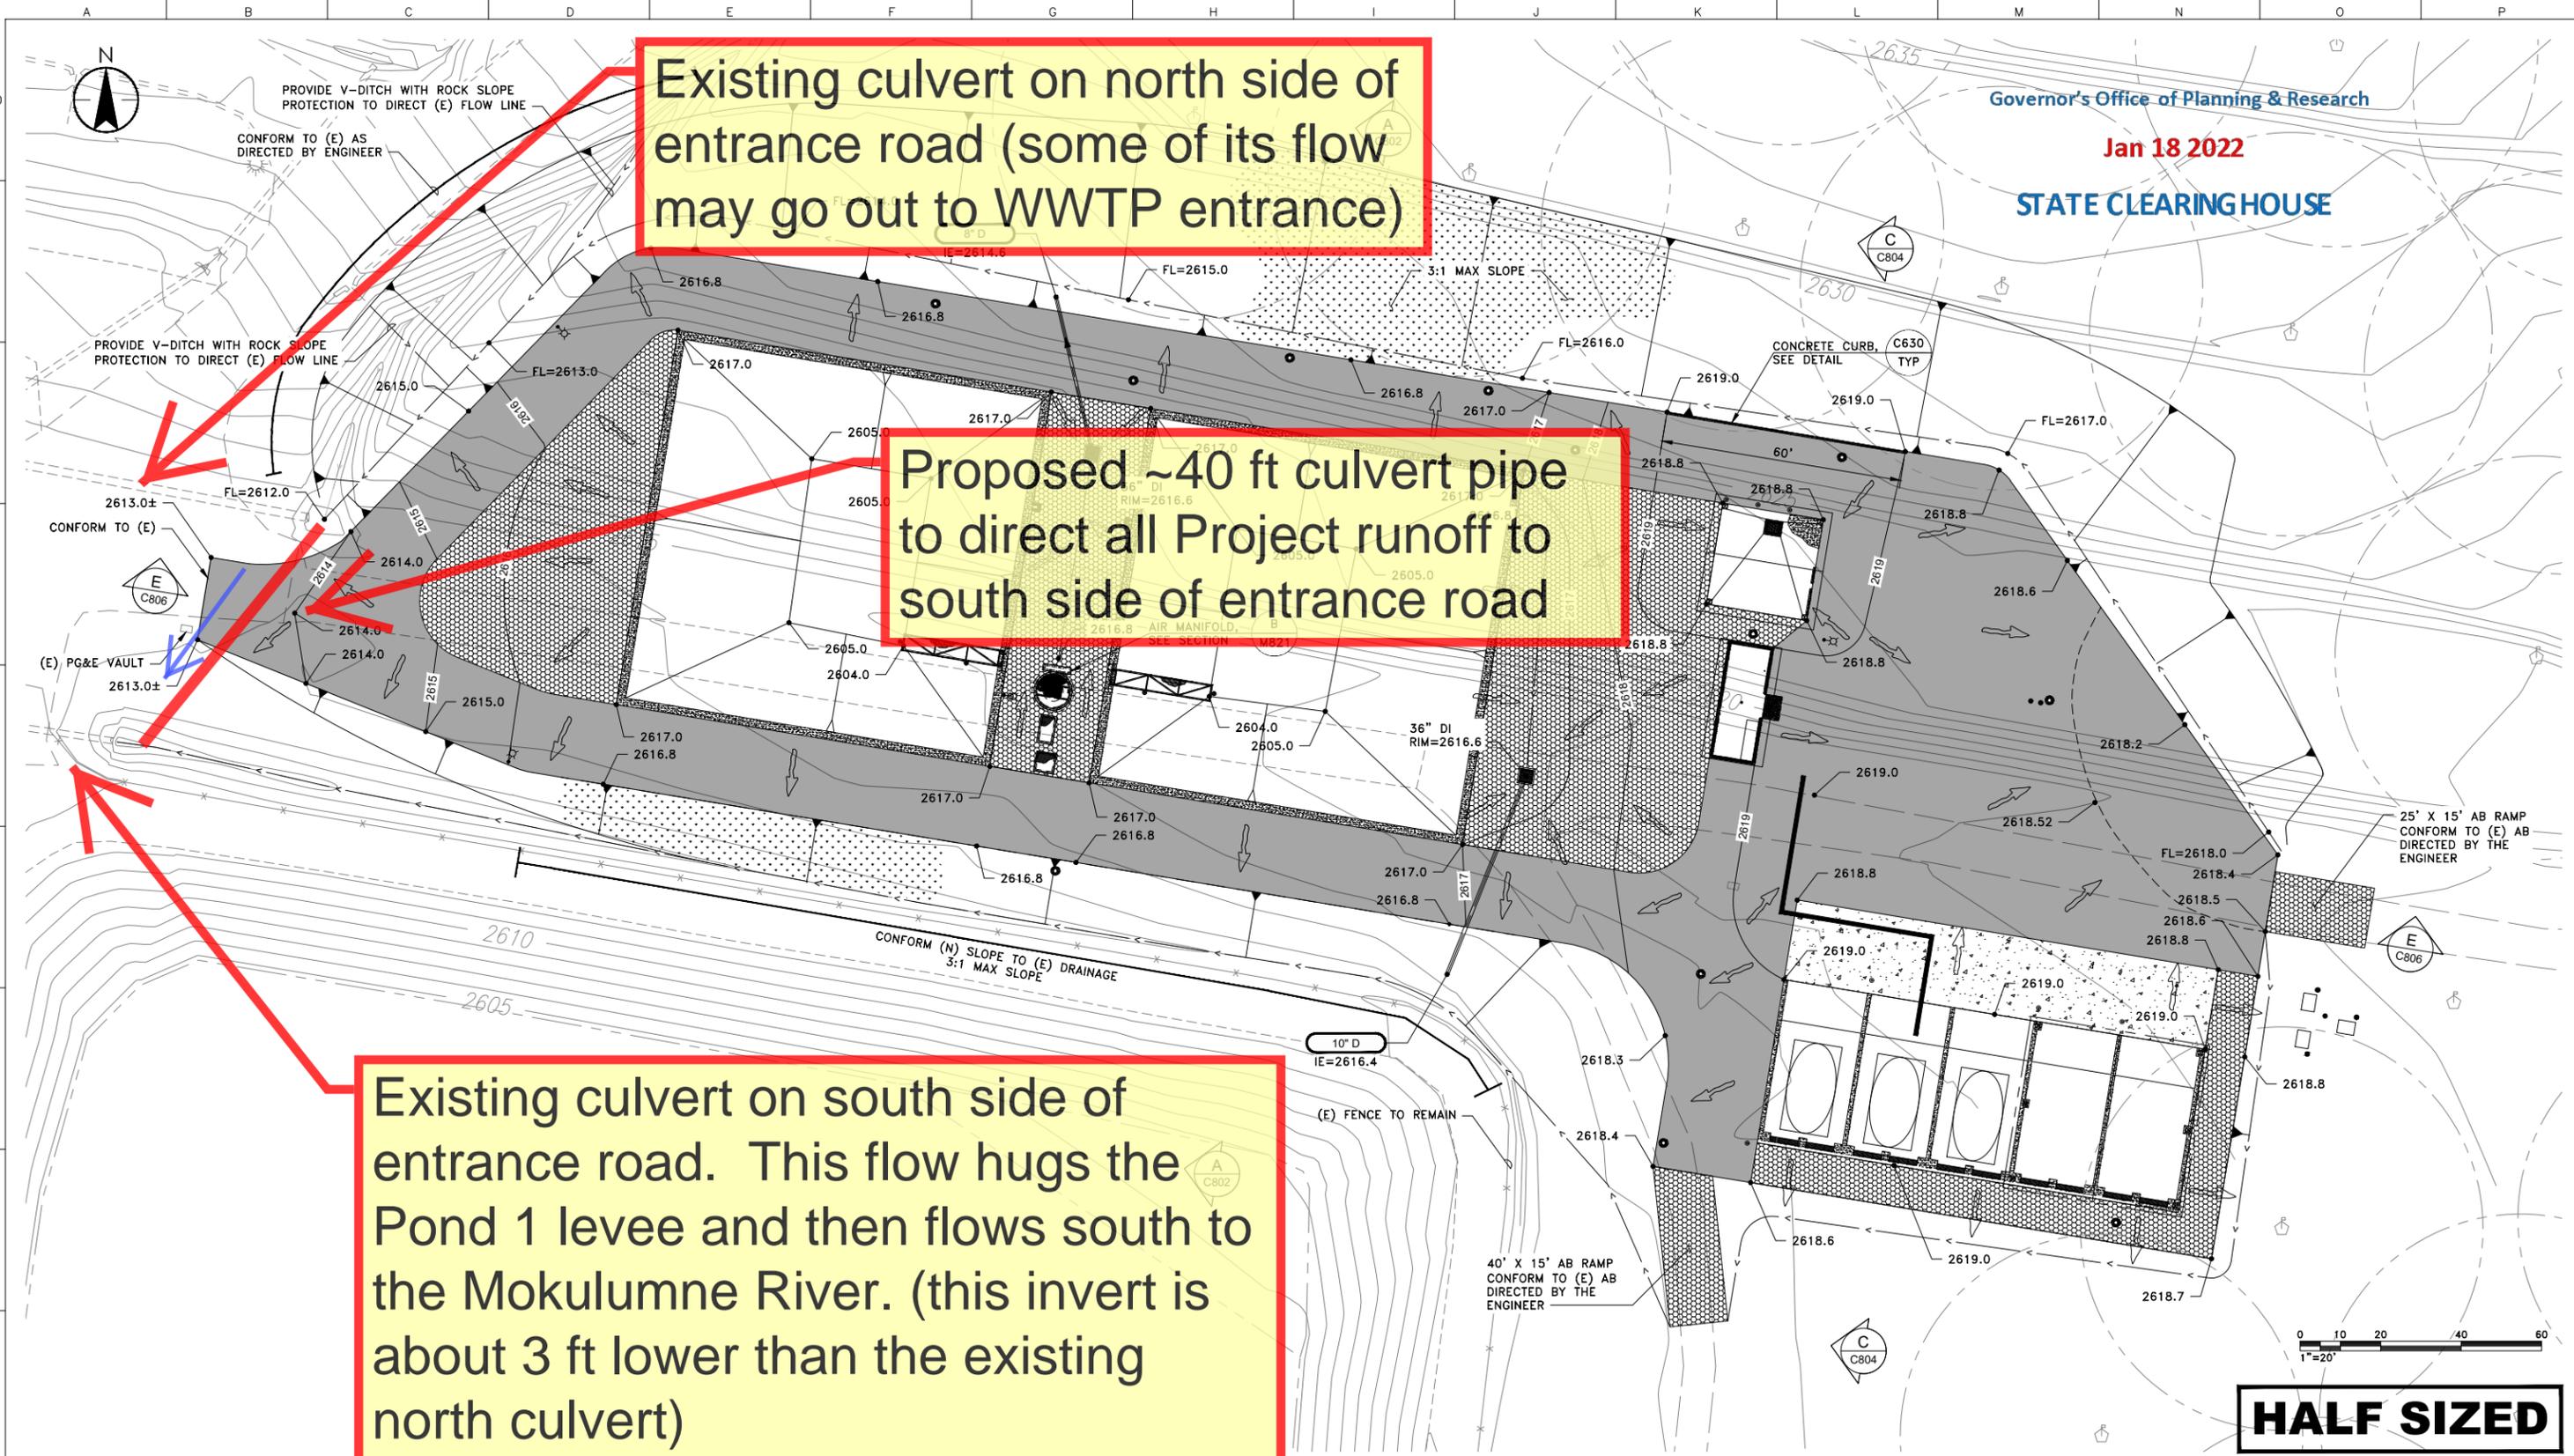

Existing culvert on north side of entrance road (some of its flow may go out to WWTP entrance)

Proposed ~40 ft culvert pipe to direct all Project runoff to south side of entrance road

Existing culvert on south side of entrance road. This flow hugs the Pond 1 levee and then flows south to the Mokulumne River. (this invert is about 3 ft lower than the existing north culvert)

Governor's Office of Planning & Research
 Jan 18 2022
 STATE CLEARINGHOUSE

HALF SIZED

DESIGNED BY: J. DIGIORGIO
 DRAFTED BY: J. AYALA
 CHECKED BY: D. RICH
 DATE: 12/23/2021
 SCALE: 1"=20'
 BAR LENGTH ONE INCH ON SCALED DRAWING

REVISION:	DESCRIPTION:	DATE:	BY:



CALAVERAS COUNTY WATER DISTRICT
 120 TOMA COURT
 POST OFFICE BOX 846
 SAN ANDREAS, CALIFORNIA 95249
 PHONE: (209) 754-3543



FACULTATIVE SLUDGE LAGOONS DRAINAGE, PAVING AND GRADING PLAN
 WEST POINT – WILSEYVILLE
 WWTF CONSOLIDATION PROJECT

15091
PROJECT NUMBER
C801
DRAWING NUMBER
28
SHEET NUMBER