


Project Specific Water Quality Management Plan

A Template for Projects located within the **Santa Ana Watershed** Region of Riverside County

Project Title: Indian & Ramona Distribution Center

Development No:

Design Review/Case No: DPR 18-00002

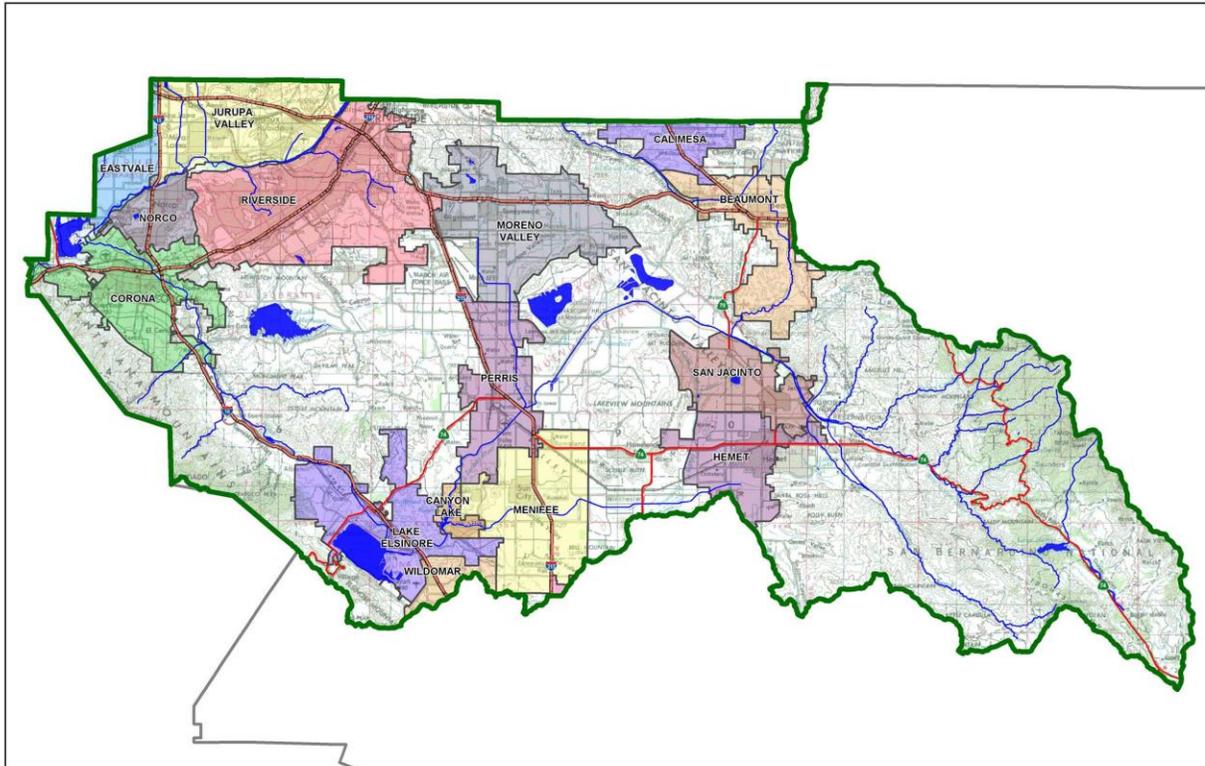

Contact Information:

Prepared for:

IDI Gazeley
Attn: Steve Hollis
601 S. Figueroa Street, Suite 2300
Los Angeles, CA 90017
(214) 697 – 1711

Prepared by:

Albert A. Webb Associates
Attn: Christopher R. Castaneda, P.E.
3788 McCray Street
Riverside, CA 92506
(951) 686 - 1070

Preliminary

Final


Original Date Prepared: December 2017

Revision Date(s): August 2018

Prepared for Compliance with
Regional Board Order No. R8-2010-0033

A Brief Introduction

This Project-Specific WQMP Template for the **Santa Ana Region** has been prepared to help guide you in documenting compliance for your project. Because this document has been designed to specifically document compliance, you will need to utilize the WQMP Guidance Document as your “how-to” manual to help guide you through this process. Both the Template and Guidance Document go hand-in-hand, and will help facilitate a well prepared Project-Specific WQMP. Below is a flowchart for the layout of this Template that will provide the steps required to document compliance.

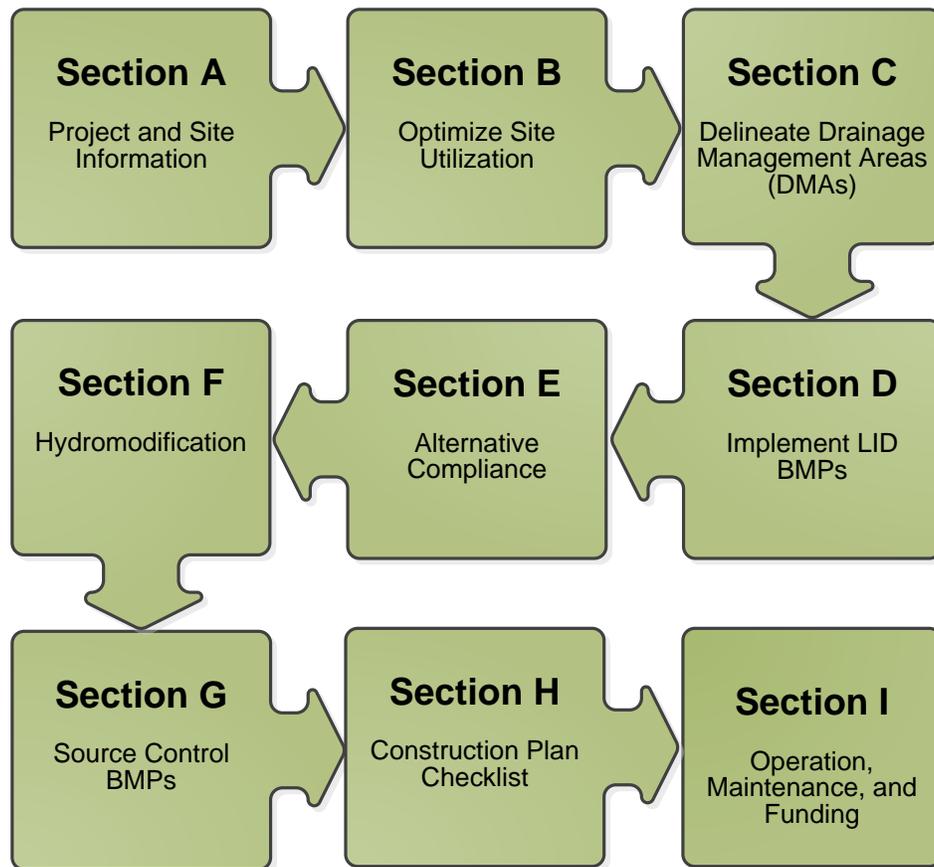

OWNER'S CERTIFICATION

This Project-Specific Water Quality Management Plan (WQMP) has been prepared for IDI Gazeley by Albert A. Webb Associates for the Indian & Ramona Distribution Center project.

This WQMP is intended to comply with the requirements of **City of Perris Water Quality Ordinance 1194** which includes the requirement for the preparation and implementation of a Project-Specific WQMP.

The undersigned, while owning the property/project described in the preceding paragraph, shall be responsible for the implementation and funding of this WQMP and will ensure that this WQMP is amended as appropriate to reflect up-to-date conditions on the site. In addition, the property owner accepts responsibility for interim operation and maintenance of Stormwater BMPs until such time as this responsibility is formally transferred to a subsequent owner. This WQMP will be reviewed with the facility operator, facility supervisors, employees, tenants, maintenance and service contractors, or any other party (or parties) having responsibility for implementing portions of this WQMP. At least one copy of this WQMP will be maintained at the project site or project office in perpetuity. The undersigned is authorized to certify and to approve implementation of this WQMP. The undersigned is aware that implementation of this WQMP is enforceable under **City of Perris Water Quality Ordinance 1194**.

"I, the undersigned, certify under penalty of law that the provisions of this WQMP have been reviewed and accepted and that the WQMP will be transferred to future successors in interest."

Owner's Signature

Date

Owner's Printed Name

Owner's Title/Position

PREPARER'S CERTIFICATION

"The selection, sizing and design of stormwater treatment and other stormwater quality and quantity control measures in this plan meet the requirements of Regional Water Quality Control Board Order No. **R8-2010-0033** and any subsequent amendments thereto."

Preparer's Signature

Date

DJ Arellano, P.E.

Preparer's Printed Name

Senior Engineer

Preparer's Title/Position

Preparer's Licensure:



Table of Contents

Section A: Project and Site Information.....	6
Project Description.....	6
A.1 Maps and Site Plans.....	7
A.2 Identify Receiving Waters.....	8
A.3 Additional Permits/Approvals required for the Project:	8
Section B: Optimize Site Utilization (LID Principles)	9
Section C: Delineate Drainage Management Areas (DMAs).....	6
Section D: Implement LID BMPs	8
D.1 Infiltration Applicability	8
D.2 Harvest and Use Assessment.....	9
D.3 Bioretention and Biotreatment Assessment	11
D.4 Feasibility Assessment Summaries	12
D.5 LID BMP Sizing	13
Section E: Alternative Compliance (LID Waiver Program)	14
E.1 Identify Pollutants of Concern	15
E.2 Stormwater Credits	16
E.3 Sizing Criteria.....	16
E.4 Treatment Control BMP Selection	17
Section F: Hydromodification	18
F.1 Hydrologic Conditions of Concern (HCOC) Analysis.....	18
F.2 HCOC Mitigation.....	19
Section G: Source Control BMPs.....	20
Section H: Construction Plan Checklist.....	24
Section I: Operation, Maintenance and Funding.....	25

List of Tables

Table A.1 Identification of Receiving Waters.....	8
Table A.2 Other Applicable Permits.....	8
Table C.1 DMA Classifications.....	6
Table C.2 Type 'A', Self-Treating Areas.....	6
Table C.3 Type 'B', Self-Retaining Areas.....	6
Table C.4 Type 'C', Areas that Drain to Self-Retaining Areas.....	7
Table C.5 Type 'D', Areas Draining to BMPs.....	7
Table D.1 Infiltration Feasibility.....	8
Table D.2 LID Prioritization Summary Matrix.....	12
Table D.3 DCV Calculations for LID BMPs.....	13
Table E.1 Potential Pollutants by Land Use Type.....	15
Table E.2 Water Quality Credits.....	16
Table E.3 Treatment Control BMP Sizing.....	16
Table E.4 Treatment Control BMP Selection.....	17
Table F.1 Hydrologic Conditions of Concern Summary.....	18
Table G.1 Permanent and Operational Source Control Measures.....	20
Table H.1 Construction Plan Cross-reference.....	24

List of Appendices

Appendix 1: Maps and Site Plans.....	26
Appendix 2: Construction Plans.....	27
Appendix 3: Soils Information.....	28
Appendix 4: Historical Site Conditions.....	29
Appendix 5: LID Infeasibility.....	30
Appendix 6: BMP Design Details.....	31
Appendix 7: Hydromodification.....	32
Appendix 8: Source Control.....	33
Appendix 9: O&M.....	34
Appendix 10: Educational Materials.....	- 35 -

Section A: Project and Site Information

PROJECT INFORMATION	
Type of Project:	Commercial/Industrial
Planning Area:	Perris Valley Commerce Center (PVCC) Plan Area
Community Name:	Perris Valley
Development Name:	Indian & Ramona Distribution Center
PROJECT LOCATION	
Latitude & Longitude (DMS): N 33°50'45.96", W 117°13'58.44"	
Project Watershed and Sub-Watershed: Santa Ana, San Jacinto Valley	
APN(s): 302-060-005, 302-060-006, 302-060-038, 302-050-034, 302-050-036	
Map Book and Page No.: Thomas Bros. Map Page: 777 Grid: F1 and G1	
PROJECT CHARACTERISTICS	
Proposed or Potential Land Use(s)	Light Industrial
Proposed or Potential SIC Code(s) 1541 (General Contractors-Industrial Buildings & Warehouses), 4225 (General Warehousing & Storage)	1541, 4225
Area of Impervious Project Footprint (SF)	951,360
Total Area of <u>proposed</u> Impervious Surfaces within the Project Limits (SF)/or Replacement	951,360
Does the project consist of offsite road improvements?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
Does the project propose to construct unpaved roads?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
Is the project part of a larger common plan of development (phased project)?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
EXISTING SITE CHARACTERISTICS	
Total area of <u>existing</u> Impervious Surfaces within the project limits (SF)	0
Is the project located within any MSHCP Criteria Cell?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
If so, identify the Cell number:	N/A
Are there any natural hydrologic features on the project site?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
Is a Geotechnical Report attached?	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N
If no Geotech. Report, list the NRCS soils type(s) present on the site (A, B, C and/or D)	N/A
What is the Water Quality Design Storm Depth for the project?	0.62

Project Description

The project is proposing a warehouse facility (approximately 428,730 square feet) on approximately 24 acres of vacant land. Existing elevations across the site vary from 1465 at the northwest corner to 1457 at the southeast corner (NAVD88 datum). The site currently slopes toward the east side of the project site at approximately 0.6% grade. The existing drainage pattern for the site and the general area is characterized by sheet flow that follows the slope towards Indian Avenue and Ramona Expressway. The existing flows are then conveyed by a graded earthen flowline that drains towards an existing reinforce concrete box (RCB) located at the Indian Avenue and Ramona Expressway intersection. The RCB is 7-foot high by 14-foot wide located at the southeast end of the project site. The project is located within the Perris Valley Commerce Center (PVCC) specific plan and is also within the Perris Valley Master Drainage Plan (PVMDP) watershed area. The existing Line E-3 storm drain channel is part of the PVCC MDP.

This project proposes to connect the two reaches of Line E that exist on either side of the project site. The project plans to connect the existing concrete trapezoidal channel located west of the site to the existing 7-foot high by

14-foot wide RCB located east of the site, using a double 5-foot high by 10-foot wide RCB. Currently, the existing RCB does not have an adequate outlet point. The box spans across Indian Avenue but is capped on both ends with small openings matching current grades allowing limited conveyance. The flow slowly draws down through weep holes along the bottom of the bulkhead but also includes a larger opening along the top for higher flows to escape into an earthen swale that continues east within the northerly parkway of Ramona Expressway. Flow will ultimately reach and discharge into the Perris Valley Storm Drain (PVSD) which drains into the San Jacinto River before finally reaching Canyon Lake and Lake Elsinore. Due to the lack of downstream conveyance of the proposed project, mitigation for increased runoff will be required for this project. The City of Perris typically requires mitigation of the differential volume between the existing and developed condition associated with the 100-year storm event. Water quality treatment will also need to be provided onsite to be compliant with NPDES MS4 Permit and local regulations.

On-site flows generated by the proposed project will surface flow through the site utilizing ribbon gutters, curb and gutters, drop inlets and a storm drain system. The storm drain system will be used to convey flows into the proposed bio-retention basin; Basin A. Basin A is located along the north side of the site and will drain into a proposed pump station that will control the total outflow from the site. The project proposes to discharge into the existing Lateral E-3.2, which then discharges into the Line E-3 storm drain. The pump station will discharge a maximum outflow of 5 cfs to mitigate the increase in runoff.

Basin A will accept the complete runoff from the project site. The bio-retention basin will utilize a 4-foot media filter (3' of amended soil media over a 1' layer of gravel) to detain and treat the first flush runoff for water quality treatment. An outlet structure will ensure the water quality volume is retained by only allowing higher flows to bypass once 0.6-foot of ponding is achieved in the basin. Once the volume exceeds the required ponding, flows will begin to spill into the outlet structure. In addition, the basin underdrain system will discharge treated flows to the outlet structure. The high flows and treated flows from the proposed basin underdrain systems will be conveyed by the outlet structure into the pump station.

In order to mitigate the increase in runoff and not adversely affect the downstream facilities and properties, the pump station is proposed to discharge a constant rate of 5 cfs. An emergency spillway will be provided in the basin in case of a failure or improper operation of the pump station. The emergency spillway will allow flow to discharge into the surrounding street, Perry Street, where flow will enter the proposed catch basins and continue to drain south towards Ramona Expressway as has been the case historically.

A.1 Maps and Site Plans

When completing your Project-Specific WQMP, include a map of the local vicinity and existing site. In addition, include all grading, drainage, landscape/plant palette and other pertinent construction plans in Appendix 2. At a **minimum**, your WQMP Site Plan should include the following:

- Drainage Management Areas
- Proposed Structural BMPs
- Drainage Path
- Drainage Infrastructure, Inlets, Overflows
- Source Control BMPs
- Buildings, Roof Lines, Downspouts
- Impervious Surfaces
- Standard Labeling

Use your discretion on whether or not you may need to create multiple sheets or can appropriately accommodate these features on one or two sheets. Keep in mind that the Co-Permittee plan reviewer must be able to easily analyze your project utilizing this template and its associated site plans and maps.

A.2 Identify Receiving Waters

Using Table A.1 below, list in order of upstream to downstream, the receiving waters that the project site is tributary to. Continue to fill each row with the Receiving Water's 303(d) listed impairments (if any), designated beneficial uses, and proximity, if any, to a RARE beneficial use. Include a map of the receiving waters in Appendix 1.

Table A.1 Identification of Receiving Waters

Receiving Waters	EPA Approved 303(d) List Impairments	Designated Beneficial Uses	Proximity to RARE Beneficial Use
<i>Perris Valley Storm Drain (Channel)</i>	<i>None</i>	<i>None</i>	<i>Not a water body classified as RARE</i>
<i>San Jacinto River (Reach 3) (HU# 802.11)</i>	<i>None</i>	<i>MUN, AGR, GWR, REC1, REC2, WARM, WILD</i>	<i>Not a water body classified as RARE</i>
<i>San Jacinto River (Reach 2)(HU#802.11)</i>	<i>None</i>	<i>AGR, GWR, WILD, MUN, REC1, REC2, WARM</i>	<i>Not a water body classified as RARE</i>
<i>Canyon Lake (HU# 802.11, 802.12)</i>	<i>Nutrients, Pathogens</i>	<i>MUN, AGR, GWR, REC1, REC2, WARM, WILD</i>	<i>Not a water body classified as RARE</i>
<i>San Jacinto River (Reach 1) (HU#802.31, 802.32)</i>	<i>None</i>	<i>AGR, GWR, MUN, REC1, REC2, WARM, WILD</i>	<i>Not a water body classified as RARE</i>
<i>Lake Elsinore (HU# 802.31)</i>	<i>PCBs, (Organic Compound), Nutrients, Organic Enrichment (Low DO), Sediment Toxicity, Unknown Toxicity</i>	<i>REC1, REC2, WARM, WILD</i>	<i>Not a water body classified as RARE</i>

A.3 Additional Permits/Approvals required for the Project:

Table A.2 Other Applicable Permits

Agency	Permit Required	
State Department of Fish and Game, 1602 Streambed Alteration Agreement	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
State Water Resources Control Board, Clean Water Act (CWA) Section 401 Water Quality Cert.	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
US Army Corps of Engineers, CWA Section 404 Permit	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
US Fish and Wildlife, Endangered Species Act Section 7 Biological Opinion	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
Statewide Construction General Permit Coverage	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
Statewide Industrial General Permit Coverage	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
Western Riverside MSHCP Consistency Approval (e.g., JPR, DBESP)	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
Other (please list in the space below as required) Grading Permit	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N

If yes is answered to any of the questions above, the Co-Permittee may require proof of approval/coverage from those agencies as applicable including documentation of any associated requirements that may affect this Project-Specific WQMP.

Section B: Optimize Site Utilization (LID Principles)

Review of the information collected in Section 'A' will aid in identifying the principal constraints on site design and selection of LID BMPs as well as opportunities to reduce imperviousness and incorporate LID Principles into the site and landscape design. For example, **constraints** might include impermeable soils, high groundwater, groundwater pollution or contaminated soils, steep slopes, geotechnical instability, high-intensity land use, heavy pedestrian or vehicular traffic, utility locations or safety concerns. **Opportunities** might include existing natural areas, low areas, oddly configured or otherwise unbuildable parcels, easements and landscape amenities including open space and buffers (which can double as locations for bioretention BMPs), and differences in elevation (which can provide hydraulic head). Prepare a brief narrative for each of the site optimization strategies described below. This narrative will help you as you proceed with your LID design and explain your design decisions to others.

The 2010 Santa Ana MS4 Permit further requires that LID Retention BMPs (Infiltration Only or Harvest and Use) be used unless it can be shown that those BMPs are infeasible. Therefore, it is important that your narrative identify and justify if there are any constraints that would prevent the use of those categories of LID BMPs. Similarly, you should also note opportunities that exist which will be utilized during project design. Upon completion of identifying Constraints and Opportunities, include these on your WQMP Site plan in Appendix 1.

Site Optimization

The following questions are based upon Section 3.2 of the WQMP Guidance Document. Review of the WQMP Guidance Document will help you determine how best to optimize your site and subsequently identify opportunities and/or constraints, and document compliance.

Did you identify and preserve existing drainage patterns? If so, how? If not, why?

The site topography currently slopes to the southeasterly portion of the site. There is an existing inlet near the Indian Ave. and Ramona Expressway intersection that conveys flow from the site into the Indian Ave. 7-foot high by 14-foot wide reinforced concrete box. The project runoff will be conveyed to the north side of the property through the use of a storm drain. The site will utilize a pump station and a basin to detain all the increase in runoff from the site and will discharge flow into the Perry Street storm drain at a rate less than 5 cfs. Flows are then conveyed to Lateral E-3.2 then ultimately Line E-3. Line E-3 discharges into Line E.

Did you identify and protect existing vegetation? If so, how? If not, why?

No, the majority of the project site is plowed and currently vacant with little or no vegetation. Presently, dense vegetation or areas of well-established trees do not exist.

Did you identify and preserve natural infiltration capacity? If so, how? If not, why?

Infiltration testing was performed near the anticipated basin location. The infiltration rates resulted in 0.3 inches per hour. Although the infiltration testing was not performed at the exact location, the boring at the basin location is consistent with the bulk sample taken at the infiltration testing locations. These soil types typical have poor infiltration results.

Did you identify and minimize impervious area? If so, how? If not, why?

Yes, impervious area was minimized given the proposed site usage and required materials. The minimum landscaping pervious cover was achieved per code.

Did you identify and disperse runoff to adjacent pervious areas? If so, how? If not, why?

Yes, landscaped areas will be utilized as self-retaining area for water quality treatment where the grading allows. Excess runoff is then directed to one of the two water quality basins. Self-retaining areas will be designated during final engineering

Section C: Delineate Drainage Management Areas (DMAs)

Utilizing the procedure in Section 3.3 of the WQMP Guidance Document which discusses the methods of delineating and mapping your project site into individual DMAs, complete Table C.1 below to appropriately categorize the types of classification (e.g., Type A, Type B, etc.) per DMA for your project site. Upon completion of this table, this information will then be used to populate and tabulate the corresponding tables for their respective DMA classifications.

Table C.1 DMA Classifications

DMA Name or ID	Surface Type(s) ¹	Area (Sq. Ft.)	DMA Type
R-A	Roofs	428,730	D
L-A	Ornamental Landscaping	78,180	D
H-A	Concrete or Asphalt	522,630	D
BMP-A	Ornamental Landscaping	24,030	A

¹Reference Table 2-1 in the WQMP Guidance Document to populate this column

Table C.2 Type 'A', Self-Treating Areas

DMA Name or ID	Area (Sq. Ft.)	Stabilization Type	Irrigation Type (if any)
BMP-A	24,040	*	*

Table C.3 Type 'B', Self-Retaining Areas

Self-Retaining Area				Type 'C' DMAs that are draining to the Self-Retaining Area		
DMA Name/ ID	Post-project surface type	Area (square feet) [A]	Storm Depth (inches) [B]	DMA Name / ID	[C] from Table C.4 = [C]	Required Retention Depth (inches) [D]
**						

$$[D] = [B] + \frac{[B] \cdot [C]}{[A]}$$

*To be determined during final engineering.

**Self-Retaining areas may exist but will be further analyzed during final engineering.

Table C.4 Type 'C', Areas that Drain to Self-Retaining Areas

DMA					Receiving Self-Retaining DMA		
DMA Name/ ID	Area (square feet)	Post-project surface type	Runoff factor	Product	DMA name /ID	Area (square feet)	Ratio
	[A]		[B]	[C] = [A] x [B]		[D]	[C]/[D]

Table C.5 Type 'D', Areas Draining to BMPs

DMA Name or ID	BMP Name or ID
R-A, L-A, H-A	Water Quality Basin A

Note: More than one drainage management area can drain to a single LID BMP, however, one drainage management area may not drain to more than one BMP.

Section D: Implement LID BMPs

D.1 Infiltration Applicability

Is there an approved downstream ‘Highest and Best Use’ for stormwater runoff (see discussion in Chapter 2.4.4 of the WQMP Guidance Document for further details)? Y N

If yes has been checked, Infiltration BMPs shall not be used for the site. If no, continue working through this section to implement your LID BMPs. It is recommended that you contact your Co-Permittee to verify whether or not your project discharges to an approved downstream ‘Highest and Best Use’ feature.

Geotechnical Report

A Geotechnical Report or Phase I Environmental Site Assessment may be required by the Copermitttee to confirm present and past site characteristics that may affect the use of Infiltration BMPs. In addition, the Co-Permittee, at their discretion, may not require a geotechnical report for small projects as described in Chapter 2 of the WQMP Guidance Document. If a geotechnical report has been prepared, include it in Appendix 3. In addition, if a Phase I Environmental Site Assessment has been prepared, include it in Appendix 4.

Is this project classified as a small project consistent with the requirements of Chapter 2 of the WQMP Guidance Document? Y N

Infiltration Feasibility

Table D.1 below is meant to provide a simple means of assessing which DMAs on your site support Infiltration BMPs and is discussed in the WQMP Guidance Document in Chapter 2.4.5. Check the appropriate box for each question and then list affected DMAs as applicable. If additional space is needed, add a row below the corresponding answer.

Table D.1 Infiltration Feasibility

Does the project site...	YES	NO
...have any DMAs with a seasonal high groundwater mark shallower than 10 feet? If Yes, list affected DMAs:		X
...have any DMAs located within 100 feet of a water supply well? If Yes, list affected DMAs:		X
...have any areas identified by the geotechnical report as posing a public safety risk where infiltration of stormwater could have a negative impact? If Yes, list affected DMAs:		X
...have measured in-situ infiltration rates of less than 1.6 inches / hour? If Yes, list affected DMAs: DMA A	X	
...have significant cut and/or fill conditions that would preclude in-situ testing of infiltration rates at the final infiltration surface? If Yes, list affected DMAs:		X
...geotechnical report identify other site-specific factors that would preclude effective and safe infiltration? Describe here:		X

If you answered “Yes” to any of the questions above for any DMA, Infiltration BMPs should not be used for those DMAs and you should proceed to the assessment for Harvest and Use below.

D.2 Harvest and Use Assessment

Please check what applies:

- Reclaimed water will be used for the non-potable water demands for the project.
- Downstream water rights may be impacted by Harvest and Use as approved by the Regional Board (verify with the Copermittee).
- The Design Capture Volume will be addressed using Infiltration Only BMPs. In such a case, Harvest and Use BMPs are still encouraged, but it would not be required if the Design Capture Volume will be infiltrated or evapotranspired.

If any of the above boxes have been checked, Harvest and Use BMPs need not be assessed for the site. If neither of the above criteria applies, follow the steps below to assess the feasibility of irrigation use, toilet use and other non-potable uses (e.g., industrial use).

Irrigation Use Feasibility

Complete the following steps to determine the feasibility of harvesting stormwater runoff for Irrigation Use BMPs on your site:

Step 1: Identify the total area of irrigated landscape on the site, and the type of landscaping used.

Total Area of Irrigated Landscape: Insert Area (Acres)

Type of Landscaping (Conservation Design or Active Turf): List Landscaping Type

Step 2: Identify the planned total of all impervious areas on the proposed project from which runoff might be feasibly captured and stored for irrigation use. Depending on the configuration of buildings and other impervious areas on the site, you may consider the site as a whole, or parts of the site, to evaluate reasonable scenarios for capturing and storing runoff and directing the stored runoff to the potential use(s) identified in Step 1 above.

Total Area of Impervious Surfaces: Insert Area (Acres)

Step 3: Cross reference the Design Storm depth for the project site (see Exhibit A of the WQMP Guidance Document) with the left column of Table 2-3 in Chapter 2 to determine the minimum area of Effective Irrigated Area per Tributary Impervious Area (EIATIA).

Enter your EIATIA factor: EIATIA Factor

Step 4: Multiply the unit value obtained from Step 3 by the total of impervious areas from Step 2 to develop the minimum irrigated area that would be required.

Minimum required irrigated area: Insert Area (Acres)

Step 5: Determine if harvesting stormwater runoff for irrigation use is feasible for the project by comparing the total area of irrigated landscape (Step 1) to the minimum required irrigated area (Step 4).

Minimum required irrigated area (Step 4)	Available Irrigated Landscape (Step 1)
Insert Area (Acres)	Insert Area (Acres)

Toilet Use Feasibility

Complete the following steps to determine the feasibility of harvesting stormwater runoff for toilet flushing uses on your site:

Step 1: Identify the projected total number of daily toilet users during the wet season, and account for any periodic shut downs or other lapses in occupancy:

Projected Number of Daily Toilet Users: Number of daily Toilet Users

Project Type: Enter 'Residential', 'Commercial', 'Industrial' or 'Schools'

Step 2: Identify the planned total of all impervious areas on the proposed project from which runoff might be feasibly captured and stored for toilet use. Depending on the configuration of buildings and other impervious areas on the site, you may consider the site as a whole, or parts of the site, to evaluate reasonable scenarios for capturing and storing runoff and directing the stored runoff to the potential use(s) identified in Step 1 above.

Total Area of Impervious Surfaces: Insert Area (Acres)

Step 3: Enter the Design Storm depth for the project site (see Exhibit A) into the left column of Table 2-1 in Chapter 2 to determine the minimum number of toilet users per tributary impervious acre (TUTIA).

Enter your TUTIA factor: TUTIA Factor

Step 4: Multiply the unit value obtained from Step 3 by the total of impervious areas from Step 2 to develop the minimum number of toilet users that would be required.

Minimum number of toilet users: Required number of toilet users

Step 5: Determine if harvesting stormwater runoff for toilet flushing use is feasible for the project by comparing the Number of Daily Toilet Users (Step 1) to the minimum required number of toilet users (Step 4).

Minimum required Toilet Users (Step 4)

Insert Area (Acres)

Projected number of toilet users (Step 1)

Insert Area (Acres)

Other Non-Potable Use Feasibility

Are there other non-potable uses for stormwater runoff on the site (e.g. industrial use)? See Chapter 2 of the Guidance for further information. If yes, describe below. If no, write N/A.

Insert narrative description here.

Step 1: Identify the projected average daily non-potable demand, in gallons per day, during the wet season and accounting for any periodic shut downs or other lapses in occupancy or operation.

Average Daily Demand: Projected Average Daily Use (gpd)

Step 2: Identify the planned total of all impervious areas on the proposed project from which runoff might be feasibly captured and stored for the identified non-potable use. Depending on the configuration of buildings and other impervious areas on the site, you may consider the site as a whole, or parts of the site, to evaluate reasonable scenarios for capturing and storing runoff and directing the stored runoff to the potential use(s) identified in Step 1 above.

Total Area of Impervious Surfaces: Insert Area (Acres)

Step 3: Enter the Design Storm depth for the project site (see Exhibit A) into the left column of Table 2-3 in Chapter 2 to determine the minimum demand for non-potable uses per tributary impervious acre.

Enter the factor from Table 2-3: Enter Value

Step 4: Multiply the unit value obtained from Step 4 by the total of impervious areas from Step 3 to develop the minimum number of gallons per day of non-potable use that would be required.

Minimum required use: Minimum use required (gpd)

Step 5: Determine if harvesting stormwater runoff for other non-potable use is feasible for the project by comparing the Number of Daily Toilet Users (Step 1) to the minimum required number of toilet users (Step 4).

Minimum required non-potable use (Step 4)	Projected average daily use (Step 1)
Minimum use required (gpd)	Projected Average Daily Use (gpd)

If Irrigation, Toilet and Other Use feasibility anticipated demands are less than the applicable minimum values, Harvest and Use BMPs are not required and you should proceed to utilize LID Bioretention and Biotreatment, unless a site-specific analysis has been completed that demonstrates technical infeasibility as noted in D.3 below.

D.3 Bioretention and Biotreatment Assessment

Other LID Bioretention and Biotreatment BMPs as described in Chapter 2.4.7 of the WQMP Guidance Document are feasible on nearly all development sites with sufficient advance planning.

Select one of the following:

LID Bioretention/Biotreatment BMPs will be used for some or all DMAs of the project as noted below in Section D.4 (note the requirements of Section 3.4.2 in the WQMP Guidance Document).

A site-specific analysis demonstrating the technical infeasibility of all LID BMPs has been performed and is included in Appendix 5. If you plan to submit an analysis demonstrating the technical infeasibility of LID BMPs, request a pre-submittal meeting with the Copermittee to discuss this option. Proceed to Section E to document your alternative compliance measures.

D.4 Feasibility Assessment Summaries

From the Infiltration, Harvest and Use, Bioretention and Biotreatment Sections above, complete Table D.2 below to summarize which LID BMPs are technically feasible, and which are not, based upon the established hierarchy.

Table D.2 LID Prioritization Summary Matrix

DMA Name/ID	LID BMP Hierarchy				No LID (Alternative Compliance)
	1. Infiltration	2. Harvest and use	3. Bioretention	4. Biotreatment	
DMA-A	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

For those DMAs where LID BMPs are not feasible, provide a brief narrative below summarizing why they are not feasible, include your technical infeasibility criteria in Appendix 5, and proceed to Section E below to document Alternative Compliance measures for those DMAs. Recall that each proposed DMA must pass through the LID BMP hierarchy before alternative compliance measures may be considered.

N/A

D.5 LID BMP Sizing

Each LID BMP must be designed to ensure that the Design Capture Volume will be addressed by the selected BMPs. First, calculate the Design Capture Volume for each LID BMP using the V_{BMP} worksheet in Appendix F of the LID BMP Design Handbook. Second, design the LID BMP to meet the required V_{BMP} using a method approved by the Copermittee. Utilize the worksheets found in the LID BMP Design Handbook or consult with your Copermittee to assist you in correctly sizing your LID BMPs. Complete Table D.3 below to document the Design Capture Volume and the Proposed Volume for each LID BMP. Provide the completed design procedure sheets for each LID BMP in Appendix 6. You may add additional rows to the table below as needed.

Table D.3 DCV Calculations for LID BMPs

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I_f	DMA Runoff Factor	DMA Areas x Runoff Factor	BASIN-A		
	[A]							
R-A	428,730	ROOFS	1	0.89	382,427.2	Design Storm Depth (in)	Design Capture Volume, V_{BMP} (cubic feet)	Proposed Volume on Plans (cubic feet)
L-A	78,180	ORNAMENTAL LANDSCAPING	0.1	0.11	8,635.6			
H-A	522,630	CONCRETE OR ASPHALT	1	0.89	466,186			
	$A_T = 1,053,570$				$\Sigma = 857,248.8$	[E] 0.62	44291.2	[G] 45,657

[B], [C] is obtained as described in Section 2.3.1 of the WQMP Guidance Document

[E] is obtained from Exhibit A in the WQMP Guidance Document

[G] is obtained from a design procedure sheet, such as in LID BMP Design Handbook and placed in Appendix 6

Section E: Alternative Compliance (LID Waiver Program)

LID BMPs are expected to be feasible on virtually all projects. Where LID BMPs have been demonstrated to be infeasible as documented in Section D, other Treatment Control BMPs must be used (subject to LID waiver approval by the Copermittee). Check one of the following Boxes:

LID Principles and LID BMPs have been incorporated into the site design to fully address all Drainage Management Areas. No alternative compliance measures are required for this project and thus this Section is not required to be completed.

- Or -

The following Drainage Management Areas are unable to be addressed using LID BMPs. A site-specific analysis demonstrating technical infeasibility of LID BMPs has been approved by the Co-Permittee and included in Appendix 5. Additionally, no downstream regional and/or sub-regional LID BMPs exist or are available for use by the project. The following alternative compliance measures on the following pages are being implemented to ensure that any pollutant loads expected to be discharged by not incorporating LID BMPs, are fully mitigated.

All DMAs to be treated by bio-retention basin.

E.1 Identify Pollutants of Concern

Utilizing Table A.1 from Section A above which noted your project's receiving waters and their associated EPA approved 303(d) listed impairments, cross reference this information with that of your selected Priority Development Project Category in Table E.1 below. If the identified General Pollutant Categories are the same as those listed for your receiving waters, then these will be your Pollutants of Concern and the appropriate box or boxes will be checked on the last row. The purpose of this is to document compliance and to help you appropriately plan for mitigating your Pollutants of Concern in lieu of implementing LID BMPs.

Table E.1 Potential Pollutants by Land Use Type

Priority Development Project Categories and/or Project Features (check those that apply)	General Pollutant Categories							
	Bacterial Indicators	Metals	Nutrients	Pesticides	Toxic Organic Compounds	Sediments	Trash & Debris	Oil & Grease
<input type="checkbox"/> Detached Residential Development	P	N	P	P	N	P	P	P
<input type="checkbox"/> Attached Residential Development	P	N	P	P	N	P	P	P ⁽²⁾
<input checked="" type="checkbox"/> Commercial/Industrial Development	P ⁽³⁾	P	P ⁽¹⁾	P ⁽¹⁾	P ⁽⁵⁾	P ⁽¹⁾	P	P
<input type="checkbox"/> Automotive Repair Shops	N	P	N	N	P ^(4, 5)	N	P	P
<input type="checkbox"/> Restaurants (>5,000 ft ²)	P	N	N	N	N	N	P	P
<input type="checkbox"/> Hillside Development (>5,000 ft ²)	P	N	P	P	N	P	P	P
<input type="checkbox"/> Parking Lots (>5,000 ft ²)	P ⁽⁶⁾	P	P ⁽¹⁾	P ⁽¹⁾	P ⁽⁴⁾	P ⁽¹⁾	P	P
<input type="checkbox"/> Retail Gasoline Outlets	N	P	N	N	P	N	P	P
Project Priority Pollutant(s) of Concern	<input checked="" type="checkbox"/>							

P = Potential

N = Not Potential

⁽¹⁾ A potential Pollutant if non-native landscaping exists or is proposed onsite; otherwise not expected

⁽²⁾ A potential Pollutant if the project includes uncovered parking areas; otherwise not expected

⁽³⁾ A potential Pollutant is land use involving animal waste

⁽⁴⁾ Specifically petroleum hydrocarbons

⁽⁵⁾ Specifically solvents

⁽⁶⁾ Bacterial indicators are routinely detected in pavement runoff

E.2 Stormwater Credits

Projects that cannot implement LID BMPs but nevertheless implement smart growth principles are potentially eligible for Stormwater Credits. Utilize Table 3-8 within the WQMP Guidance Document to identify your Project Category and its associated Water Quality Credit. If not applicable, write N/A.

Table E.2 Water Quality Credits

Qualifying Project Categories	Credit Percentage ²
<i>Total Credit Percentage¹</i>	

¹Cannot Exceed 50%

²Obtain corresponding data from Table 3-8 in the WQMP Guidance Document

E.3 Sizing Criteria

After you appropriately considered Stormwater Credits for your project, utilize Table E.3 below to appropriately size them to the DCV, or Design Flow Rate, as applicable. Please reference Chapter 3.5.2 of the WQMP Guidance Document for further information.

Table E.3 Treatment Control BMP Sizing

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I _f	DMA Runoff Factor	DMA Area x Runoff Factor	Enter BMP Name / Identifier Here			
	[A]		[B]	[C]	[A] x [C]				
						<i>Design Storm Depth (in)</i>	<i>Minimum Design Capture Volume or Design Flow Rate (cubic feet or cfs)</i>	<i>Total Storm Water Credit % Reduction</i>	<i>Proposed Volume or Flow on Plans (cubic feet or cfs)</i>
	$A_T = \sum[A]$				$\sum = [D]$	[E]	$[F] = \frac{[D] \times [E]}{[G]}$	$[F] \times (1-[H])$	[I]

[B], [C] is obtained as described in Section 2.3.1 from the WQMP Guidance Document

[E] is obtained from Exhibit A in the WQMP Guidance Document

[G] is for Flow-Based Treatment Control BMPs [G] = 43,560, for Volume-Based Control Treatment BMPs, [G] = 12

[H] is from the Total Credit Percentage as Calculated from Table E.2 above

[I] as obtained from a design procedure sheet from the BMP manufacturer and should be included in Appendix 6

E.4 Treatment Control BMP Selection

Treatment Control BMPs typically provide proprietary treatment mechanisms to treat potential pollutants in runoff, but do not sustain significant biological processes. Treatment Control BMPs must have a removal efficiency of a medium or high effectiveness as quantified below:

- **High:** equal to or greater than 80% removal efficiency
- **Medium:** between 40% and 80% removal efficiency

Such removal efficiency documentation (e.g., studies, reports, etc.) as further discussed in Chapter 3.5.2 of the WQMP Guidance Document, must be included in Appendix 6. In addition, ensure that proposed Treatment Control BMPs are properly identified on the WQMP Site Plan in Appendix 1.

Table E.4 Treatment Control BMP Selection

Selected Treatment Control BMP Name or ID ¹	Priority Pollutant(s) of Concern to Mitigate ²	Removal Percentage ³	Efficiency

¹ Treatment Control BMPs must not be constructed within Receiving Waters. In addition, a proposed Treatment Control BMP may be listed more than once if they possess more than one qualifying pollutant removal efficiency.

² Cross Reference Table E.1 above to populate this column.

³ As documented in a Co-Permittee Approved Study and provided in Appendix 6.

Section F: Hydromodification

F.1 Hydrologic Conditions of Concern (HCOC) Analysis

Once you have determined that the LID design is adequate to address water quality requirements, you will need to assess if the proposed LID Design may still create a HCOC. Review Chapters 2 and 3 (including Figure 3-7) of the WQMP Guidance Document to determine if your project must mitigate for Hydromodification impacts. If your project meets one of the following criteria which will be indicated by the check boxes below, you do not need to address Hydromodification at this time. However, if the project does not qualify for Exemptions 1, 2 or 3, then additional measures must be added to the design to comply with HCOC criteria. This is discussed in further detail below in Section F.2.

HCOC EXEMPTION 1: The Priority Development Project disturbs less than one acre. The Copermitttee has the discretion to require a Project-Specific WQMP to address HCOCs on projects less than one acre on a case by case basis. The disturbed area calculation should include all disturbances associated with larger common plans of development.

Does the project qualify for this HCOC Exemption? Y N

If Yes, HCOC criteria do not apply.

HCOC EXEMPTION 2: The volume and time of concentration¹ of storm water runoff for the post-development condition is not significantly different from the pre-development condition for a 2-year return frequency storm (a difference of 5% or less is considered insignificant) using one of the following methods to calculate:

- Riverside County Hydrology Manual
- Technical Release 55 (TR-55): Urban Hydrology for Small Watersheds (NRCS 1986), or derivatives thereof, such as the Santa Barbara Urban Hydrograph Method
- Other methods acceptable to the Co-Permittee

Does the project qualify for this HCOC Exemption? Y N

If Yes, report results in Table F.1 below and provide your substantiated hydrologic analysis in Appendix 7.

Table F.1 Hydrologic Conditions of Concern Summary

	2 year – 24 hour		
	Pre-condition	Post-condition	% Difference
Time of Concentration	INSERT VALUE	INSERT VALUE	INSERT VALUE
Volume (Cubic Feet)	INSERT VALUE	INSERT VALUE	INSERT VALUE

¹ Time of concentration is defined as the time after the beginning of the rainfall when all portions of the drainage basin are contributing to flow at the outlet.

HCOC EXEMPTION 3: All downstream conveyance channels to an adequate sump (for example, Prado Dam, Lake Elsinore, Canyon Lake, Santa Ana River, or other lake, reservoir or naturally erosion resistant feature) that will receive runoff from the project are engineered and regularly maintained to ensure design flow capacity; no sensitive stream habitat areas will be adversely affected; or are not identified on the Co-Permittees Hydromodification Sensitivity Maps.

Does the project qualify for this HCOC Exemption? Y N

If Yes, HCOC criteria do not apply and note below which adequate sump applies to this HCOC qualifier:

F.2 HCOC Mitigation

If none of the above HCOC Exemption Criteria are applicable, HCOC criteria is considered mitigated if they meet one of the following conditions:

- a. Additional LID BMPS are implemented onsite or offsite to mitigate potential erosion or habitat impacts as a result of HCOCs. This can be conducted by an evaluation of site-specific conditions utilizing accepted professional methodologies published by entities such as the California Stormwater Quality Association (CASQA), the Southern California Coastal Water Research Project (SCCRWP), or other Co-Permittee approved methodologies for site-specific HCOC analysis.
- b. The project is developed consistent with an approved Watershed Action Plan that addresses HCOC in Receiving Waters.
- c. Mimicking the pre-development hydrograph with the post-development hydrograph, for a 2-year return frequency storm. Generally, the hydrologic conditions of concern are not significant, if the post-development hydrograph is no more than 10% greater than pre-development hydrograph. In cases where excess volume cannot be infiltrated or captured and reused, discharge from the site must be limited to a flow rate no greater than 110% of the pre-development 2-year peak flow.

Be sure to include all pertinent documentation used in your analysis of the items a, b or c in Appendix 7.

This project is located within the approved Hydromodification exempt area based on the approved HCOC Applicability Map (approved April 20, 2017) furnished by the Santa Ana Region Co-Permittees.

Section G: Source Control BMPs

Source control BMPs include permanent, structural features that may be required in your project plans — such as roofs over and berms around trash and recycling areas — and Operational BMPs, such as regular sweeping and “housekeeping”, that must be implemented by the site’s occupant or user. The MEP standard typically requires both types of BMPs. In general, Operational BMPs cannot be substituted for a feasible and effective permanent BMP. Using the Pollutant Sources/Source Control Checklist in Appendix 8, review the following procedure to specify Source Control BMPs for your site:

1. **Identify Pollutant Sources:** Review Column 1 in the Pollutant Sources/Source Control Checklist. Check off the potential sources of Pollutants that apply to your site.
2. **Note Locations on Project-Specific WQMP Exhibit:** Note the corresponding requirements listed in Column 2 of the Pollutant Sources/Source Control Checklist. Show the location of each Pollutant source and each permanent Source Control BMP in your Project-Specific WQMP Exhibit located in Appendix 1.
3. **Prepare a Table and Narrative:** Check off the corresponding requirements listed in Column 3 in the Pollutant Sources/Source Control Checklist. In the left column of Table G.1 below, list each potential source of runoff Pollutants on your site (from those that you checked in the Pollutant Sources/Source Control Checklist). In the middle column, list the corresponding permanent, Structural Source Control BMPs (from Columns 2 and 3 of the Pollutant Sources/Source Control Checklist) used to prevent Pollutants from entering runoff. **Add additional narrative** in this column that explains any special features, materials or methods of construction that will be used to implement these permanent, Structural Source Control BMPs.
4. **Identify Operational Source Control BMPs:** To complete your table, refer once again to the Pollutant Sources/Source Control Checklist. List in the right column of your table the Operational BMPs that should be implemented as long as the anticipated activities continue at the site. Copermittee stormwater ordinances require that applicable Source Control BMPs be implemented; the same BMPs may also be required as a condition of a use permit or other revocable Discretionary Approval for use of the site.

Table G.1 Permanent and Operational Source Control Measures

Potential Sources of Runoff pollutants	Permanent Structural Source Control BMPs	Operational Source Control BMPs
A. <i>On-site storm drain catch basins and grated inlets. Locations are shown on the PWQMP Exhibit in Appendix 1.</i>	<i>On-site storm drain signage will utilize language, “No Dumping Drains to River”, or equally approved text that is consistent with the City of Perris’ requirements. Landscape area drains surrounded by vegetation will not be signed. Catch Basin Markers may be available from the Riverside County Flood Control and Water District Conservation District, call 951-955-1200 to verify.</i>	<i>Maintain and periodically repaint or replace inlet markings. Provide stormwater pollution prevention information to new site owners, lessees, or operators. See applicable operational BMPs in Fact Sheet SC-44, “Drainage System Maintenance,” in Appendix 10 (CASQA Stormwater Quality Handbook at www.cabmphandbooks.com</i>

	<p><i>On-site drainage structures, including all storm drain clean outs, area drains, inlets, catch basins, inlet & outlet structures, forebays, & water treatment control basins shall be inspected and maintained on a regular basis to insure their operational adequacy.</i></p>	<p><i>Include the following in lessee agreements: "Tenants shall not allow anyone to discharge anything to storm drains or to store or deposit materials so as to create a potential discharge to storm drains"</i></p> <p><i>Maintenance should include removal of trash, debris, & sediment and the repair of any deficiencies or damage that may impact water quality.</i></p>
<p><i>B. Interior floor drains and elevator shaft sump</i></p>	<p><i>The interior floor drains and elevator shaft sump pumps will be plumbed to sanitary sewer</i></p>	<p><i>Inspect and maintain drains to prevent blockages and overflow.</i></p>
<p><i>C. Landscape/Outdoor Pesticide Use</i></p>	<p><i>The final landscape shall be designed to accomplish all of the following:</i></p> <p><i>Preserve existing native trees, shrubs and ground cover to the maximum extent possible.</i></p> <p><i>Design landscape to minimize irrigation and runoff, to promote surface infiltration where appropriate and to minimize the use of fertilizers and pesticides that can contribute to stormwater pollution.</i></p> <p><i>Where landscaped areas are used to retain or detain stormwater, specify plants that are tolerant of saturated soil conditions.</i></p> <p><i>Consider using pest-resistant plants, especially adjacent to hardscape.</i></p> <p><i>To insure successful establishments, select plants appropriate to site, soils, slopes, climate, sun, wind, rain, land use, air movement, ecological consistency and plant interactions.</i></p> <p><i>Pesticide usage should be at a necessary minimum and be consistent with the instructions contained on product labels and with the regulations administered by the State Department of Pesticide Regulation.</i></p> <p><i>Pesticides should be used at an absolute minimum or not at all in the retention/infiltration basin. If used, it</i></p>	<p><i>Maintain landscaping using minimum or no pesticides</i></p> <p><i>See applicable operational BMPs in "What you should know for... Landscape and Gardening" at http://rcflood.org/stormwater and Appendix 10.</i></p> <p><i>Provide IPM information to new owners, lessees and operators.</i></p> <p><i>Landscape maintenance should include mowing, weeding, trimming, removal of trash & debris, repair of erosion, re-vegetation, and removal of cut & dead vegetation.</i></p> <p><i>Irrigation maintenance should include the repair of leaky or broken sprinkler heads, the maintaining of timing apparatus accuracy, and the maintaining of shut off valves in good working order.</i></p>

	<i>should not be applied in close proximity to the rainy season.</i>	
<i>D. Refuse Trash Storage areas</i>	<p><i>Trash container storage areas shall be paved with an impervious surface, designed not to allow run-on from adjoining areas, designed to divert drainage from adjoining roofs and pavements from the surrounding area, and screened or walled to prevent off-site transport of trash.</i></p> <p><i>Trash dumpsters (containers) shall be leak proof and have attached covers or lids.</i></p> <p><i>Trash enclosures shall be roofed per City standards and the details on the PWQMP Exhibit in Appendix 1.</i></p> <p><i>Trash compactors shall be roofed and set on a concrete pad per City standards. The pad shall be a minimum of one foot larger all around than the trash compactor and sloped to drain to a sanitary sewer line. Connection of trash area drains to the MS4 is prohibited.</i></p> <p><i>See CASQA SD-32 BMP Fact Sheets in Appendix 10 for additional information.</i></p> <p><i>Signs shall be posted on or near dumpsters with the words "Do not dump hazardous materials here" or similar.</i></p>	<p><i>Adequate number of receptacles shall be provided. Inspect receptacles regularly; repair or replace leaky receptacles. Keep receptacles covered.</i></p> <p><i>Prohibit/prevent dumping of liquid or hazardous wastes. Post "no hazardous materials" signs.</i></p> <p><i>Inspect and pick up litter daily and clean up spills immediately. Keep spill control materials available on-site. See Fact Sheet SC-34, in Appendix 10, "Waste Handling and Disposal" in the CASQA Stormwater Quality Handbook at www.cabmphandbooks.com</i></p>
<i>E. Loading Docks</i>	<p><i>Loading docks will not be covered and are 4 feet above finished pavement surface.</i></p> <p><i>Spill kits are to be kept on-site at all times per SC-11.</i></p>	<p><i>Move loaded and unloaded items indoors as soon as possible.</i></p> <p><i>Inspect for accumulated trash and debris. Implement good housekeeping procedures on a regular basis. Sweep areas clean instead of using wash water. Loading docks will be kept in a clean and orderly condition, through a regular program of sweeping and litter control, and immediate clean up of any spills or broken containers. Property owner will ensure that loading docks will be swept as needed. Cleanup procedures will not include the use of wash-down water. Property owner will be responsible for implementation of loading dock housekeeping procedures</i></p> <p><i>See the Fact Sheet SC-30, in Appendix 10, "Outdoor Loading</i></p>

		<i>and Unloading” in the CASQA Stormwater Quality Handbooks at www.cabmphandbooks.com</i>
<i>F. Fire Sprinkler Test Water</i>	<i>Provide a means to drain fire sprinkler test water to the sanitary sewer.</i>	<i>See the note in the Fact Sheet SC-41, in Appendix 10, “Building and Grounds Maintenance”, in the CASQA Stormwater Quality Handbooks at www.cabmphandbooks.com</i>
<i>G. Miscellaneous Drain or Wash Water or Other Sources</i> <i>Boiler drain lines</i> <i>Condensate drain lines</i> <i>Rooftop equipment</i> <i>Drainage sumps</i> <i>Roofing, gutters and trim</i> <i>Other sources</i>	<i>Boiler drain lines shall be directly or indirectly connected to the sanitary sewer system and may not discharge to the storm drain system</i> <i>Condensate drain lines may discharge to landscaped areas if the flow is small enough that runoff will not occur.</i> <i>Condensate drain lines may not discharge to the storm drain system.</i> <i>Rooftop equipment with potential to produce pollutants shall be roofed and/or have secondary containment.</i> <i>Any drainage sumps on-site shall feature a sediment sump to reduce the quantity of sediment in pumped water.</i> <i>Avoid roofing, gutters and trim made of copper or other unprotected metals that may leach into runoff.</i> <i>Include controls for other sources as specified by local reviewer.</i>	
<i>H. Plazas, sidewalks, and parking lots</i>	<i>Spill kits are to be kept on-site at all times per SC-11.</i>	<i>Sweep plazas, sidewalks, and parking lots regularly to prevent accumulation of litter and debris. Collect debris from pressure washing to prevent entry into the storm drain system. Collect washwater containing any cleaning agent or degreaser and discharge to the sanitary sewer not to a storm drain.</i>

Section H: Construction Plan Checklist

Populate Table H.1 below to assist the plan checker in an expeditious review of your project. The first two columns will contain information that was prepared in previous steps, while the last column will be populated with the corresponding plan sheets. This table is to be completed with the submittal of your final Project-Specific WQMP.

Table H.1 Construction Plan Cross-reference

BMP No. or ID	BMP Identifier and Description	Corresponding Plan Sheet(s)

Note that the updated table — or Construction Plan WQMP Checklist — is **only a reference tool** to facilitate an easy comparison of the construction plans to your Project-Specific WQMP. Co-Permittee staff can advise you regarding the process required to propose changes to the approved Project-Specific WQMP.

***To be completed during Final Engineering**

Section I: Operation, Maintenance and Funding

The Copermitttee will periodically verify that Stormwater BMPs on your site are maintained and continue to operate as designed. To make this possible, your Copermitttee will require that you include in Appendix 9 of this Project-Specific WQMP:

1. A means to finance and implement facility maintenance in perpetuity, including replacement cost.
2. Acceptance of responsibility for maintenance from the time the BMPs are constructed until responsibility for operation and maintenance is legally transferred. A warranty covering a period following construction may also be required.
3. An outline of general maintenance requirements for the Stormwater BMPs you have selected.
4. Figures delineating and designating pervious and impervious areas, location, and type of Stormwater BMP, and tables of pervious and impervious areas served by each facility. Geo-locating the BMPs using a coordinate system of latitude and longitude is recommended to help facilitate a future statewide database system.
5. A separate list and location of self-retaining areas or areas addressed by LID Principles that do not require specialized O&M or inspections but will require typical landscape maintenance as noted in Chapter 5, pages 85-86, in the WQMP Guidance. Include a brief description of typical landscape maintenance for these areas.

Your local Co-Permitttee will also require that you prepare and submit a detailed Stormwater BMP Operation and Maintenance Plan that sets forth a maintenance schedule for each of the Stormwater BMPs built on your site. An agreement assigning responsibility for maintenance and providing for inspections and certification may also be required.

Details of these requirements and instructions for preparing a Stormwater BMP Operation and Maintenance Plan are in Chapter 5 of the WQMP Guidance Document.

Maintenance Mechanism: WQMP Covenant and Agreement

Will the proposed BMPs be maintained by a Home Owners' Association (HOA) or Property Owners Association (POA)?


Y N

Include your Operation and Maintenance Plan and Maintenance Mechanism in Appendix 9. Additionally, include all pertinent forms of educational materials for those personnel that will be maintaining the proposed BMPs within this Project-Specific WQMP in Appendix 10.

***To be completed during Final Engineering.**

Appendix 1: Maps and Site Plans

Location Map, WQMP Site Plan and Receiving Waters Map

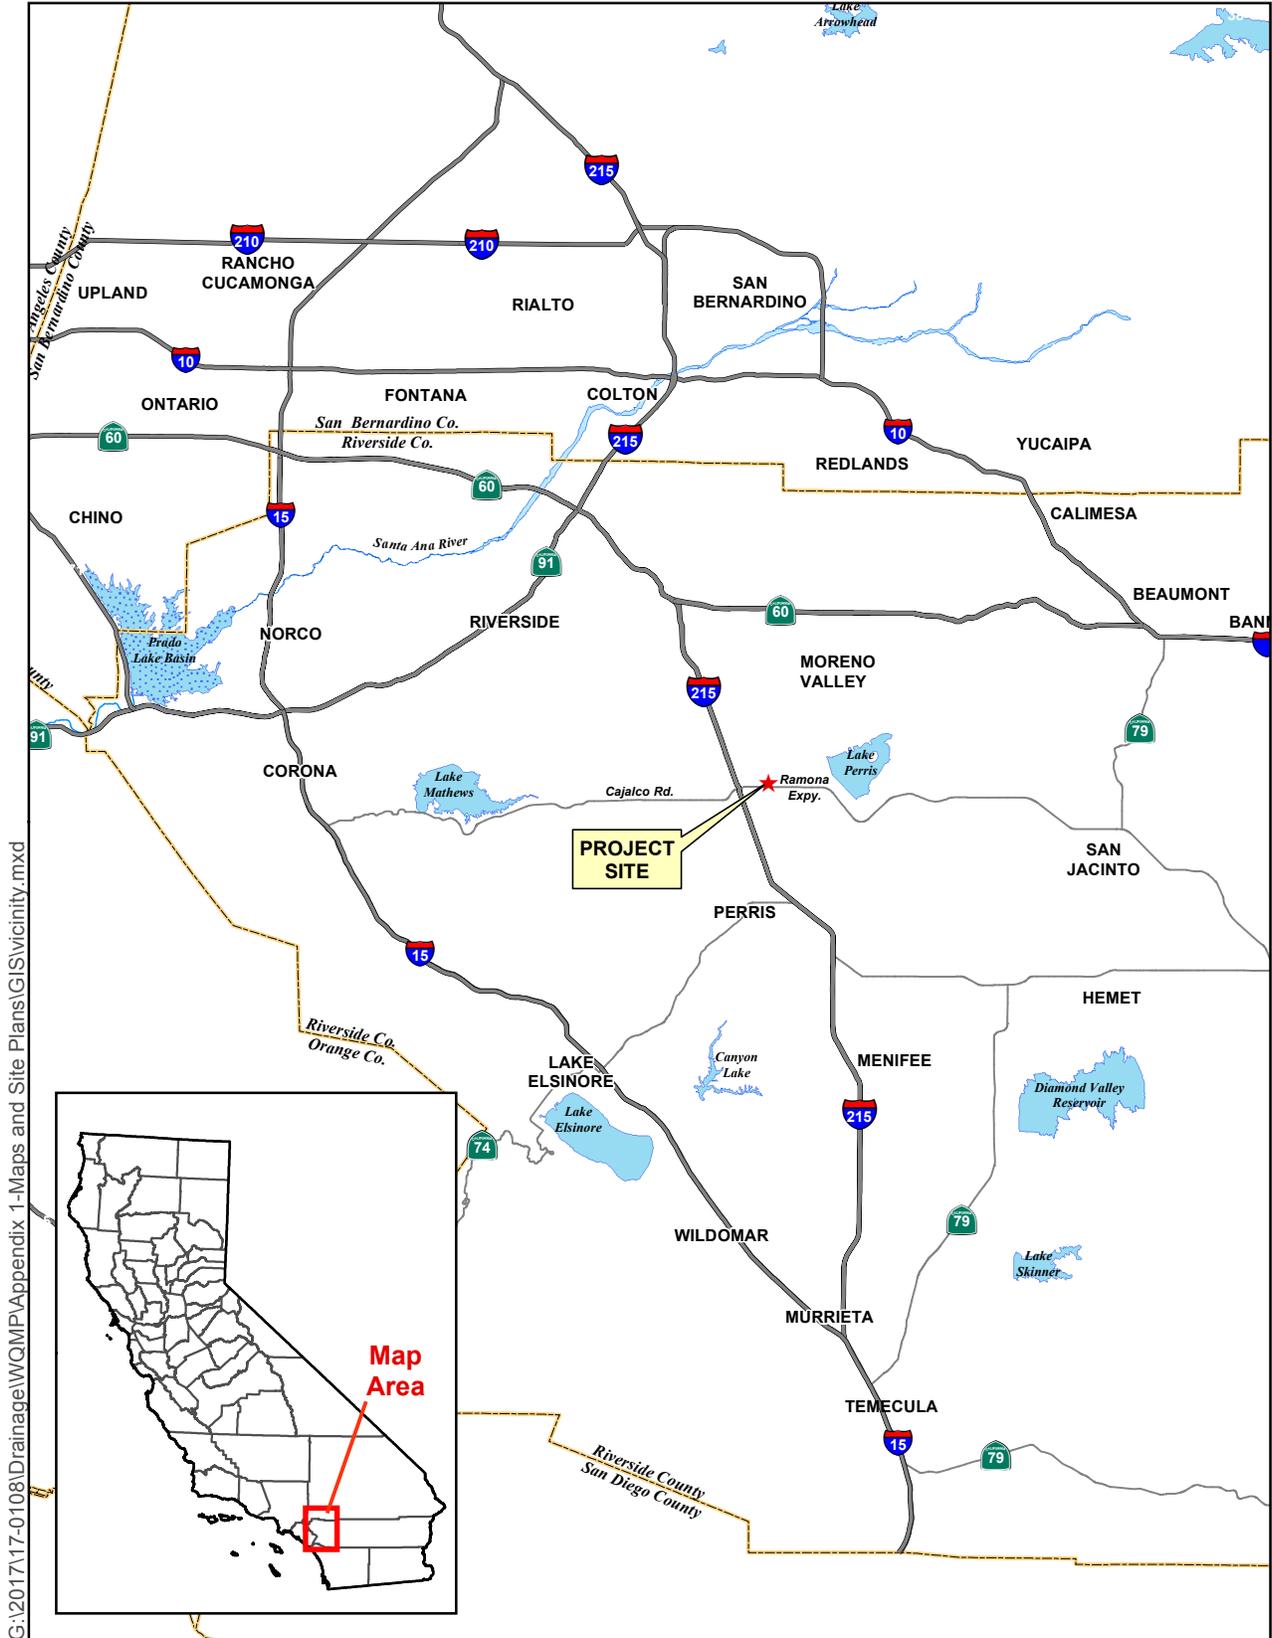


G:\2017\17-0108\Drainage\WQMP\Appendix 1-Maps and Site Plans\GIS\vicinity.mxd

Figure 1. Vicinity Map

0 2.5 5
Miles



H:\201919-0008\Drainage\WQMP\Appendix 1-Maps and Site Plans\GIS\usgs.mxd

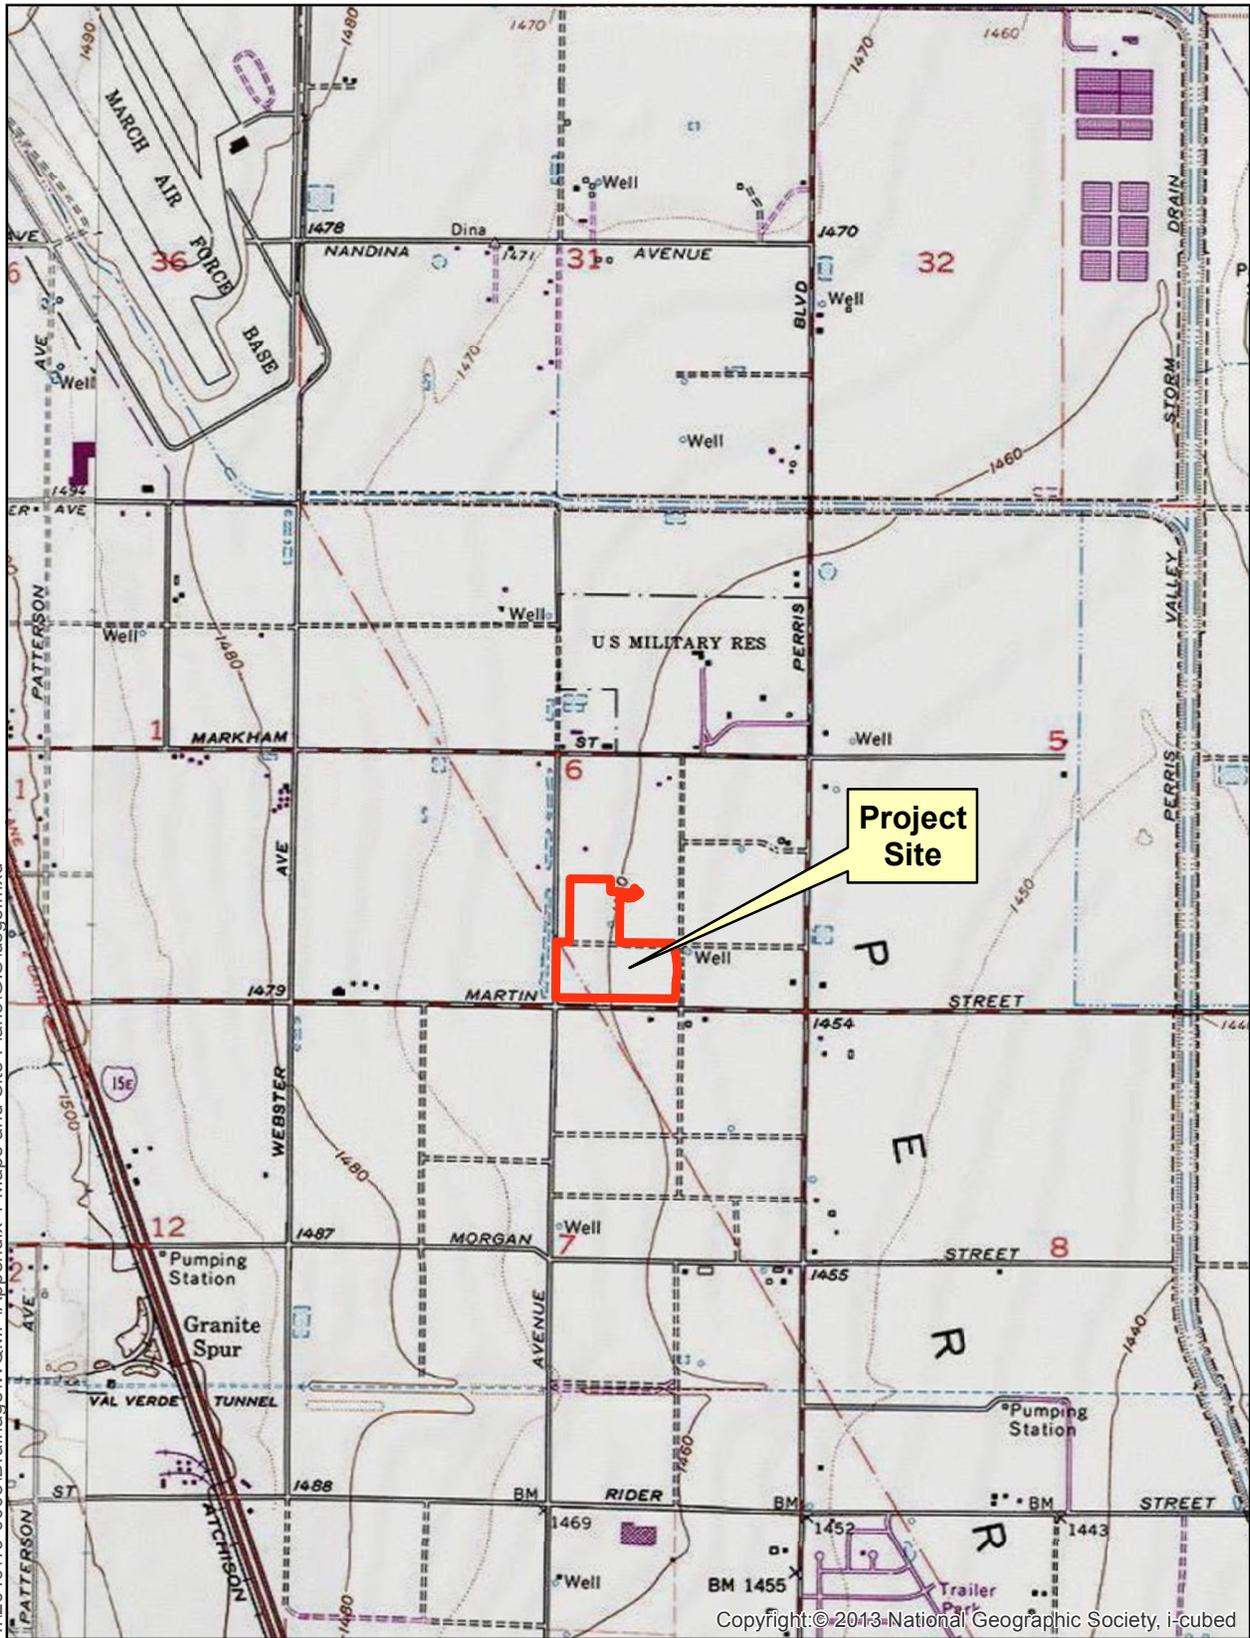

Copyright: © 2013 National Geographic Society, i-cubed


Sources: ESRI / USGS 7.5min Quad
DRGs: PERRIS

Figure 2. USGS Topography Map

0 1,000 2,000
Feet



H:\201919-0008\Drainage\WQMP\Appendix 1-Maps and Site Plans\GIS\Aerial.mxd

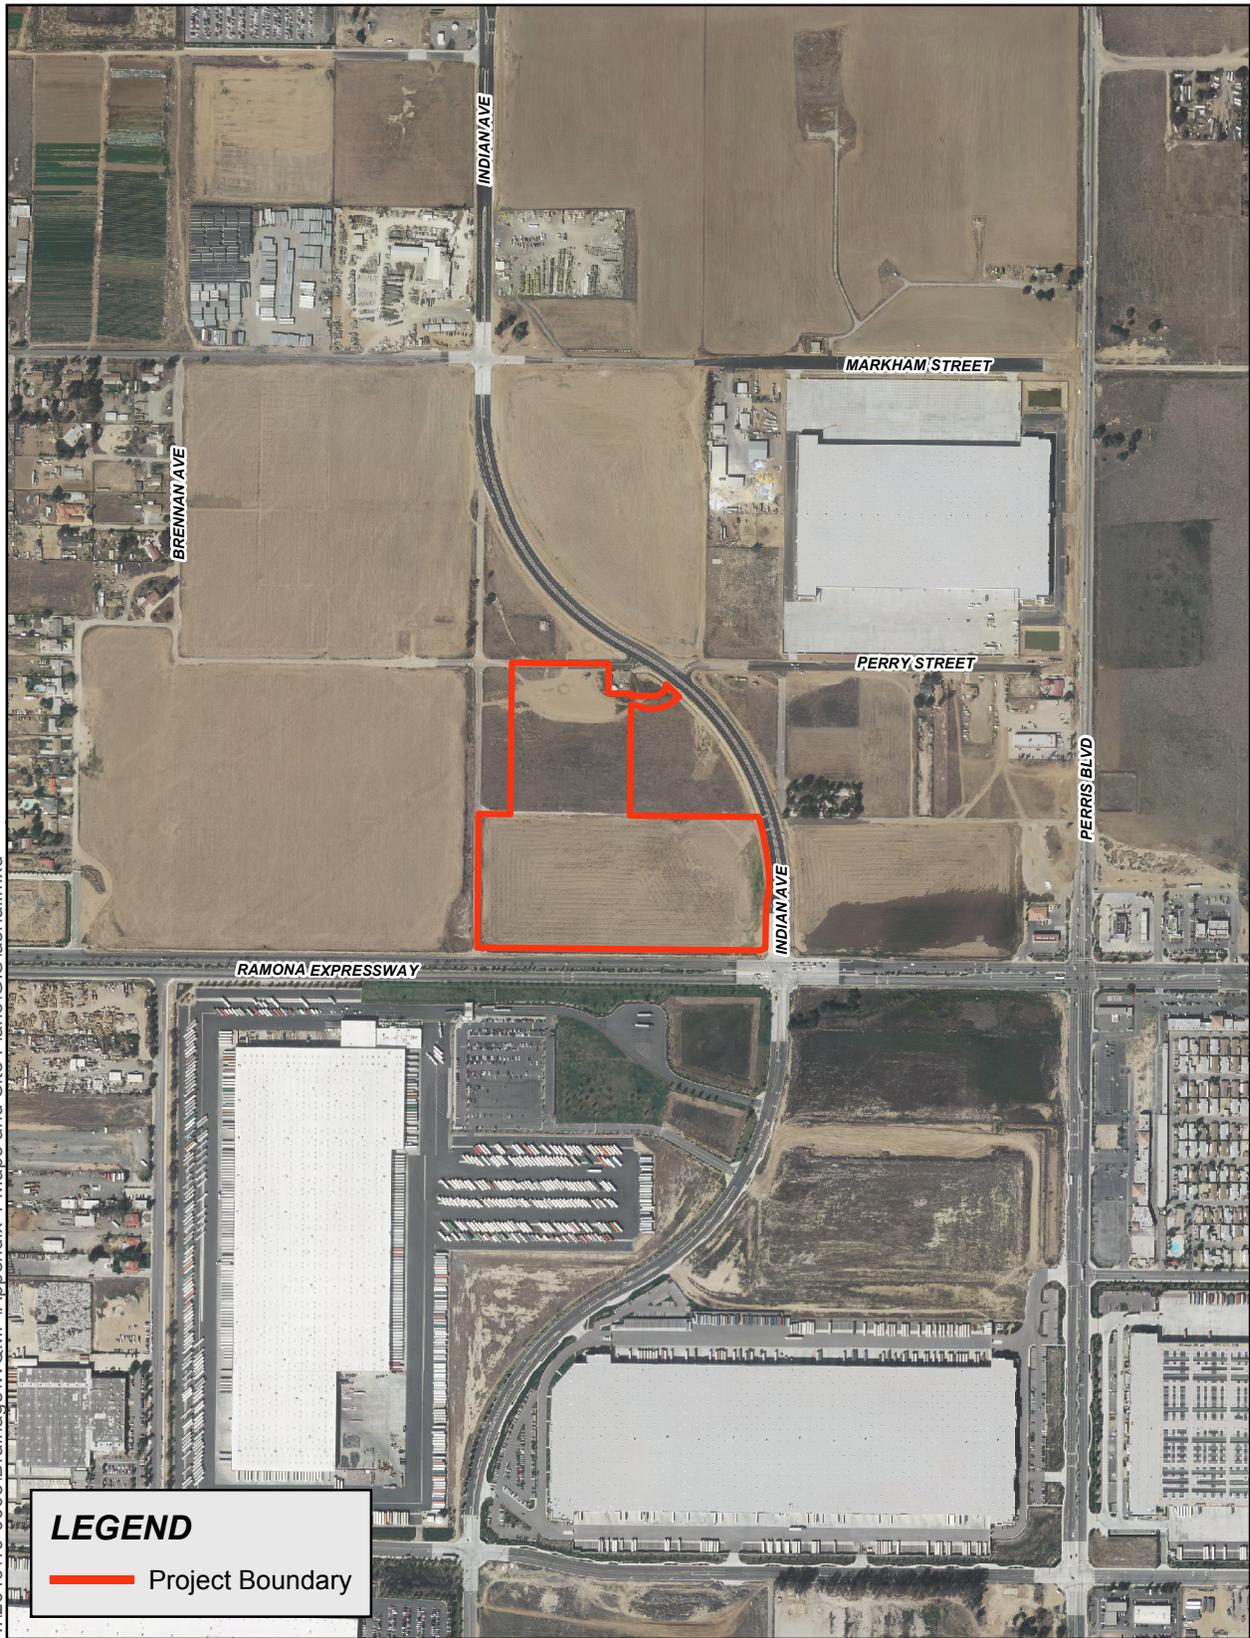


Sources: County of Riverside GIS, 2013;
Eagle Aerial, April 2012.

Figure 3. Aerial Photograph

0 400 800
Feet



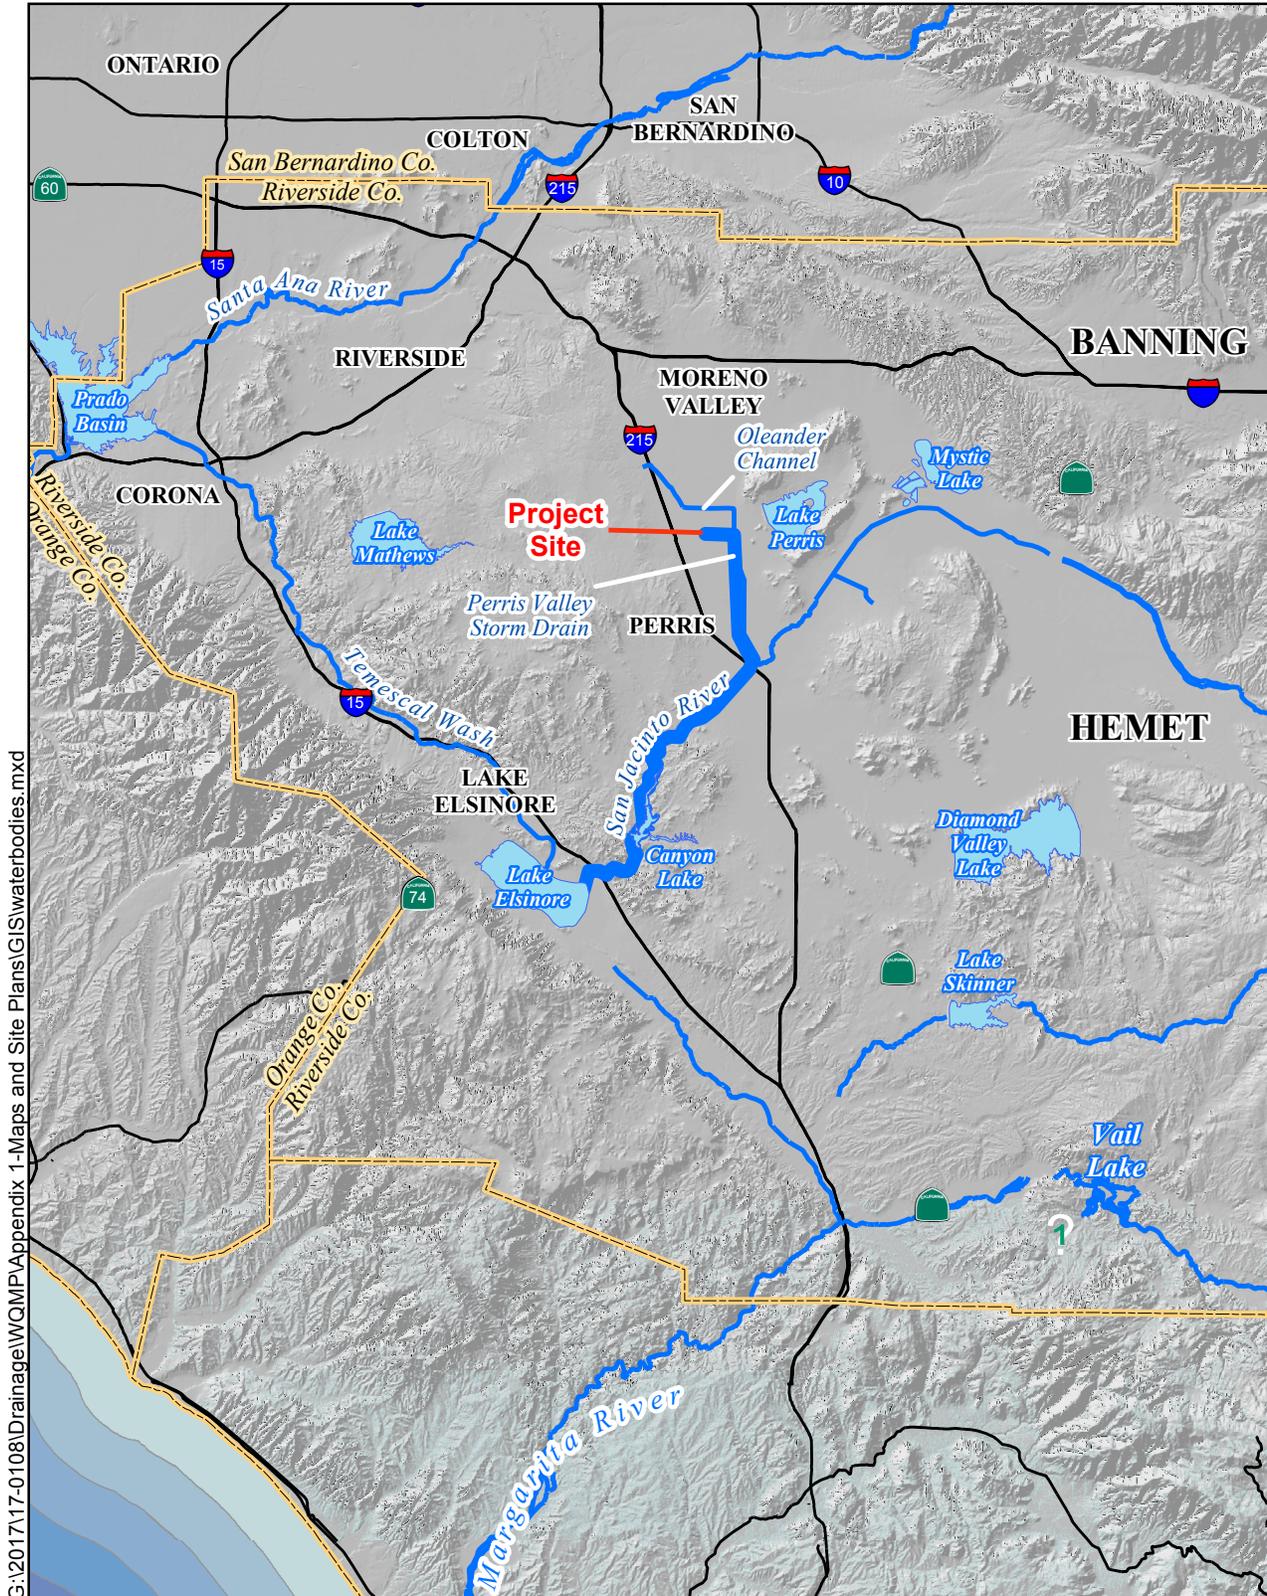

G:\2017\17-0108\Drainage\WQMP\Appendix 1-Maps and Site Plans\GIS\waterbodies.mxd

Sources: USGS 30 Meter DEM;
USGS Digital Line Graph


Figure 4. Receiving Waterbodies

0 2 4 6
Miles




Flowpath

\\Eisnore\wo4\2019\19-0008\Drainage\WCMP\Appendix 1-Maps and Site Plans\GIS\SOILS MAP (2).mxd

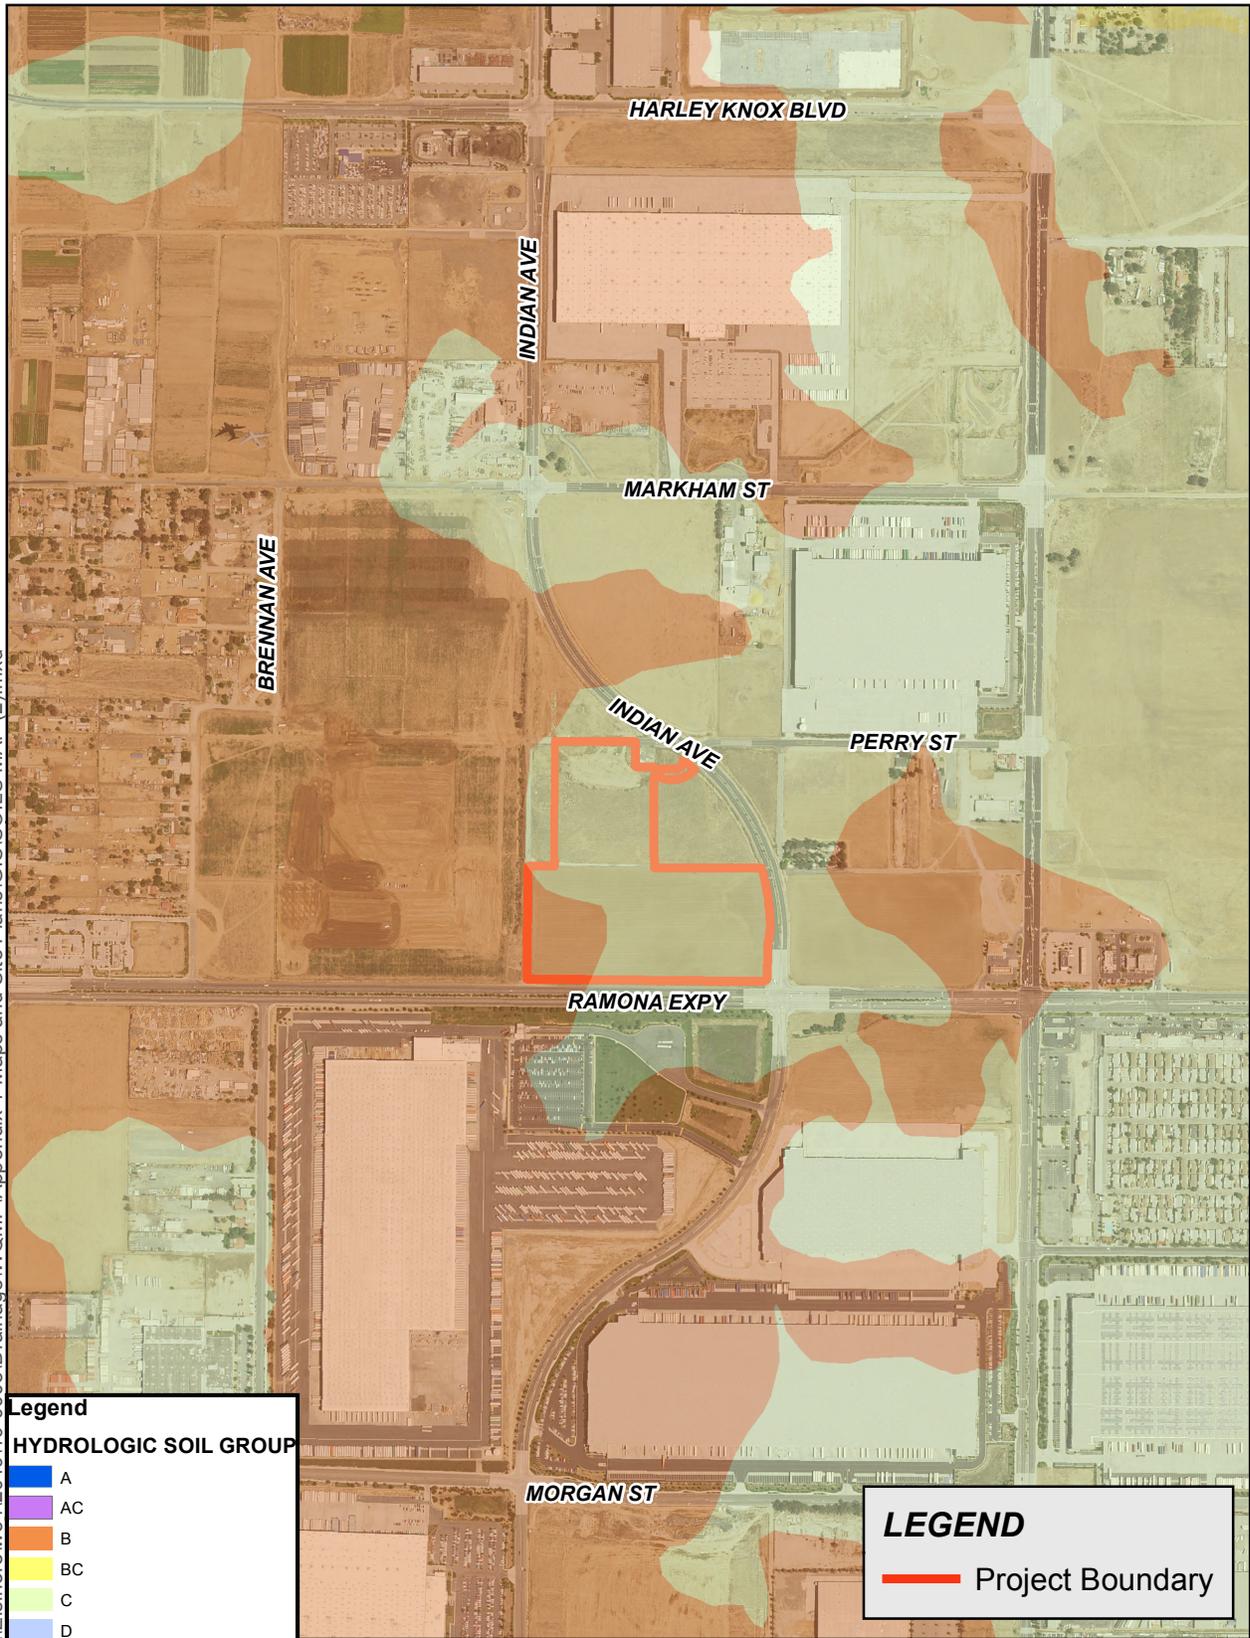

Eagle Aerial, April 2010;
Riverside County GIS, 2012
RCFC&WCD Hydology Manual Plate C-1.30

Figure 5. Soils Map

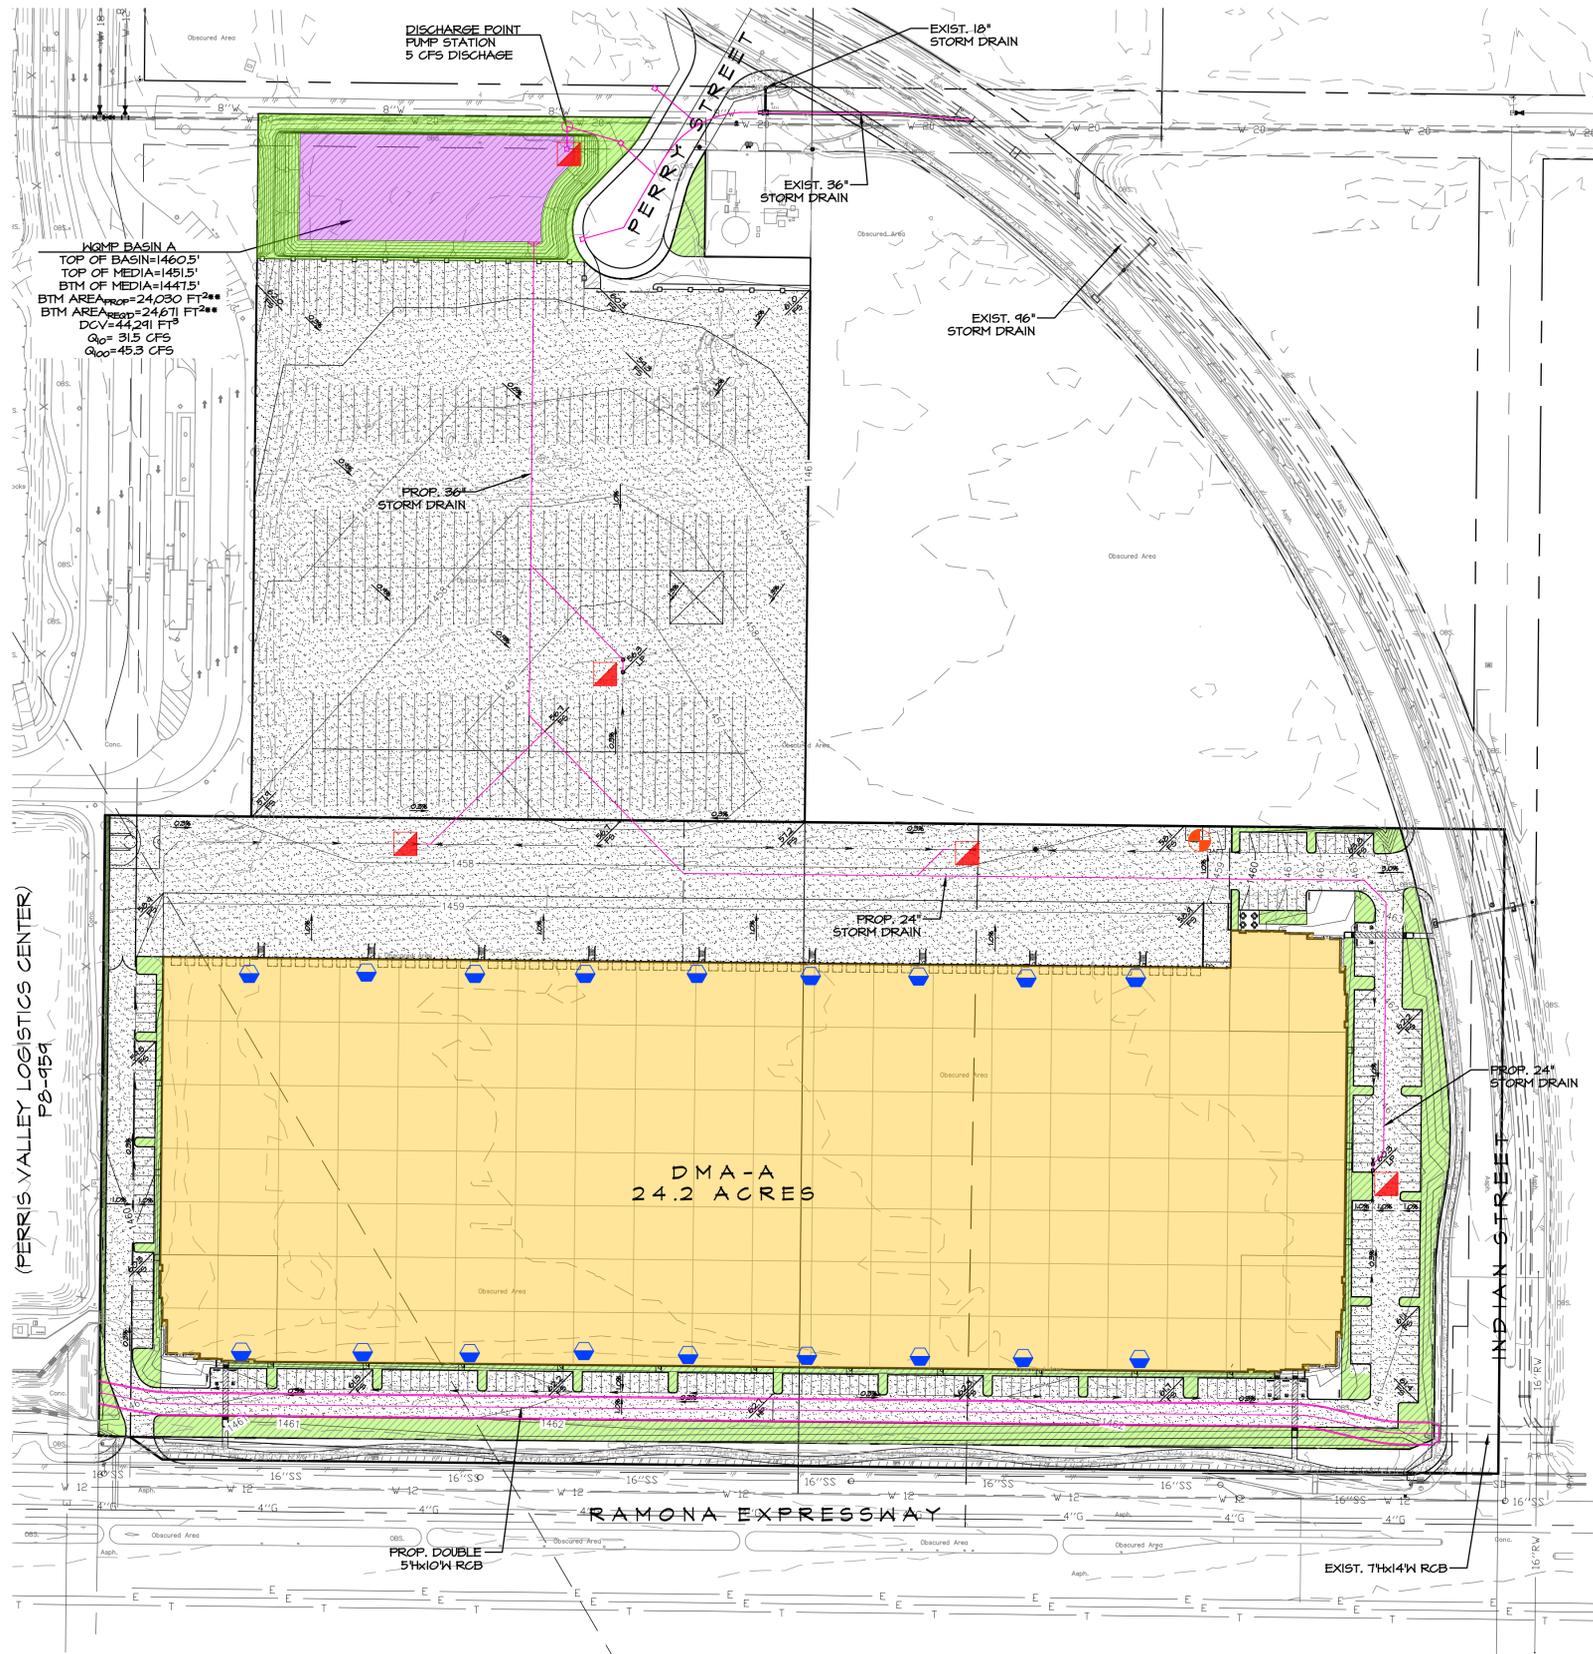


HQMP BASIN A
 TOP OF BASIN=1460.5'
 TOP OF MEDIA=1451.5'
 BTM OF MEDIA=1441.5'
 BTM AREA_{prop}=24,030 FT²
 BTM AREA_{reg}=24,671 FT²
 DCV=44,241 FT³
 Q₁₀=31.5 CFS
 Q₁₀₀=45.3 CFS

LEGEND


- DRAINAGE MANAGEMENT BOUNDARY
- LANDSCAPING
- ROOF
- CONCRETE OR ASPHALT
- SELF RETAINING
- HQ BASIN
- FLOW DIRECTION
- STORM DRAIN PIPE
- ROOF DRAIN DOWNSPOUT
- CURB OPENING/CUT
- STORM INLET
- TRASH ENCLOSURE

DRAINAGE MANAGEMENT AREAS			
LEGEND	DMA-ID	TYPE	AREA (SF)
	L-A	LANDSCAPE	78180
	R-A	ROOF	428730
	H-A	HARDSCAPE	522630
	BMP-A	LANDSCAPE	24030
	SR-A	SELF-RETAINING	0

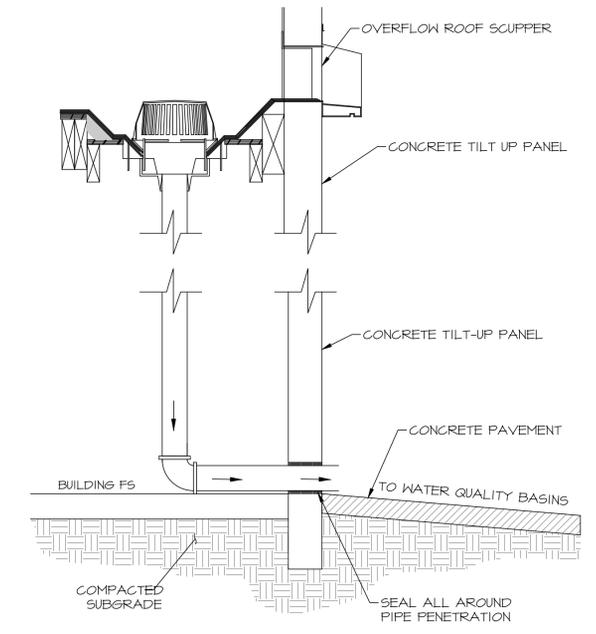



ROOF DRAIN DETAIL
N.T.S.

****NOTE:**
 EFFECTIVE DEPTH = 3 FT.(0.3) + 1 FT.(0.4) + 0.6 FT. = 1.4 FT.
 REQUIRED BOTTOM AREA = DCV / EFFECTIVE DEPTH
 REQUIRED BOTTOM AREA = 44,241 FT³ / 1.4 FT. = 23,311 FT²
 PROPOSED BOTTOM AREA = 24,030 FT²
 PROPOSED DCV = EFFECTIVE DEPTH * PROPOSED BOTTOM AREA
 PROPOSED DCV = 1.4 FT. * 24,030 FT² = 45,651 FT³





CITY OF PERRIS			
POST-CONSTRUCTION BMP SITE PLAN & DETAILS P18-00002 INDIAN & RAMONA			
SCALE: 1"=80'	DATE: 8/20/18	WEBB ASSOCIATES	W.O. 17-0108
DESIGNED: MJS	CHECKED: CRC		SHEET 1
PLN CK REF:	F.B.	ENGINEERING CONSULTANTS 3788 MCCRAY STREET RIVERSIDE CA 92506 PH. (951) 686-1070 FAX (951) 788-1256	OF 2 SHEETS
			DWG. NO.

G:\2017\17-0108\DRAINAGE\WQMP\DRAWINGS\17-0108-PWQMP.DWG 8/20/2018 7:18:13 PM

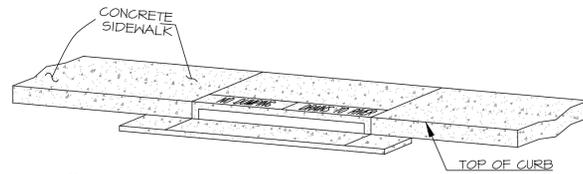


- 1 STENCILS TO HAVE 2" LETTERS AS FOLLOWS:
"NO DUMPING - DRAINS TO RIVER"
- 2 PLACE BOTH STENCILS CENTERED WITHIN THE CATCHBASIN OPENINGS AND WITHIN THE TOP OF THE CURB.
- 3 SPRAY BOTH STENCILS WITH WHITE PAINT.
- 4 REMOVE STENCILS WHEN PAINT IS DRY.


CATCH BASIN STENCILING DETAIL
NTS

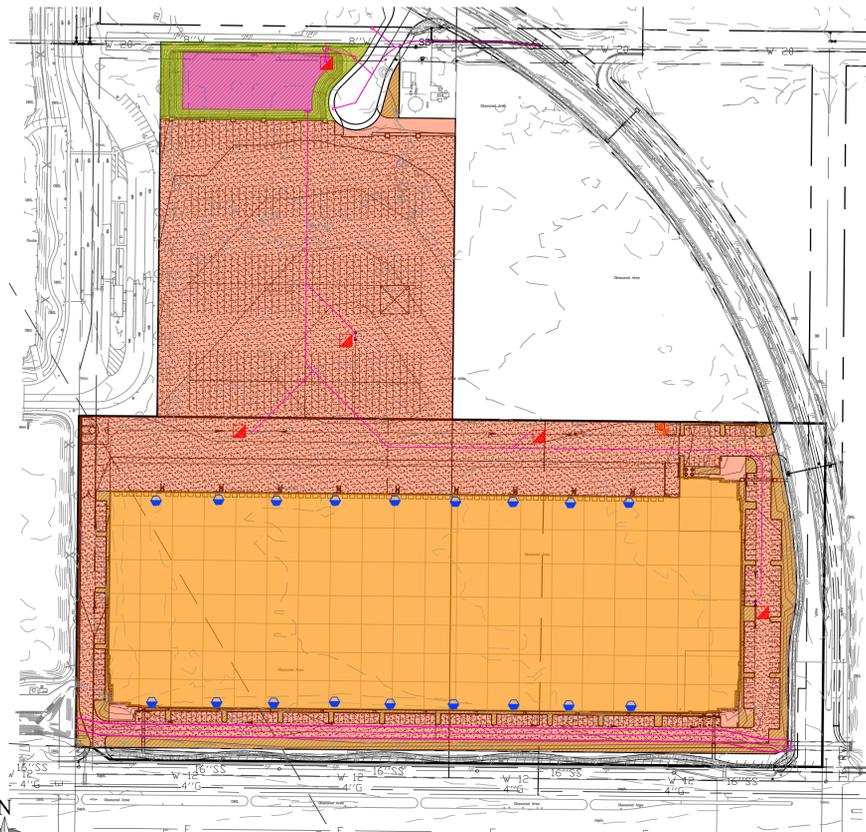


DMA-SITE PLAN
1" = 40'
20 0 40 80 120
DMA-A

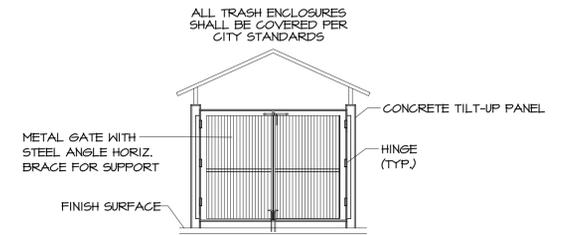


TRASH ENCLOSURE GATE ELEVATION
NTS.

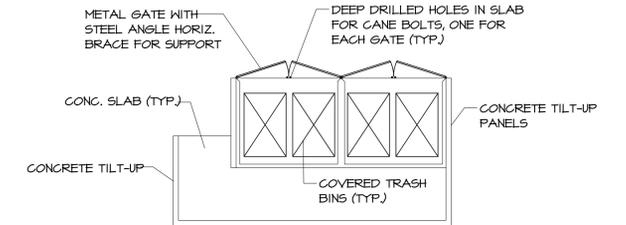


TRASH ENCLOSURE PLAN DETAIL
NTS.

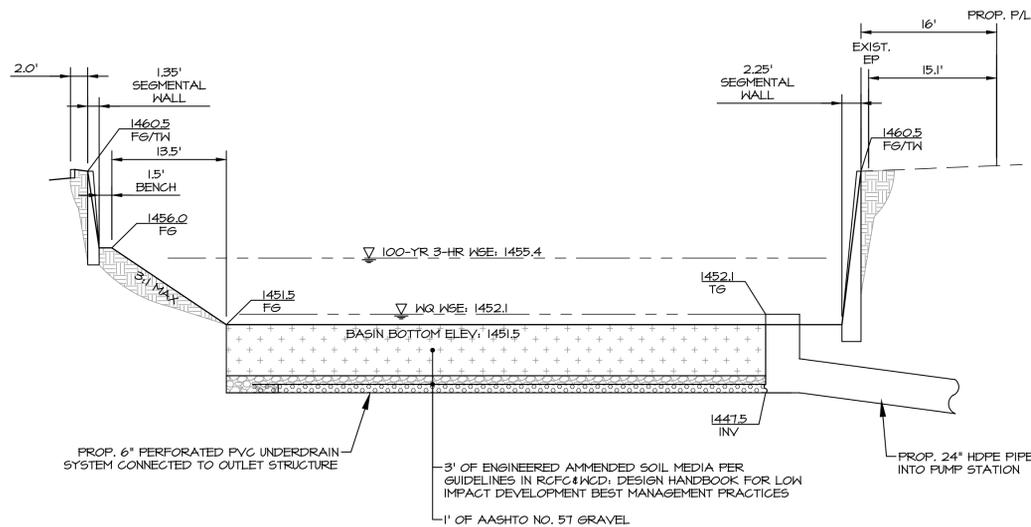

WQMP BASIN A OUTLET DETAIL
NTS

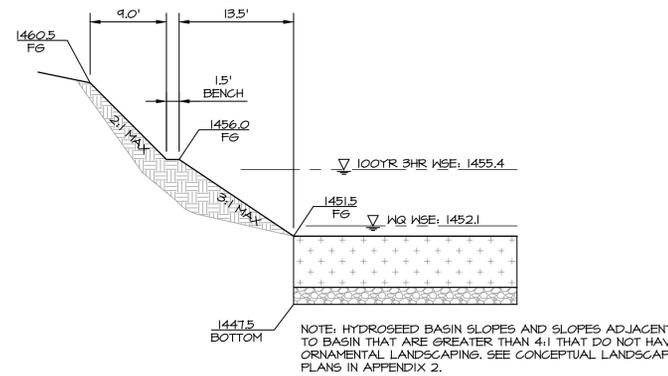

WQMP BASIN A TYPICAL SLOPE SECTION
NTS

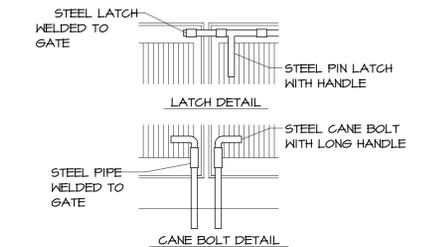

TRASH ENCLOSURE GATE LATCHES DETAIL
NTS.

CITY OF PERRIS			
POST-CONSTRUCTION DMA SITE PLAN & DETAILS P18-00002 INDIAN & RAMONA			
SCALE: 1"=80'	ALBERTA A. ENGINEERING CONSULTANTS	W.O. 17-0108	
DATE: 8/20/18	3788 MCCRAY STREET	RIVERSIDE CA 92506	SHEET 1
DESIGNED: MJS	PH. (951) 686-1070		OF 2 SHEETS
CHECKED: CRC	FAX (951) 788-1256		DWG. NO.
PLN CK REF:			
F.B.			

G:\2017\17-0108\DRAINAGE\WQMP\DWG DRAWINGS\17-0108-PWQMP.DWG 8/20/2018 6:16:51 PM

Appendix 2: Construction Plans

Grading and Drainage Plans

****To be provided during Final Engineering***




TREE SHADING LEGEND

- 40,330 SF PARKING AREA
- 20,507 SF SHADED PARKING AREA

PERCENTAGE RATIO OF TOTAL SHADED PARKING AREA PROVIDED **51%**
 MINIMUM PERCENTAGE RATIO OF TOTAL SHADED PARKING AREA REQUIRED **50%**


GENERAL NOTES:
 TREE SIZES ARE SHOWN AT 15 YEARS MATURITY PER RIVERSIDE COUNTY ORDINANCE.
 FOR PLANT LEGEND AND NOTES SEE CONCEPTUAL LANDSCAPE PLAN

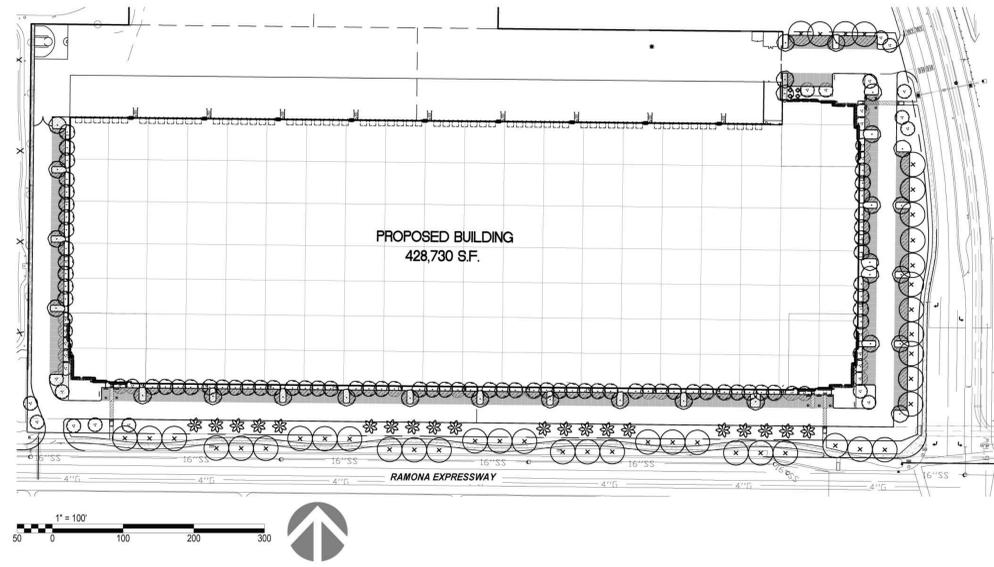

CONCEPTUAL SHADING PLAN
 SCALE: 1"=100'

Riverside County Ordinance 859 Landscape Water Use Calculations
IDI LOGISTICS - INDIAN AND RAMONA

1 Maximum Annual Water Allowance (MAWA)	
INPUT the total square footage of landscape =	131,279 S.F.
INPUT the Hist. E.To for the area =	56.4
MAWA =	306,856 cu ft / yr
2 Estimated Annual Water Use (EAWU)	
Hydrozone 1 Trees	INPUT PF = 0.5
INPUT square footage of hydrozone =	3,488
INPUT hydrozone irrigation efficiency =	0.85
EAWU =	9,592 cu ft / yr
Hydrozone 2 Shrubs and G. cover	INPUT PF = 0.2
INPUT square footage of hydrozone =	83,018
INPUT hydrozone irrigation efficiency =	0.75 mixed
EAWU =	103,493 cu ft / yr
Hydrozone 3 Basin	INPUT PF = 0.2
INPUT square footage of hydrozone =	37,748
INPUT hydrozone irrigation efficiency =	0.75 rotary spray
EAWU =	47,058 cu ft / yr
Hydrozone 4 Non-irrigated	INPUT PF = 0
INPUT square footage of hydrozone =	7,025
INPUT hydrozone irrigation efficiency =	1 n/a
EAWU =	0 cu ft / yr
SubTotal EAWU = 160,143 cu ft / yr	
Input Irrigation System Operation Factor = 0.85	
Total EAWU = 188,404	
MAWA - EAWU = 118,452 cu ft / yr	
(this number must be positive)	
PERCENTAGE OF WATER SAVED RELATIVE TO MAX ALLOWED = 39%	



VICINITY MAP
 SCALE: NTS

OWNER/ APPLICANT:
 IDI LOGISTICS
 ATTN: STEVE COLLIS
 601 S FIGUEROA ST SUITE #2300
 LOS ANGELES, CA 90071
 PHONE: (214) 697-1711

LANDSCAPE ARCHITECT:
 ALBERT A. WEBB ASSOCIATES
 ATTN: JAMIE MACIAS
 3788 MCCRAY STREET
 RIVERSIDE, CA 92506
 TEL: (951) 686-1070
 FAX: (951) 788-1256



CIVIL ENGINEER:
 ALBERT A. WEBB ASSOCIATES
 ATTN: DJ ARELLANO
 3788 MCCRAY STREET
 RIVERSIDE, CA 92506
 TEL: (951) 686-1070
 FAX: (951) 788-1256

ARCHITECT:
 HPA ARCHITECTURE
 ATTN: STEVE HONG
 18831 BARDEEN AVENUE, SUITE 100
 IRVINE, CA 92612
 TEL: (949) 862-2115

ASSESSOR'S PARCEL NUMBER
 302-060-005, 302-060-006, 302-060-038

ACREAGE:
 NET SITE AREA: 24.2 ACRES

LEGAL DESCRIPTION
 THE LAND SITUATED IN THE CITY OF PERRIS, COUNTY OF RIVERSIDE, STATE OF CALIFORNIA, AND IS DESCRIBED AS FOLLOWS: PARCELS 1, 2, AND 3 OF THE PROPERTY AS DESCRIBED IN THE SCHEDULE OF A FIRST AMERICAN TITLE INSURANCE COMPANY NO. NCS-840529-ONTI WITH EFFECTIVE DATE OF MARCH 08, 2017. SEE TITLE REPORT FOR FURTHER DESCRIPTION.

PROJECT DESCRIPTION
 DEVELOPMENT PLAN REVIEW FOR A WAREHOUSE FACILITY CONSISTING OF 1 BUILDING TOTALING 428,730 SQUARE FEET ON 24.2 NET ACRES.

CONCEPT PLANT SCHEDULE

	PARKING LOT SHADE TREES PLATANUS X ACERIFOLIA 'BLOODGOOD' / LONDON PLANE TREE STD. TRUNK	48	24' BOX
	ACCENT TREES LAGERSTROEMIA INDICA 'WATERMELON RED' / WATERMELON RED CRAPE MYRTLE PARKINSONIA X 'DESERT MUSEUM' / DESERT MUSEUM PALM O VERDE	34	24' BOX M.T. 38' BOX M.T.
	SMALL PARKING TREE GELIERA PARVIFLORA / AUSTRALIAN WILLOW	41	24' BOX
	BUILDING TREE MELALEUCA QUINQUENERVIA / CAJEPUT TREE	68	24' BOX
	PALMS WASHINGTONIA FILIFERA / CALIFORNIA FAN PALM	20	12' 8TH
	SHRUB AND GROUND COVER AGAVE AMERICANA 'MEDIO-PICTA ALBA' / STRIPED CENTURY PLANT CALLISTEMON VIMINALIS 'LITTLE JOHN' / DWARF WEEPING BOTTLEBRUSH CISTUS X PURPUREUS / ORCHID ROCKROSE HESPERALOE PARVIFLORA / RED YUCCA LANTANA CAMARA 'NEW GOLD' / NEW GOLD LANTANA MULLENBERGIA CAPILLARIS 'REGAL MIST TM' / MUHLY MYOPORUM PARVIFOLIUM 'PUTAH CREEK' / PUTAH CREEK MYOPORUM RHAPHIDOLEPSIS INDICA 'CLARA' / INDIAN HAWTHORN ROSMARINUS OFFICINALIS 'BOULE' / ROSEMARY ROSMARINUS OFFICINALIS 'PROSTRATUS' / DWARF ROSEMARY SALVIA GREGGII 'BURMANS RED' / BURMAN'S RED SALVIA SENECEO MANORALISCAE 'BLUE CHALK STICKS' / SENECEO WESTRINGIA FRUTICOSA 'SMOKEY' / SMOKEY WESTRINGIA	69,200 SF	5 GAL 5 GAL 5 GAL 1 GAL 5 GAL 5 GAL 5 GAL 5 GAL 5 GAL 1 GAL 5 GAL 5 GAL
	SCREENING SHRUBS LEUCOPHYLLUM FRUTESCENS 'GREEN CLOUD TM' / GREEN CLOUD TEXAS RANGER WESTRINGIA FRUTICOSA 'WYNABBIE GEM' / WYNABBIE GEM COAST ROSEMARY	15,796 SF	5 GAL 5 GAL
	BASIN SLOPES BACCHARIS PILULARIS 'PIGEON POINT' / COYOTE BRUSH	5,987 SF	1 GAL
	HYDROSEED SEE MIX TO INCLUDE LOW WATER USE, GRASSES TO BE NO TALLER THAN 36" HIGH	23,998 SF	100%

CONCEPTUAL SITE PLAN
 SCALE: 1"=50'

Appendix 3: Soils Information

Geotechnical Study and Other Infiltration Testing Data

**Infiltration testing done at the previous anticipated basin location but the basin location was moved after results came back. Based on the soils report, Boring No. B-12 showed Clayey and Silt properties, which can imply that low infiltration rates can be expected at the current basin location.*



**SOUTHERN
CALIFORNIA
GEOTECHNICAL**
A California Corporation

December 4, 2017

IDI Gazeley
8 Corporate Park, Suite 300-34
Irvine, California 92606

Attention: Mr. Stephen Hollis

Project No.: **17G207-2**

Subject: **Results of Infiltration Testing**
Proposed Commercial/Industrial Building
NWC Ramona Expressway at Indian Avenue
Perris, California

Reference: Geotechnical Investigation, Proposed Commercial/Industrial Building, NWC Ramona Expressway at Indian Avenue, Perris, California, prepared for IDI Gazeley by Southern California Geotechnical, Inc. (SCG), SCG Project No. 17G207-1, dated December 4, 2017.

Gentlemen:

In accordance with your request, we have conducted infiltration testing at the subject site. We are pleased to present this report summarizing the results of the infiltration testing and our design recommendations.

Scope of Services

The scope of services performed for this project was in general accordance with our Proposal No. 17P385 dated October 11, 2017. The scope of services included site reconnaissance, subsurface exploration, field testing, and engineering analysis to determine the infiltration rates of the onsite soils. The infiltration testing was performed in general accordance with ASTM Test Method D-3385-03, Standard Test Method for Infiltration Rate of Soils in Field Using Double Ring Infiltrometer.

Site and Project Description

The site is located at the northwest corner of Ramona Expressway and Indian Avenue in Perris, California. The site is bounded to the north by West Perry Street, to the west by a commercial/industrial building, to the south by Ramona Expressway, and to the east by Indian Avenue. The general location of the site is illustrated on the Site Location Map included as Plate 1 of this report.

The subject site consists of an irregular-shaped parcel, approximately 25± acres in size. The site is currently vacant and undeveloped. Portion of the site appear to have been previously used for agricultural purposes. The ground surface consists of exposed soil with sparse to very dense native grass and weed growth. Crop stubble is present in isolated areas of the property. Medium to large boulders are present in the northern portion of the site. A water pump station is present in the north-central area of the site, which is not a part of the site area.

Detailed topographic information was not available at the time of this report. However, based on visual observations, the site topography slopes to the southeast at an estimated gradient of less than 1 percent. Small ascending slopes are located along portions of the western property line, adjacent to the existing commercial/industrial building on the westerly adjacent property. There was estimated to be less than 5± feet of elevation differential across the site.

Proposed Development

A site plan for the proposed development, prepared by HPA Architecture, was provided to our office by the client. The plan indicates that the site will be developed with one (1) new warehouse building. The building will be located in the south-central area of the site and will be 428,730± ft² in size. The building will be constructed with loading docks along north side of the building. A large truck parking area will be located in the northern region of the property. It is expected that the building will be surrounded by asphaltic concrete pavements for parking and drive lanes and Portland cement concrete pavements in the loading dock areas. Landscape planters and concrete flatwork are expected to be included throughout the site.

We understand that the proposed development will include on-site infiltration to dispose of storm water. Based on the site plan provided by Albert A. Webb Associates, the project civil engineer, the proposed infiltration system will consist an infiltration/detention basin located in the northern area of the site. The bottom of the proposed infiltration basin will be 9 to 10± feet below the existing site grades. It should be noted that the previous site plan (Scheme 4), which was provided to our office for the purposes of this study, depicted the infiltration basin along the northernmost portion of the eastern property line. However, based on a site plan received after completion of the field testing for this study, the location of the infiltration/detention basin has been relocated to the northern area of the site.

Concurrent Study

Southern California Geotechnical, Inc. (SCG) recently conducted a geotechnical investigation at the subject site, referenced above. As a part of this study, twelve (12) borings were advanced to depths of 5 to 25± feet below existing site grades.

Native alluvial soils were encountered at the ground surface at all of the boring locations, extending to at least the maximum depth explored of 25± feet below existing site grades. The near-surface alluvium generally consists of loose to medium dense clayey fine to medium sands, extending to depths of 3 to 6½± feet. At greater depths, the alluvium generally consists of interbedded layers of medium dense silty fine to medium sands, fine to medium sandy silts, and clayey fine sands as well as stiff to hard clayey silts and silty clays.

Groundwater

Free water was not encountered during the drilling of any of the borings. Based on the lack of any water within the borings, and the moisture contents of the recovered soil samples, the static groundwater is considered to have existed at a depth in excess of 25± feet at the time of the subsurface exploration. As part of our research, we reviewed available groundwater data in order to determine the historic high groundwater level for the site. The primary reference used to determine the groundwater depths in this area is the California Department of Water Resources website,

<http://www.water.ca.gov/waterdatalibrary/>. This database indicates that a monitoring well is located within the subject site. Water level readings within this monitoring well indicate high groundwater levels of 81± feet (April 2017) below the ground surface.

Subsurface Exploration

Scope of Exploration

The subsurface exploration for the infiltration testing consisted of three (3) backhoe excavated trenches, extending to depths of 9 to 9½± feet below existing site grades. The trenches were logged during excavation by a member of our staff. The approximate locations of the infiltration trenches (identified as I-1 through I-3) are indicated on the Infiltration Test Location Plan, enclosed as Plate 2 of this report.

Geotechnical Conditions

Native alluvium was encountered at the ground surface at all of the infiltration trench locations, extending to at least 9½± feet below existing site grades. The native alluvial soils generally consist of stiff to very stiff silty clays and clayey silts, and medium dense to very dense silty fine to medium sands and clayey fine to medium sands. Free water was not encountered during the excavation of any of the trenches. The Trench Logs, which illustrate the conditions encountered at the trench locations, are included with this report.

Infiltration Testing

We understand that the results of the testing will be used to prepare a preliminary design for the storm water infiltration system that will be used at the subject site. The infiltration testing was performed in general accordance with ASTM Test Method D-3385-03, Standard Test Method for Infiltration Rate of Soils in Field Using Double Ring Infiltrometer.

Two stainless steel infiltration rings were used for the infiltration testing. The outer infiltration ring is 2 feet in diameter and 20 inches in height. The inner infiltration ring is 1 foot in diameter and 20 inches in height. At the test locations, the outer ring was driven 3± inches into the soil at the base of each trench. The inner ring was centered inside the outer ring and subsequently driven 3± inches into the soil at the base of the trenches. The rings were driven into the soil using a ten-pound sledge hammer. The soil surrounding the wall of the infiltration rings was only slightly disturbed during the driving process.

Infiltration Testing Procedure

Infiltration testing was performed at all three (3) of the trench locations. The infiltration testing consisted of filling the inner ring and the annular space (the space between the inner and outer rings) with water, approximately 3 to 4 inches above the soil. To prevent the flow of water from one ring to the other, the water level in both the inner ring and the annular space between the rings was maintained using constant-head float valves. The volume of water that was added to maintain a constant head in the inner ring and the annular space during each time interval was determined and recorded. A cap was placed over the rings to minimize the evaporation of water during the test.

The schedule for readings was determined based on the observed soil type at the base of each backhoe excavated trench. Based on the existing soils at each infiltration test location, the volumetric measurements were made at increments of 20 and 30 minutes. The water volume measurements are presented on the spreadsheets enclosed with this report. The infiltration rates for each of the timed intervals are also tabulated on these spreadsheets.

The infiltration rates for the infiltration tests are calculated in centimeters per hour and then converted to inches per hour. The rates are summarized below:

<u>Infiltration Test No.</u>	<u>Soil Description</u>	<u>Infiltration Rate (inches/hour)</u>
I-1	Silty fine to medium Sand, trace Clay	0.7
I-2	Clayey fine to medium Sand, little Silt	0.3
I-3	Silty fine to medium Sand, little coarse Sand, trace Clay	0.4

Laboratory Testing

Grain Size Analysis

The grain size distribution of selected soils from the base of each infiltration test trench has been determined using a range of wire mesh screens. These tests were performed in general accordance with ASTM D-422 and/or ASTM D-1140. The weight of the portion of the sample retained on each screen is recorded and the percentage finer or coarser of the total weight is calculated. The results of these tests are presented at the end of this report.

Design Recommendations

Three (3) infiltration tests were performed at the subject site. As noted above, the calculated infiltration rates at the infiltration test locations range from 0.3 to 0.7 inches per hour. The primary factors affecting the infiltration rates are the varying relative densities, and the clay and silt content of the encountered soils, which vary at different depths and locations at the subject site.

Based on the infiltration test results, we recommend a design infiltration rate of 0.3 inches per hour be used for the proposed infiltration basin, if it is located in the test location area. However, if the infiltration/detention basin is located in the northern area of the site, we recommend additional infiltration testing be performed to confirm the infiltration rates in the area of the proposed basin.

The design of the proposed storm water infiltration system should be performed by the project civil engineer, in accordance with the City of Perris and/or County of Riverside guidelines. However, it is recommended that the system be constructed so as to facilitate removal of silt and clay, or other deleterious materials from any water that may enter the system. The presence of such materials would decrease the effective infiltration rate. **It is recommended that the project civil engineer apply an appropriate factor of safety. The infiltration rate recommended above is based on the assumption that only clean water will be introduced to the**

subsurface profile. Any fines, debris, or organic materials could significantly impact the infiltration rate. It should be noted that the recommended infiltration rate is based on infiltration testing at three (3) discrete locations and the overall infiltration rate of the storm water infiltration system could vary considerably.

Infiltration versus Permeability

Infiltration rates are based on unsaturated flow. As water is introduced into soils by infiltration, the soils become saturated and the wetting front advances from the unsaturated zone to the saturated zone. Once the soils become saturated, infiltration rates become zero, and water can only move through soils by hydraulic conductivity at a rate determined by pressure head and soil permeability. The infiltration rates presented herein were determined in accordance with the ASTM Test Method D-3385-03 standard, and are considered valid for the time and place of the actual test. Changes in soil moisture content will affect these infiltration rates. Infiltration rates should be expected to decrease until the soils become saturated. Soil permeability values will then govern groundwater movement. Permeability values may be on the order of 10 to 20 times less than infiltration rates. The system designer should incorporate adequate factors of safety and allow for overflow design into appropriate traditional storm drain systems, which would transport storm water off-site.

Location of Infiltration Systems

The use of on-site storm water infiltration systems carries a risk of creating adverse geotechnical conditions. Increasing the moisture content of the soil can cause the soil to lose internal shear strength and increase its compressibility, resulting in a change in the designed engineering properties. Overlying structures and pavements in the infiltration areas could potentially be damaged due to saturation of subgrade soils. **The proposed infiltration system for the site should be located at least 25 feet away from any structures, including retaining walls.** Even with this provision of locating the infiltration systems at least 25 feet from any building, it is possible that infiltrating water into the subsurface soils could have an adverse effect on any proposed or existing structure. It should also be noted that utility trenches which happen to collect storm water can also serve as conduits to transmit storm water toward the structure, depending on the slope of the utility trench. Therefore, consideration should also be given to the proposed locations of underground utilities which may pass near the proposed infiltration system.

General Comments

This report has been prepared as an instrument of service for use by the client in order to aid in the evaluation of this property and to assist the architects and engineers in the design and preparation of the project plans and specifications. This report may be provided to the contractor(s) and other design consultants to disclose information relative to the project. However, this report is not intended to be utilized as a specification in and of itself, without appropriate interpretation by the project architect, structural engineer, and/or civil engineer. The design of the infiltration system is the responsibility of the civil engineer. The role of the geotechnical engineer is limited to determination of infiltration rate only. By using the design infiltration rates contained herein, the civil engineer agrees to indemnify, defend, and hold harmless the geotechnical engineer for all aspects of the design and performance of the infiltration system. The reproduction and distribution of this report must be authorized by the client and Southern California Geotechnical, Inc.

Furthermore, any reliance on this report by an unauthorized third party is at such party's sole risk, and we accept no responsibility for damage or loss which may occur.

The analysis of this site was based on a subsurface profile interpolated from limited discrete soil samples. While the materials encountered in the project area are considered to be representative of the total area, some variations should be expected between trench locations and testing depths. If the conditions encountered during construction vary significantly from those detailed herein, we should be contacted immediately to determine if the conditions alter the recommendations contained herein.

This report has been based on assumed or provided characteristics of the proposed development. It is recommended that the owner, client, architect, structural engineer, and civil engineer carefully review these assumptions to ensure that they are consistent with the characteristics of the proposed development. If discrepancies exist, they should be brought to our attention to verify that they do not affect the conclusions and recommendations contained herein. We also recommend that the project plans and specifications be submitted to our office for review to verify that our recommendations have been correctly interpreted. The analysis, conclusions, and recommendations contained within this report have been promulgated in accordance with generally accepted professional geotechnical engineering practice. No other warranty is implied or expressed.

Closure

We sincerely appreciate the opportunity to be of service on this project. We look forward to providing additional consulting services during the course of the project. If we may be of further assistance in any manner, please contact our office.

Respectfully Submitted,

SOUTHERN CALIFORNIA GEOTECHNICAL, INC.



Scott McCann
Staff Scientist



Gregory K. Mitchell, GE 2364
Principal Engineer



Distribution: (1) Addressee

Enclosures: Plate 1 - Site Location Map
Plate 2 - Infiltration Test Location Plan
Trench Logs (3 pages)
Infiltration Test Results Spreadsheets (3 pages)
Grain Size Distribution Graphs (3 pages)

INFILTRATION CALCULATIONS

Project Name	Proposed Commercial/Industrial Building
Project Location	Perris, CA
Project Number	17G207-2
Engineer	Scott McCann

Infiltration Test No I-1

Constants			
	Diameter (ft)	Area (ft ²)	Area (cm ²)
Inner	1	0.79	730
Anlr. Spac	2	2.36	2189

*Note: The infiltration rate was calculated based on current time interval

Test Interval		Time (hr)	Interval Elapsed (min)	Flow Readings				Infiltration Rates			
				Inner Ring (ml)	Ring Flow (cm ³)	Annular Ring (ml)	Space Flow (cm ³)	Inner Ring* (cm/hr)	Annular Space* (cm/hr)	Inner Ring* (in/hr)	Annular Space* (in/hr)
1	Initial	8:45 AM	20	200	925	800	3400	3.80	4.66	1.50	1.83
	Final	9:05 AM	20	1125		4200					
2	Initial	9:06 AM	20	200	550	650	2800	2.26	3.84	0.89	1.51
	Final	9:26 AM	41	750		3450					
3	Initial	9:27 AM	20	750	425	3500	2400	1.75	3.29	0.69	1.30
	Final	9:47 AM	62	1175		5900					
4	Initial	9:48 AM	20	125	400	3900	2400	1.64	3.29	0.65	1.30
	Final	10:08 AM	83	525		6300					
5	Initial	10:09 AM	20	525	400	6350	2400	1.64	3.29	0.65	1.30
	Final	10:29 AM	104	925		8750					
6	Initial	10:30 AM	20	100	400	200	2400	1.64	3.29	0.65	1.30
	Final	10:50 AM	125	500		2600					

INFILTRATION CALCULATIONS

Project Name	Proposed Commercial/Industrial Building
Project Location	Perris, CA
Project Number	17G207-2
Engineer	Scott McCann

Infiltration Test No I-2

Constants			
	Diameter (ft)	Area (ft ²)	Area (cm ²)
Inner	1	0.79	730
Anlr. Spac	2	2.36	2189

*Note: The infiltration rate was calculated based on current time interval

Test Interval		Time (hr)	Interval Elapsed (min)	Flow Readings				Infiltration Rates				
				Inner Ring (ml)	Ring Flow (cm ³)	Annular Ring (ml)	Space Flow (cm ³)	Inner Ring* (cm/hr)	Annular Space* (cm/hr)	Inner Ring* (in/hr)	Annular Space* (in/hr)	
1	Initial	11:00 AM	30	0		600		2750	1.58	2.51	0.62	0.99
	Final	11:30 AM	30	575	575	3350						
2	Initial	11:30 AM	30	50		0		2300	1.23	2.10	0.49	0.83
	Final	12:00 PM	60	500	450	2300						
3	Initial	12:00 PM	30	250		100		2100	0.89	1.92	0.35	0.76
	Final	12:30 PM	90	575	325	2200						
4	Initial	12:30 PM	30	100		100		1950	0.82	1.78	0.32	0.70
	Final	1:00 PM	120	400	300	2050						
5	Initial	1:00 PM	30	100		400		1900	0.82	1.74	0.32	0.68
	Final	1:30 PM	150	400	300	2300						

INFILTRATION CALCULATIONS

Project Name	Proposed Commercial/Industrial Building
Project Location	Perris, CA
Project Number	17G207-2
Engineer	Scott McCann


Infiltration Test No I-3

Constants			
	Diameter (ft)	Area (ft ²)	Area (cm ²)
Inner	1	0.79	730
Anlr. Spac	2	2.36	2189

*Note: The infiltration rate was calculated based on current time interval


Test Interval		Time (hr)	Interval Elapsed (min)	Flow Readings				Infiltration Rates			
				Inner Ring (ml)	Ring Flow (cm ³)	Annular Ring (ml)	Space Flow (cm ³)	Inner Ring* (cm/hr)	Annular Space* (cm/hr)	Inner Ring* (in/hr)	Annular Space* (in/hr)
1	Initial	1:45 PM	30	100	625	600	2800	1.71	2.56	0.67	1.01
	Final	2:15 PM	30	725		3400					
2	Initial	2:15 PM	30	150	550	1200	2550	1.51	2.33	0.59	0.92
	Final	2:45 PM	60	700		3750					
3	Initial	2:45 PM	30	0	450	500	2500	1.23	2.28	0.49	0.90
	Final	3:15 PM	90	450		3000					
4	Initial	3:15 PM	30	50	375	100	2400	1.03	2.19	0.40	0.86
	Final	3:45 PM	120	425		2500					

Grain Size Distribution

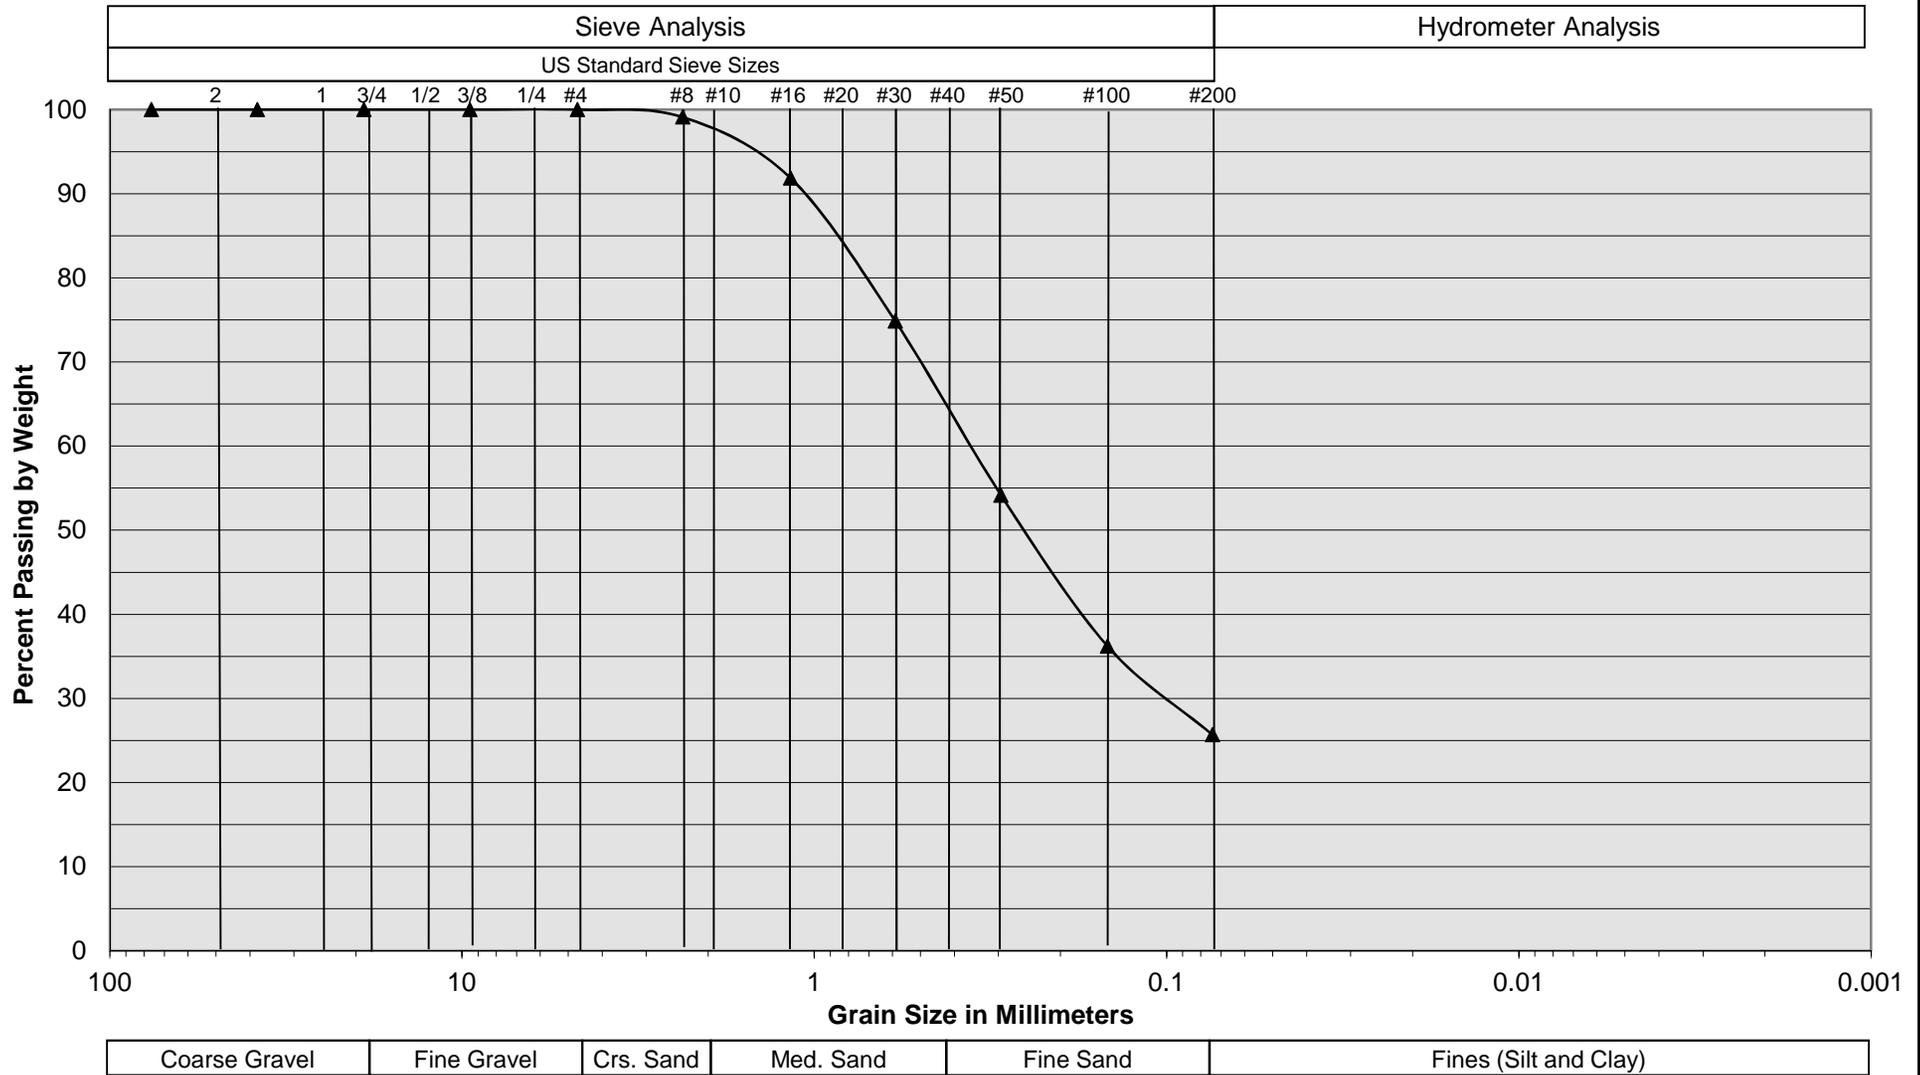


Sample Description	I-1 @ 9.5 feet
Soil Classification	Brown Silty fine to medium Sand, trace Clay

Proposed Commercial/Industrial Building
 Perris, California
 Project No. 17G207-2
PLATE C-1

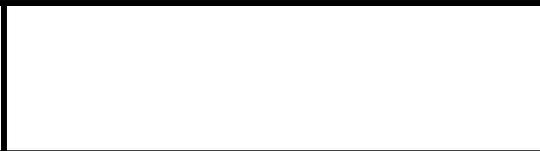


SOUTHERN CALIFORNIA GEOTECHNICAL
A California Corporation

Grain Size Distribution

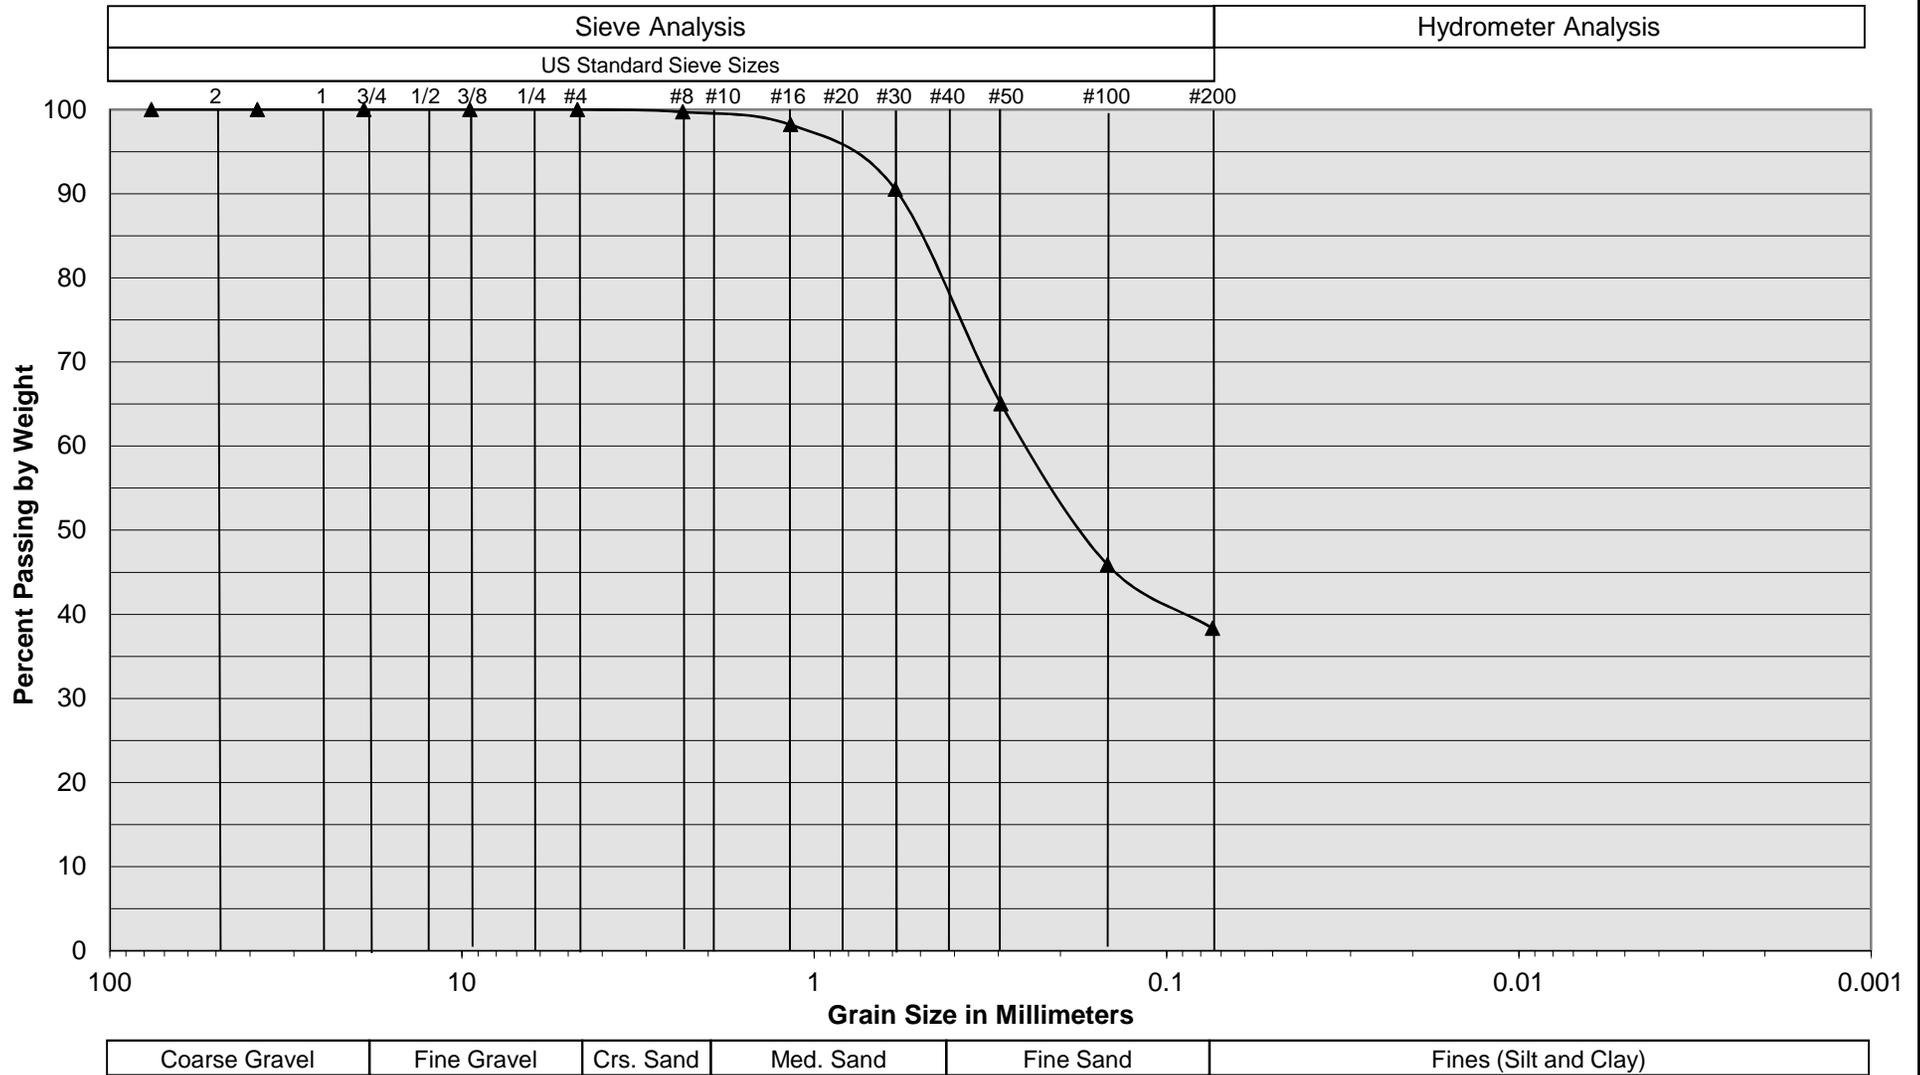

Grain Size Distribution

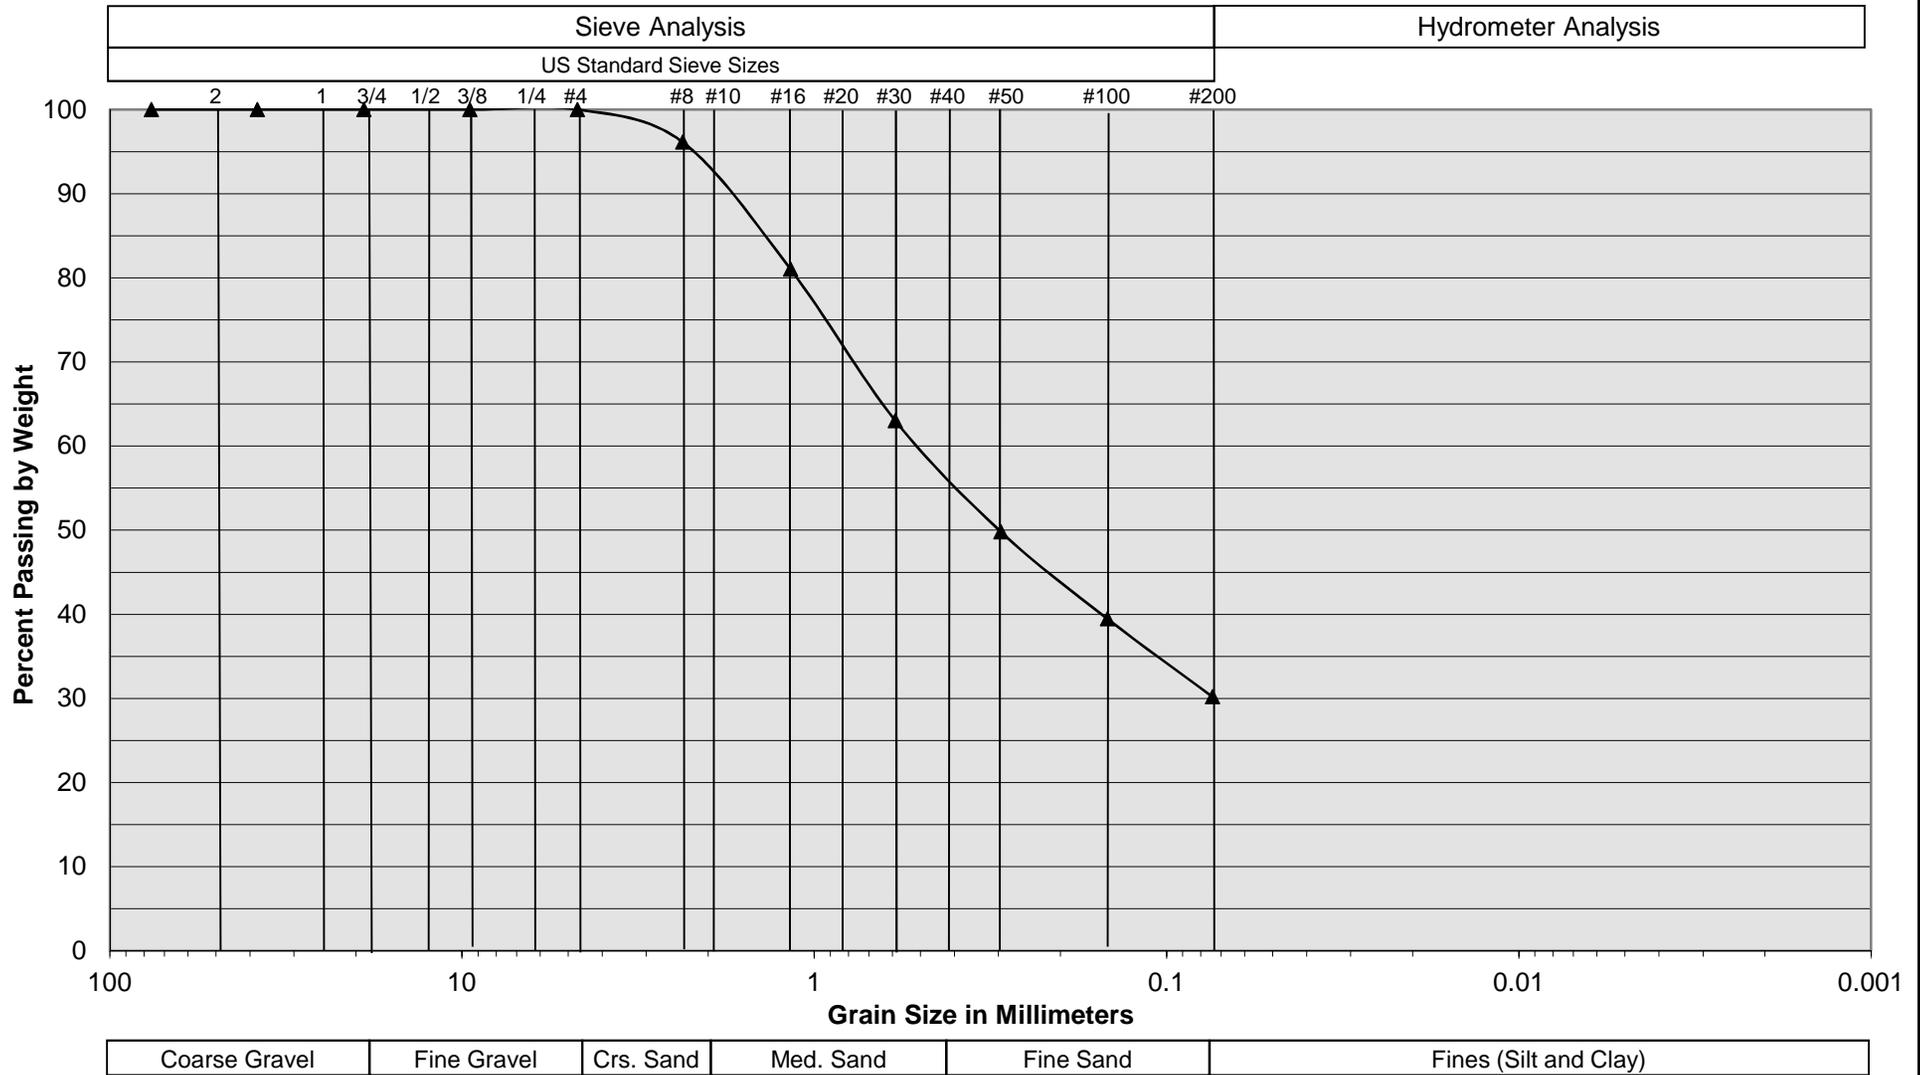

Sample Description	I-3 @ 9.5 feet
Soil Classification	Light Brown Silty fine to medium Sand, little coarse Sand, trace Clay

Proposed Commercial/Industrial Building Perris, California Project No. 17G207-2 PLATE C-3		 SOUTHERN CALIFORNIA GEOTECHNICAL <small>A California Corporation</small>
---	--	--

**GEOTECHNICAL INVESTIGATION
PROPOSED COMMERCIAL/INDUSTRIAL
BUILDING**

NWC Ramona Expressway at Indian Avenue
Perris, California
for
IDI Gazeley



**SOUTHERN
CALIFORNIA
GEOTECHNICAL**
A California Corporation

December 4, 2017

IDI Gazeley
8 Corporate Park, Suite 300-34
Irvine, California 92606



**SOUTHERN
CALIFORNIA
GEOTECHNICAL**
A California Corporation

Attention: Mr. Stephen Hollis

Project No.: **17G207-1**

Subject: **Geotechnical Investigation**
Proposed Commercial/Industrial Building
NWC Ramona Expressway at Indian Avenue
Perris, California

Dear Mr. Hollis:

In accordance with your request, we have conducted a geotechnical investigation at the subject site. We are pleased to present this report summarizing the conclusions and recommendations developed from our investigation.

We sincerely appreciate the opportunity to be of service on this project. We look forward to providing additional consulting services during the course of the project. If we may be of further assistance in any manner, please contact our office.

Respectfully Submitted,

SOUTHERN CALIFORNIA GEOTECHNICAL, INC.

A handwritten signature in blue ink, appearing to read "Gregory K. Mitchell".

Gregory K. Mitchell, GE 2364
Principal Engineer



A handwritten signature in blue ink, appearing to read "Robert G. Trazo".

Robert G. Trazo, GE 2655
Principal Engineer



Distribution: (1) Addressee

TABLE OF CONTENTS

1.0 EXECUTIVE SUMMARY	2
2.0 SCOPE OF SERVICES	4
3.0 SITE AND PROJECT DESCRIPTION	5
3.1 Site Conditions	5
3.2 Proposed Development	5
4.0 SUBSURFACE EXPLORATION	6
4.1 Scope of Exploration/Sampling Methods	6
4.2 Geotechnical Conditions	6
5.0 LABORATORY TESTING	8
6.0 CONCLUSIONS AND RECOMMENDATIONS	10
6.1 Seismic Design Considerations	10
6.2 Geotechnical Design Considerations	12
6.3 Site Grading Recommendations	13
6.4 Construction Considerations	16
6.5 Foundation Design and Construction	17
6.6 Floor Slab Design and Construction	18
6.7 Exterior Flatwork Design and Construction	19
6.8 Retaining Wall Design and Construction	20
6.9 Pavement Design Parameters	22
7.0 GENERAL COMMENTS	25
APPENDICES	
A Plate 1: Site Location Map Plate 2: Boring Location Plan	
B Boring Logs	
C Laboratory Test Results	
D Grading Guide Specifications	
E Seismic Design Parameters	

1.0 EXECUTIVE SUMMARY

Presented below is a brief summary of the conclusions and recommendations of this investigation. Since this summary is not all inclusive, it should be read in complete context with the entire report.

Geotechnical Design Considerations

- The subject site is located within an area of low liquefaction susceptibility.
- The subsurface conditions encountered at this site are not considered to be conducive to liquefaction. These conditions consist of moderate to high strength alluvium below depths of 10± feet, and the absence of a historic groundwater table within 50 feet of the ground surface.
- Based on these considerations, liquefaction is not considered to be a design concern for this project.

Site Preparation

- Initial site preparation should include stripping of the existing crop stubble as well as the existing native grass, weed, and brush growth.
- The near-surface soils generally consist of low expansive native alluvium which possesses a moderate potential for consolidation/collapse. Therefore, remedial grading is recommended to remove the upper portion of the near-surface native alluvium and replace these soils as compacted structural fill. The recommended remedial grading will reduce potential differential settlements by replacing collapsible/compressible soils as compacted structural fill.
- The proposed building area should be overexcavated to a depth of at least 4 feet below existing grade and to a depth of 4 feet below proposed building pad subgrade elevation. Within the foundation influence zones, the overexcavation should extend to a depth of at least 3 feet below proposed foundation bearing grade. The overexcavation should extend horizontally at least 5 feet beyond the building and foundation perimeters.
- After the overexcavation has been completed, the resulting subgrade soils should be evaluated by the geotechnical engineer to identify any additional soils that should be removed. Resulting subgrade should then be scarified to a depth of 12 inches and moisture conditioned to 2 to 4 percent above optimum. The previously excavated soils may then be replaced as compacted structural fill. All structural fill soils should be compacted to at least 90 percent of the ASTM D-1557 maximum dry density.
- The new pavement and flatwork subgrade soils are recommended to be scarified to a depth of 12± inches, thoroughly moisture conditioned and recompacted to at least 90 percent of the ASTM D-1557 maximum dry density.

Building Foundations

- Conventional shallow foundations, supported in newly placed compacted fill.
- 2,500 lbs/ft² maximum allowable soil bearing pressure.
- Reinforcement consisting of at least four (4) No. 5 rebars (2 top and 2 bottom) in strip footings. Additional reinforcement may be necessary for structural considerations.

Building Floor Slab

- Conventional Slab-on-Grade, 6 inches thick.
- Modulus of Subgrade Reaction: $k = 100$ psi/in.

- Minimum slab reinforcement: Not required for geotechnical considerations. The actual floor slab reinforcement should be determined by the structural engineer, based upon the imposed loading.

Pavements

ASPHALT PAVEMENTS (R = 30)					
Materials	Thickness (inches)				
	Auto Parking and Auto Drive Lanes (TI = 4.0 to 5.0)	Truck Traffic			
		TI = 6.0	TI = 7.0	TI = 8.0	TI = 9.0
Asphalt Concrete	3	4	4	5	6
Aggregate Base	6	7	10	11	12
Compacted Subgrade	12	12	12	12	12

PORTLAND CEMENT CONCRETE PAVEMENTS (R = 30)				
Materials	Thickness (inches)			
	Autos and Light Truck Traffic (TI = 6.0)	Truck Traffic		
		TI = 7.0	TI = 8.0	TI = 9.0
PCC	5	5½	6½	8
Compacted Subgrade (95% minimum compaction)	12	12	12	12

2.0 SCOPE OF SERVICES

The scope of services performed for this project was in accordance with our Proposal No. 17P385, dated October 11, 2017. The scope of services included a visual site reconnaissance, subsurface exploration, field and laboratory testing, and geotechnical engineering analysis to provide criteria for preparing the design of the building foundations, building floor slab, and parking lot pavements along with site preparation recommendations and construction considerations for the proposed development. The evaluation of the environmental aspects of this site was beyond the scope of services for this geotechnical investigation.

3.0 SITE AND PROJECT DESCRIPTION

3.1 Site Conditions

The site is located at the northwest corner of Ramona Expressway and Indian Avenue in Perris, California. The site is bounded to the west by a commercial/industrial building, to the south by Ramona Expressway, and to the north and east by Indian Avenue. The general location of the site is illustrated on the Site Location Map, enclosed as Plate 1 in Appendix A of this report.

The subject site consists of an irregular-shaped parcel, approximately 25± acres in size. The site is currently vacant and undeveloped. Portion of the site appear to have been previously used for agricultural purposes. The ground surface consists of exposed soil with sparse to very dense native grass and weed growth. Crop stubble is present in isolated areas of the property. Scattered medium to large boulders are present on the ground surface in the northern portion of the site. A water pump station is present in the north-central area of the site.

Detailed topographic information was not available at the time of this report. However, based on visual observations, the site topography slopes to the southeast at an estimated gradient of less than 1 percent. Small ascending slopes are located along portions of the western property line, adjacent to the existing commercial/industrial building on the westerly adjacent property. There was estimated to be less than 5± feet of elevation differential across the site.

3.2 Proposed Development

A site plan for the proposed development, prepared by HPA Architecture, was provided to our office by the client. The plan indicates that the site will be developed with one (1) new warehouse building. The building will be located in the south-central area of the site and will be 428,730± ft² in size. The building will be constructed with loading docks along north side of the building. A large truck parking area will be located in the northern region of the property. The plan indicates that the building will be surrounded by asphaltic concrete pavements for parking and drive lanes and Portland cement concrete pavements in the loading dock areas. Landscape planters and concrete flatwork are expected to be included throughout the site.

Detailed structural information has not been provided. It is assumed that the building will be a single-story structure of tilt-up concrete construction, typically supported on conventional shallow foundations with a concrete slab-on-grade floor. Based on the assumed construction, maximum column and wall loads are expected to be on the order of 100 kips and 4 to 7 kips per linear foot, respectively.

The proposed development is not expected to include any significant amounts of below grade construction such as basements or crawl spaces. Based on the relatively level topography, cuts and fills of less than 5± feet are expected to be necessary to achieve the new site grades.

4.0 SUBSURFACE EXPLORATION

4.1 Scope of Exploration/Sampling Methods

The subsurface exploration conducted for this project consisted of twelve (12) borings, advanced to depths of 5 to 25± feet below currently existing site grades. All of the borings were logged during drilling by a member of our staff.

All borings were advanced with hollow-stem augers, by a conventional truck-mounted drilling rig. Representative bulk and in-situ soil samples were taken during drilling. Relatively undisturbed in-situ samples were taken with a split barrel "California Sampler" containing a series of one inch long, 2.416± inch diameter brass rings. This sampling method is described in ASTM Test Method D-3550. In-situ samples were also taken using a 1.4± inch inside diameter split spoon sampler, in general accordance with ASTM D-1586. Both of these samplers are driven into the ground with successive blows of a 140-pound weight falling 30 inches. The blow counts obtained during driving are recorded for further analysis. Bulk samples were collected in plastic bags to retain their original moisture content. The relatively undisturbed ring samples were placed in molded plastic sleeves that were then sealed and transported to our laboratory.

The approximate locations of the borings are indicated on the Boring Location Plan, included as Plate 2 in Appendix A of this report. The Boring Logs, which illustrate the conditions encountered at the boring locations, as well as the results of some of the laboratory testing, are included in Appendix B.

4.2 Geotechnical Conditions

Alluvium

Native alluvial soils were encountered at the ground surface at all of the boring locations. The near-surface alluvium generally consists of loose to medium dense clayey fine to medium sands, extending to depths of 3 to 6½± feet. At greater depths, the alluvium generally consists of interbedded layers of medium dense silty fine to medium sands, fine to medium sandy silts, and clayey fine sands as well as stiff to hard clayey silts and silty clays. The alluvium generally becomes more dense and/or stiffer with depth. These alluvial soils extend to at least the maximum depth explored of 25± feet.

Groundwater

Free water was not encountered during the drilling of any of the borings. Based on the lack of any water within the borings, and the moisture contents of the recovered soil samples, the static groundwater is considered to have existed at a depth in excess of 25± feet at the time of the subsurface exploration.

As part of our research, we reviewed available groundwater data in order to determine the historic high groundwater level for the site. The primary reference used to determine the groundwater depths in this area is the California Department of Water Resources website, <http://www.water.ca.gov/waterdatalibrary/>. This database indicates that a monitoring well is located within the subject site. Water level readings within this monitoring well indicate high groundwater levels of 81± feet (April 2017) below the ground surface.

5.0 LABORATORY TESTING

The soil samples recovered from the subsurface exploration were returned to our laboratory for further testing to determine selected physical and engineering properties of the soils. The tests are briefly discussed below. It should be noted that the test results are specific to the actual samples tested, and variations could be expected at other locations and depths.

Classification

All recovered soil samples were classified using the Unified Soil Classification System (USCS), in accordance with ASTM D-2488. Field identifications were then supplemented with additional visual classifications and/or by laboratory testing. The USCS classifications are shown on the Boring Logs and are periodically referenced throughout this report.

In-situ Density and Moisture Content

The density has been determined for selected relatively undisturbed ring samples. These densities were determined in general accordance with the method presented in ASTM D-2937. The results are recorded as dry unit weight in pounds per cubic foot. The moisture contents are determined in accordance with ASTM D-2216, and are expressed as a percentage of the dry weight. These test results are presented on the Boring Logs.

Consolidation

Selected soil samples have been tested to determine their consolidation potential, in accordance with ASTM D-2435. The testing apparatus is designed to accept either natural or remolded samples in a one-inch high ring, approximately 2.416 inches in diameter. Each sample is then loaded incrementally in a geometric progression and the resulting deflection is recorded at selected time intervals. Porous stones are in contact with the top and bottom of the sample to permit the addition or release of pore water. The samples are typically inundated with water at an intermediate load to determine their potential for collapse or heave. The results of the consolidation testing are plotted on Plates C-1 through C-8 in Appendix C of this report.

Maximum Dry Density and Optimum Moisture Content

A representative bulk sample has been tested for its maximum dry density and optimum moisture content. The results have been obtained using the Modified Proctor procedure, per ASTM D-1557, and are presented on Plate C-9 in Appendix C of this report. These tests are generally used to compare the in-situ densities of undisturbed field samples, and for later compaction testing. Additional testing of other soil types or soil mixes may be necessary at a later date.

Expansion Index

The expansion potential of the on-site soils was determined in general accordance with ASTM D-4829. The testing apparatus is designed to accept a 4-inch diameter, 1-in high, remolded sample. The sample is initially remolded to 50± 1 percent saturation and then loaded with a surcharge equivalent to 144 pounds per square foot. The sample is then inundated with water, and allowed

to swell against the surcharge. The resultant swell or consolidation is recorded after a 24-hour period. The results of the EI testing are as follows:

<u>Sample Identification</u>	<u>Expansion Index</u>	<u>Expansive Potential</u>
B-2 @ 0 to 5 feet	28	Low
B-4 @ 0 to 5 feet	20	Low

Soluble Sulfates

Representative samples of the near-surface soils have been submitted to a subcontracted analytical laboratory for determination of soluble sulfate content. Soluble sulfates are naturally present in soils, and if the concentration is high enough, can result in degradation of concrete which comes into contact with these soils. The results of the soluble sulfate testing are not yet available. These results, along with recommendations for any appropriate sulfate-resistant concrete mix designs will be presented in an addendum report.

Organic Content Testing

Selected soil samples have been tested to determine their organic content, in accordance with ASTM Test Method 2974. The results of the testing are as follows:

<u>Sample Identification</u>	<u>Organic Content</u>
B-2 @ 0 to 5 feet	0.53%
B-7 @ 0 to 5 feet	0.52%

6.0 CONCLUSIONS AND RECOMMENDATIONS

Based on the results of our review, field exploration, laboratory testing and geotechnical analysis, the proposed development is considered feasible from a geotechnical standpoint. The recommendations contained in this report should be taken into the design, construction, and grading considerations.

The recommendations are contingent upon all grading and foundation construction activities being monitored by the geotechnical engineer of record. The recommendations are provided with the assumption that an adequate program of client consultation, construction monitoring, and testing will be performed during the final design and construction phases to verify compliance with these recommendations. Maintaining Southern California Geotechnical, Inc., (SCG) as the geotechnical consultant from the beginning to the end of the project will provide continuity of services. The geotechnical engineering firm providing testing and observation services shall assume the responsibility of Geotechnical Engineer of Record.

The Grading Guide Specifications, included as Appendix D, should be considered part of this report, and should be incorporated into the project specifications. The contractor and/or owner of the development should bring to the attention of the geotechnical engineer any conditions that differ from those stated in this report, or which may be detrimental for the development.

6.1 Seismic Design Considerations

The subject site is located in an area which is subject to strong ground motions due to earthquakes. The performance of a site specific seismic hazards analysis was beyond the scope of this investigation. However, numerous faults capable of producing significant ground motions are located near the subject site. Due to economic considerations, it is not generally considered reasonable to design a structure that is not susceptible to earthquake damage. Therefore, significant damage to structures may be unavoidable during large earthquakes. The proposed structures should, however, be designed to resist structural collapse and thereby provide reasonable protection from serious injury, catastrophic property damage and loss of life.

Faulting and Seismicity

Research of available maps indicates that the subject site is not located within an Alquist-Priolo Earthquake Fault Zone. Furthermore, SCG did not identify any evidence of faulting during the geotechnical investigation. Therefore, the possibility of significant fault rupture on the site is considered to be low.

Seismic Design Parameters

Based on standards in place at the time of this report, the proposed development is expected to be designed in accordance with the requirements of the 2016 edition of the California Building Code (CBC). The CBC provides procedures for earthquake resistant structural design that include considerations for on-site soil conditions, occupancy, and the configuration of the structure

including the structural system and height. The seismic design parameters presented below are based on the soil profile and the proximity of known faults with respect to the subject site.

The 2016 CBC Seismic Design Parameters have been generated using U.S. Seismic Design Maps, a web-based software application developed by the United States Geological Survey. This software application, available at the USGS web site, calculates seismic design parameters in accordance with the 2016 CBC, utilizing a database of deterministic site accelerations at 0.01 degree intervals. The table below is a compilation of the data provided by the USGS application. A copy of the output generated from this program is included in Appendix E of this report. A copy of the Design Response Spectrum, as generated by the USGS application is also included in Appendix E. Based on this output, the following parameters may be utilized for the subject site:

2016 CBC SEISMIC DESIGN PARAMETERS

Parameter		Value
Mapped Spectral Acceleration at 0.2 sec Period	S_s	1.500
Mapped Spectral Acceleration at 1.0 sec Period	S_1	0.600
Site Class	---	D
Site Modified Spectral Acceleration at 0.2 sec Period	S_{MS}	1.500
Site Modified Spectral Acceleration at 1.0 sec Period	S_{M1}	0.900
Design Spectral Acceleration at 0.2 sec Period	S_{DS}	1.000
Design Spectral Acceleration at 1.0 sec Period	S_{D1}	0.600

Liquefaction

Liquefaction is the loss of strength in generally cohesionless, saturated soils when the pore-water pressure induced in the soil by a seismic event becomes equal to or exceeds the overburden pressure. The primary factors which influence the potential for liquefaction include groundwater table elevation, soil type and plasticity characteristics, relative density of the soil, initial confining pressure, and intensity and duration of ground shaking. The depth within which the occurrence of liquefaction may impact surface improvements is generally identified as the upper 50 feet below the existing ground surface. Liquefaction potential is greater in saturated, loose, poorly graded fine sands with a mean (d_{50}) grain size in the range of 0.075 to 0.2 mm (Seed and Idriss, 1971). Non-sensitive clayey (cohesive) soils which possess a plasticity index of at least 18 (Bray and Sancio, 2006) are generally not considered to be susceptible to liquefaction, nor are those soils which are above the historic static groundwater table.

The Riverside County GIS website indicates that the subject site is located within a zone of low liquefaction susceptibility. In addition, the soil conditions encountered at the boring locations are not considered to be conducive to liquefaction. These conditions consist of well-graded moderate to high strength native alluvial soils and no evidence of a long-term groundwater table within the upper 50± feet of the subsurface profile. Based on these considerations, liquefaction is not considered to be a design concern for this project.

6.2 Geotechnical Design Considerations

General

The subsurface conditions encountered at the boring locations generally consist of variable strength native alluvium. The results of laboratory testing indicate that the near surface alluvium (within the upper 3 to 5± feet) possesses a potential for moderate collapse when exposed to moisture infiltration as well as consolidation when exposed to load increases in the range of those that will be exerted by the new foundations. Some of the near-surface soils also possess calcareous nodules and/or veining throughout with evidence of slight cementation, indicating an increased collapse potential. Based on these conditions, remedial grading will be necessary within the proposed building area to provide a subgrade suitable for support of the new foundations and floor slab.

Settlement

The recommended remedial grading will remove the potentially compressible/collapsible near-surface native alluvium, and replace these materials as compacted structural fill. The native soils that will remain in place below the recommended depth of overexcavation will not be subject to significant load increases from the foundations of the new structure. Provided that the recommended remedial grading is completed, the post-construction static settlements of the proposed structure are expected to be within tolerable limits.

Expansion

Laboratory testing performed on representative samples of the near surface soils indicates that these materials possess a low expansion potential (EI = 20 and 28). Based on the presence of expansive soils at this site, care should be given to proper moisture conditioning of all building pad subgrade soils to a moisture content of 2 to 4 percent above the ASTM D-1557 optimum during site grading. In addition to adequately moisture conditioning the subgrade soils and fill soils during grading, special care must be taken to maintaining moisture content of these soils at 2 to 4 percent above the optimum moisture content. This will require the contractor to frequently moisture condition these soils throughout the grading process, unless grading occurs during a period of relatively wet weather.

Shrinkage/Subsidence

Removal and recompaction of the near-surface native fill soils is estimated to result in an average shrinkage of 6 to 11 percent. It should be noted that the potential shrinkage estimate is based on dry density testing performed on small-diameter samples taken at the boring locations. If a more accurate and precise shrinkage estimate is desired, SCG can perform a shrinkage study involving several excavated test-pits where in-place densities are determined using in-situ testing methods instead of laboratory density testing on small-diameter samples. Please contact SCG for details and a cost estimate regarding a shrinkage study, if desired.

Minor ground subsidence is expected to occur in the soils below the zone of removal, due to settlement and machinery working. The subsidence is estimated to be 0.10 feet.

These estimates are based on previous experience and the subsurface conditions encountered at the boring locations. The actual amount of subsidence is expected to be variable and will be dependent on the type of machinery used, repetitions of use, and dynamic effects, all of which are difficult to assess precisely.

Grading and Foundation Plan Review

It is recommended that we be provided with copies of the grading and foundation plans, when they become available, for review with regard to the conclusions, recommendations, and assumptions contained within this report.

6.3 Site Grading Recommendations

The grading recommendations presented below are based on the subsurface conditions encountered at the boring locations and our understanding of the proposed development. We recommend that all grading activities be completed in accordance with the Grading Guide Specifications included as Appendix D of this report, unless superseded by site-specific recommendations presented below.

Site Stripping

Initial site preparation should include stripping of any surficial vegetation and organic soils. Based on conditions encountered at the time of the subsurface exploration, minor stripping of the crop stubble and native grass, weed, and brush growth is expected to be necessary. These materials should be disposed of offsite. The actual extent of site stripping should be determined in the field by the geotechnical engineer, based on the organic content and stability of the encountered materials.

Treatment of Existing Soils: Building Pad

Remedial grading should be performed within the proposed building pad area in order to remove the existing potentially compressible/collapsible native alluvium. It is recommended that the overexcavation extend to a depth of at least 4 feet below existing grade and to a depth of at least 4 feet below proposed grade, whichever is greater. Within the influence zones of the new foundations, the overexcavation should extend to a depth of at least 3 feet below proposed foundation bearing grade.

The overexcavation areas should extend at least 5 feet beyond the building perimeter, and to an extent equal to the depth of fill below the new foundations. If the proposed structure incorporates any exterior columns (such as for a canopy or overhang) the area of overexcavation should also encompass these areas.

Following completion of the overexcavation, the subgrade soils within the overexcavation areas should be evaluated by the geotechnical engineer to verify their suitability to serve as the structural fill subgrade, as well as to support the foundation loads of the new structure. This evaluation should include proofrolling and probing to identify any soft, loose or otherwise unstable soils that must be removed. Some localized areas of deeper excavation may be required if

additional fill materials or loose, porous, overly moist, or low density native soils are encountered at the base of the overexcavation.

After a suitable overexcavation subgrade has been achieved, the exposed soils should be scarified to a depth of at least 12 inches and moisture conditioned or air dried to achieve a moisture content of 2 to 4 percent above optimum moisture content. The subgrade soils should then be recompacted to at least 90 percent of the ASTM D-1557 maximum dry density. The building pad areas may then be raised to grade with previously excavated soils or imported, structural fill. All structural fill soils present within the proposed building area should be compacted to at least 90 percent of the ASTM D-1557 maximum dry density.

Treatment of Existing Soils: Retaining Walls and Site Walls

The existing soils within the areas of proposed retaining and non-retaining site walls should be overexcavated to a depth of at least 3 feet below foundation bearing grade and replaced as compacted structural fill. Any undocumented fill soils should also be removed from the retaining wall areas. In both cases, the overexcavation subgrade soils should be evaluated by the geotechnical engineer prior to scarifying, moisture conditioning and recompacting the upper 12 inches of exposed subgrade soils. The previously excavated soils may then be replaced as compacted structural fill.

Treatment of Existing Soils: Parking Areas

Based on economic considerations, overexcavation of the surficial alluvial soils in the new parking areas is not considered warranted, with the exception of areas where lower strength or unstable soils are identified by the geotechnical engineer during grading.

Subgrade preparation in the new parking areas should initially consist of removal of all soils disturbed during stripping operations. The geotechnical engineer should then evaluate the subgrade to identify any areas of additional unsuitable soils. The subgrade soils should then be scarified to a depth of 12± inches, moisture conditioned to 2 to 4 percent above optimum, and recompacted to at least 90 percent of the ASTM D-1557 maximum dry density. Based on the presence of variable strength alluvial soils throughout the site, it is expected that some isolated areas of additional overexcavation may be required to remove zones of lower strength, unsuitable soils.

The grading recommendations presented above for the proposed parking and drive areas assume that the owner and/or developer can tolerate minor amounts of settlement within the proposed parking areas. The grading recommendations presented above do not completely mitigate the extent of existing collapsible and compressible alluvium in the parking areas. As such, settlement and associated pavement distress could occur. Typically, repair of such distressed areas involves significantly lower costs than completely mitigating these soils at the time of construction. If the owner cannot tolerate the risk of such settlements, the parking and drive areas should be overexcavated to a depth of 2 feet below proposed pavement subgrade elevation, with the resulting soils replaced as compacted structural fill.

Treatment of Existing Soils: Flatwork Areas

Subgrade preparation in the new flatwork areas should initially consist of removal of all soils disturbed during stripping and demolition operations. The geotechnical engineer should then evaluate the subgrade to identify any areas of additional unsuitable soils. The subgrade soils should then be scarified to a depth of 12± inches, moisture conditioned to 2 to 4 percent above optimum, and recompacted to at least 90 percent of the ASTM D-1557 maximum dry density. Based on the presence of variable strength alluvial soils throughout the site, it is expected that some isolated areas of additional overexcavation may be required to remove zones of lower strength, unsuitable soils.

Fill Placement

- Fill soils should be placed in thin (6± inches), near-horizontal lifts, moisture conditioned to 2 to 4 percent above the optimum moisture content, and compacted.
- On-site soils may be used for fill provided they are cleaned of any debris to the satisfaction of the geotechnical engineer. All grading and fill placement activities should be completed in accordance with the requirements of the CBC and the grading code of the city of Perris.
- All fill soils should be compacted to at least 90 percent of the ASTM D-1557 maximum dry density. Fill soils should be well mixed.
- Compaction tests should be performed periodically by the geotechnical engineer as random verification of compaction and moisture content. These tests are intended to aid the contractor. Since the tests are taken at discrete locations and depths, they may not be indicative of the entire fill and therefore should not relieve the contractor of his responsibility to meet the job specifications.

Imported Structural Fill

All imported structural fill should consist of low expansive ($EI < 50$), well graded soils possessing at least 10 percent fines (that portion of the sample passing the No. 200 sieve). Additional specifications for structural fill are presented in the Grading Guide Specifications, included as Appendix D.

Utility Trench Backfill

In general, all utility trench backfill soils should be compacted to at least 90 percent of the ASTM D-1557 maximum dry density. As an alternative, a clean sand (minimum Sand Equivalent of 30) may be placed within trenches and compacted in place (jetting or flooding is not recommended). Compacted trench backfill should conform to the requirements of the local grading code, and more restrictive requirements may be indicated by the city of Perris. All utility trench backfills should be witnessed by the geotechnical engineer. The trench backfill soils should be compaction tested where possible; probed and visually evaluated elsewhere.

Utility trenches which parallel a footing, and extending below a 1h:1v plane projected from the outside edge of the footing should be backfilled with structural fill soils, compacted to at least 90 percent of the ASTM D-1557 standard. Pea gravel backfill should not be used for these trenches.

6.4 Construction Considerations

Excavation Considerations

The near surface soils generally consist of moderate strength clayey sands. These materials may be subject to minor caving within shallow excavations. Where caving occurs within shallow excavations, flattened excavation slopes may be sufficient to provide excavation stability. On a preliminary basis, the inclination of temporary slopes should not exceed 2h:1v. Deeper excavations may require some form of external stabilization such as shoring or bracing. Maintaining adequate moisture content within the near-surface soils will improve excavation stability. All excavation activities on this site should be conducted in accordance with Cal-OSHA regulations.

Moisture Sensitive Subgrade Soils

Most of the near surface soils possess appreciable silt and clay content and may become unstable if exposed to significant moisture infiltration or disturbance by construction traffic. In addition, based on their granular content, some of the on-site soils will also be susceptible to erosion. The site should, therefore, be graded to prevent ponding of surface water and to prevent water from running into excavations.

Expansive Soils

Based on the results of laboratory testing, the near surface soils have been determined to be low expansive. Based on the presence of expansive soils at this site, care should be given to proper moisture conditioning of all building pad subgrade soils to a moisture content of 2 to 4 percent above the Modified Proctor optimum during site grading. All imported fill soils should have low expansive characteristics. In addition to adequately moisture conditioning the subgrade soils and fill soils during grading, special care must be taken to maintain moisture content of these soils at 2 to 4 percent above the Modified Proctor optimum. This will require the contractor to frequently moisture condition these soils throughout the grading process, unless grading occurs during a period of relatively wet weather.

Due to the presence of expansive soils at this site, provisions should be made to limit the potential for surface water to penetrate the soils immediately adjacent to the structure. These provisions should include directing surface runoff into rain gutters and area drains, reducing the extent of landscaped areas around the structure, and sloping the ground surface away from the building. Where possible, it is recommended that landscaped planters not be located immediately adjacent to the building. If landscaped planters around the buildings are necessary, it is recommended that drought tolerant plants or a drip irrigation system be utilized, to minimize the potential for deep moisture penetration around the structures. Other provisions, as determined by the landscape architect or civil engineer, may also be appropriate.

Groundwater

The static groundwater table is considered to exist at a depth in excess of 25± feet below existing grade. Therefore, groundwater is not expected to impact the grading or foundation construction activities.

6.5 Foundation Design and Construction

Based on the preceding grading recommendations, it is assumed that the new building pad will be underlain by structural fill soils extending to depths of at least 3 feet below foundation bearing grade. Based on this subsurface profile, the proposed structure may be supported on conventional shallow foundations.

Foundation Design Parameters

New square and rectangular footings may be designed as follows:

- Maximum, net allowable soil bearing pressure: 2,500 lbs/ft².
- Minimum wall/column footing width: 14 inches/24 inches.
- Minimum longitudinal steel reinforcement within strip footings: Four (4) No. 5 rebars (2 top and 2 bottom), due to the presence of expansive soils.
- Minimum foundation embedment: 12 inches into suitable structural fill soils, and at least 18 inches below adjacent exterior grade. Interior column footings may be placed immediately beneath the floor slab.
- It is recommended that the perimeter building foundations be continuous across all exterior doorways. Any flatwork adjacent to the exterior doors should be doweled into the perimeter foundations in a manner determined by the structural engineer.

The allowable bearing pressures presented above may be increased by 1/3 when considering short duration wind or seismic loads. The minimum steel reinforcement recommended above is based on standard geotechnical practice. Additional rigidity may be necessary for structural considerations. The actual design of the foundations should be determined by the structural engineer.

Foundation Construction

The foundation subgrade soils should be evaluated at the time of overexcavation, as discussed in Section 6.3 of this report. It is further recommended that the foundation subgrade soils be evaluated by the geotechnical engineer immediately prior to steel or concrete placement. Soils suitable for direct foundation support should consist of newly placed structural fill compacted at least 90 percent of the ASTM D-1557 maximum dry density. Any unsuitable materials should be removed to a depth of suitable bearing compacted structural fill, with the resulting excavations backfilled with compacted fill soils. As an alternative, lean concrete slurry (500 to 1,500 psi) may be used to backfill such isolated overexcavations.

The foundation subgrade soils should also be properly moisture conditioned to 2 to 4 percent above the Modified Proctor optimum, to a depth of at least 12 inches below bearing grade. Since it is typically not feasible to increase the moisture content of the floor slab and foundation subgrade soils once rough grading has been completed, care should be taken to maintain the moisture content of the building pad subgrade soils throughout the construction process.

Estimated Foundation Settlements

Post-construction total and differential static settlements of shallow foundations designed and constructed in accordance with the previously presented recommendations are estimated to be less than 1.0 and 0.5 inches, respectively. Differential movements are expected to occur over a 30-foot span, thereby resulting in an angular distortion of less than 0.002 inches per inch.

Lateral Load Resistance

Lateral load resistance will be developed by a combination of friction acting at the base of foundations and slabs and the passive earth pressure developed by footings below grade. The following friction and passive pressure may be used to resist lateral forces:

- Passive Earth Pressure: 300 lbs/ft³
- Friction Coefficient: 0.30

These are allowable values, and include a factor of safety. When combining friction and passive resistance, the passive pressure component should be reduced by one-third. These values assume that footings will be poured directly against compacted structural fill soils. The maximum allowable passive pressure is 2,500 lbs/ft².

6.6 Floor Slab Design and Construction

Subgrades which will support new floor slabs should be prepared in accordance with the recommendations contained in the ***Site Grading Recommendations*** section of this report. Based on the anticipated grading which will occur at this site, the floor of the proposed structure may be constructed as a conventional slab-on-grade supported on newly placed structural fill, extending to a depth of at least 4 feet below finished pad grade. Based on geotechnical considerations, the floor slab may be designed as follows:

- Minimum slab thickness: 6 inches.
- Modulus of Subgrade Reaction: 100 lbs/in³.
- Minimum slab reinforcement: Not required for geotechnical considerations. The actual floor slab reinforcement should be determined by the structural engineer, based upon the imposed loading.
- Slab underlayment: If moisture sensitive floor coverings will be used then minimum slab underlayment should consist of a moisture vapor barrier constructed below the entire slab area where such moisture sensitive floor coverings are expected. The moisture vapor barrier should meet or exceed the Class A rating as defined by ASTM E 1745-97 and have a permeance rating less than 0.01 perms as described in ASTM E 96-95 and ASTM E 154-88. A polyolefin material such as Stego® Wrap Vapor Barrier or equivalent will meet these specifications. The moisture vapor barrier should be properly constructed in accordance with all applicable manufacturer specifications. Given that a rock free subgrade is anticipated and that a capillary break is not required, sand below the barrier is not required. The need for sand and/or the amount of sand above the moisture vapor barrier

should be specified by the structural engineer or concrete contractor. The selection of sand above the barrier is not a geotechnical engineering issue and hence outside our purview. Where moisture sensitive floor coverings are not anticipated, the vapor barrier may be eliminated.

- Moisture condition the floor slab subgrade soils to 2 to 4 percent above the Modified Proctor optimum moisture content, to a depth of 12 inches. The moisture content of the floor slab subgrade soils should be verified by the geotechnical engineer within 24 hours prior to concrete placement.
- Proper concrete curing techniques should be utilized to reduce the potential for slab curling or the formation of excessive shrinkage cracks.

The actual design of the floor slab should be completed by the structural engineer to verify adequate thickness and reinforcement.

6.7 Exterior Flatwork Design and Construction

Subgrades which will support new exterior slabs-on-grade for sidewalks, patios, and other concrete flatwork, should be prepared in accordance with the recommendations contained in the ***Grading Recommendations*** section of this report. Based on geotechnical considerations, exterior slabs on grade may be designed as follows:

- Minimum slab thickness: 4½ inches.
- Minimum slab reinforcement: No. 3 bars at 18 inches on center, in both directions.
- The flatwork at building entry areas should be structurally connected to the perimeter foundation that is recommended to span across the door opening. This recommendation is designed to reduce the potential for differential movement at this joint.
- Moisture condition the slab subgrade soils to at least 2 to 4 percent of optimum moisture content, to a depth of at least 12 inches. Adequate moisture conditioning should be verified by the geotechnical engineer 24 hours prior to concrete placement.
- Proper concrete curing techniques should be utilized to reduce the potential for slab curling or the formation of excessive shrinkage cracks.
- Control joints should be provided at a maximum spacing of 8 feet on center in two directions for slabs and at 6 feet on center for sidewalks. Control joints are intended to direct cracking. Minor cracking of exterior concrete slabs on grade should be expected.

Expansion or felt joints should be used at the interface of exterior slabs on grade and any fixed structures to permit relative movement.

6.8 Retaining Wall Design and Construction

Although not indicated on the site plan, some small (less than 6 feet in height) retaining walls may be required to facilitate the new site grades and in the loading dock areas. The parameters recommended for use in the design of these walls are presented below.

Retaining Wall Design Parameters

Based on the soil conditions encountered at the boring locations, the following parameters may be used in the design of new retaining walls for this site. The following parameters assume that only the on-site soils will be utilized for retaining wall backfill. The near surface soils generally consist of clayey sands, silty sands, and sandy silts. Based on their composition, the on-site soils have been assigned a friction angle of 30 degrees.

If desired, SCG could provide design parameters for an alternative select backfill material behind the retaining walls. The use of select backfill material could result in lower lateral earth pressures. In order to use the design parameters for the imported select fill, this material must be placed within the entire active failure wedge. This wedge is defined as extending from the heel of the retaining wall upwards at an angle of approximately 60° from horizontal. If select backfill material behind the retaining wall is desired, SCG should be contacted for supplementary recommendations.

RETAINING WALL DESIGN PARAMETERS

Design Parameter		Soil Type
		On-site Clayey Sands, Silty Sands and Sandy Silts
Internal Friction Angle (ϕ)		30°
Unit Weight		133 lbs/ft ³
Equivalent Fluid Pressure:	Active Condition (level backfill)	44 lbs/ft ³
	Active Condition (2h:1v backfill)	72 lbs/ft ³
	At-Rest Condition (level backfill)	67 lbs/ft ³

The walls should be designed using a soil-footing coefficient of friction of 0.30 and an equivalent passive pressure of 300 lbs/ft³. The structural engineer should incorporate appropriate factors of safety in the design of the retaining walls.

The active earth pressure may be used for the design of retaining walls that do not directly support structures or support soils that in turn support structures and which will be allowed to deflect. The at-rest earth pressure should be used for walls that will not be allowed to deflect such as those which will support foundation bearing soils, or which will support foundation loads directly.

Where the soils on the toe side of the retaining wall are not covered by a "hard" surface such as a structure or pavement, the upper 1 foot of soil should be neglected when calculating passive

resistance due to the potential for the material to become disturbed or degraded during the life of the structure.

Seismic Lateral Earth Pressures

In accordance with the 2016 CBC, any retaining walls more than 6 feet in height must be designed for seismic lateral earth pressures. If walls 6 feet or more are required for this site, the geotechnical engineer should be contacted for supplementary seismic lateral earth pressure recommendations.

Retaining Wall Foundation Design

The retaining wall foundations should be supported within newly placed compacted structural fill, extending to a depth of at least 3 feet below proposed foundation bearing grade. Foundations to support new retaining walls should be designed in accordance with the general Foundation Design Parameters presented in a previous section of this report.

Backfill Material

On-site soils may be used to backfill the retaining walls. All backfill material placed within 3 feet of the back wall face should have a particle size no greater than 3 inches. The retaining wall backfill materials should be well graded.

It is recommended that a minimum 1 foot thick layer of free-draining granular material (less than 5 percent passing the No. 200 sieve) be placed against the face of the retaining walls. This material should extend from the top of the retaining wall footing to within 1 foot of the ground surface on the back side of the retaining wall. This material should be approved by the geotechnical engineer. In lieu of the 1 foot thick layer of free-draining material, a properly installed prefabricated drainage composite such as the MiraDRAIN 6000XL (or approved equivalent), which is specifically designed for use behind retaining walls, may be used. If the layer of free-draining material is not covered by an impermeable surface, such as a structure or pavement, a 12-inch thick layer of a low permeability soil should be placed over the backfill to reduce surface water migration to the underlying soils. The layer of free draining granular material should be separated from the backfill soils by a suitable geotextile, approved by the geotechnical engineer.

All retaining wall backfill should be placed and compacted under engineering controlled conditions in the necessary layer thicknesses to ensure an in-place density between 90 and 93 percent of the maximum dry density as determined by the Modified Proctor test (ASTM D1557). Care should be taken to avoid over-compaction of the soils behind the retaining walls, and the use of heavy compaction equipment should be avoided.

Subsurface Drainage

As previously indicated, the retaining wall design parameters are based upon drained backfill conditions. Consequently, some form of permanent drainage system will be necessary in conjunction with the appropriate backfill material. Subsurface drainage may consist of either:

- A weep hole drainage system typically consisting of a series of 4-inch diameter holes in the wall situated slightly above the ground surface elevation on the exposed side of the wall and at an approximate 8-foot on-center spacing. The weep holes should include a 2 cubic foot pocket of open graded gravel, surrounded by an approved geotextile fabric, at each weep hole location.
- A 4-inch diameter perforated pipe surrounded by 2 cubic feet of gravel per linear foot of drain placed behind the wall, above the retaining wall footing. The gravel layer should be wrapped in a suitable geotextile fabric to reduce the potential for migration of fines. The footing drain should be extended to daylight or tied into a storm drainage system.

6.9 Pavement Design Parameters

Site preparation in the pavement area should be completed as previously recommended in the ***Site Grading Recommendations*** section of this report. The subsequent pavement recommendations assume proper drainage and construction monitoring, and are based on either PCA or CALTRANS design parameters for a twenty (20) year design period. However, these designs also assume a routine pavement maintenance program to obtain the anticipated 20-year pavement service life.

Pavement Subgrades

It is anticipated that the new pavements will be primarily supported on a layer of compacted structural fill, consisting of scarified, thoroughly moisture conditioned and recompacted existing soils. The near surface soils generally consist of clayey sands, silty sands, and sandy silts. These soils are generally considered to possess fair pavement support characteristics with an estimated R-values of 30 to 40. R-value testing was outside the scope of services. The subsequent pavement design is therefore based upon an assumed R-value of 30. Any fill material imported to the site should have support characteristics equal to or greater than that of the on-site soils and be placed and compacted under engineering controlled conditions. It is recommended that R-value testing be performed after completion of rough grading. Depending upon the results of the R-value testing, it may be feasible to use thinner pavement sections in some areas of the site.

Asphaltic Concrete

Presented below are the recommended thicknesses for new flexible pavement structures consisting of asphaltic concrete over a granular base. The pavement designs are based on the traffic indices (TI's) indicated. The client and/or civil engineer should verify that these TI's are representative of the anticipated traffic volumes. If the client and/or civil engineer determine that the expected traffic volume will exceed the applicable traffic index, we should be contacted for supplementary recommendations. The design traffic indices equate to the following approximate daily traffic volumes over a 20-year design life, assuming six operational traffic days per week.

Traffic Index	No. of Heavy Trucks per Day
4.0	0
5.0	1
6.0	3
7.0	11
8.0	35
9.0	93

For the purpose of the traffic volumes indicated above, a truck is defined as a 5-axle tractor trailer unit with one 8-kip axle and two 32-kip tandem axles. All of the traffic indices allow for 1,000 automobiles per day.

ASPHALT PAVEMENTS (R = 30)					
Materials	Thickness (inches)				
	Auto Parking and Auto Drive Lanes (TI = 4.0 to 5.0)	Truck Traffic			
		TI = 6.0	TI = 7.0	TI = 8.0	TI = 9.0
Asphalt Concrete	3	4	4	5	6
Aggregate Base	6	7	10	11	12
Compacted Subgrade	12	12	12	12	12

The aggregate base course should be compacted to at least 95 percent of the ASTM D-1557 maximum dry density. The asphaltic concrete should be compacted to at least 95 percent of the Marshall maximum density, as determined by ASTM D-2726. The aggregate base course may consist of crushed aggregate base (CAB) or crushed miscellaneous base (CMB), which is a recycled gravel, asphalt and concrete material. The gradation, R-Value, Sand Equivalent, and Percentage Wear of the CAB or CMB should comply with appropriate specifications contained in the current edition of the "Greenbook" Standard Specifications for Public Works Construction.

Portland Cement Concrete

The preparation of the subgrade soils within concrete pavement areas should be performed as previously described for proposed asphalt pavement areas. The minimum recommended thicknesses for the Portland Cement Concrete pavement sections are as follows:

PORTLAND CEMENT CONCRETE PAVEMENTS (R = 30)				
Materials	Thickness (inches)			
	Autos and Light Truck Traffic (TI = 6.0)	Truck Traffic		
		TI = 7.0	TI = 8.0	TI = 9.0
PCC	5	5½	6½	8
Compacted Subgrade (95% minimum compaction)	12	12	12	12

The concrete should have a 28-day compressive strength of at least 3,000 psi. Any reinforcement within the PCC pavements should be determined by the project structural engineer. The maximum joint spacing within all of the PCC pavements is recommended to be equal to or less than 30 times the pavement thickness.

7.0 GENERAL COMMENTS



This report has been prepared as an instrument of service for use by the client, in order to aid in the evaluation of this property and to assist the architects and engineers in the design and preparation of the project plans and specifications. This report may be provided to the contractor(s) and other design consultants to disclose information relative to the project. However, this report is not intended to be utilized as a specification in and of itself, without appropriate interpretation by the project architect, civil engineer, and/or structural engineer. The reproduction and distribution of this report must be authorized by the client and Southern California Geotechnical, Inc. Furthermore, any reliance on this report by an unauthorized third party is at such party's sole risk, and we accept no responsibility for damage or loss which may occur. The client(s)' reliance upon this report is subject to the Engineering Services Agreement, incorporated into our proposal for this project.

The analysis of this site was based on a subsurface profile interpolated from limited discrete soil samples. While the materials encountered in the project area are considered to be representative of the total area, some variations should be expected between boring locations and sample depths. If the conditions encountered during construction vary significantly from those detailed herein, we should be contacted immediately to determine if the conditions alter the recommendations contained herein.

This report has been based on assumed or provided characteristics of the proposed development. It is recommended that the owner, client, architect, structural engineer, and civil engineer carefully review these assumptions to ensure that they are consistent with the characteristics of the proposed development. If discrepancies exist, they should be brought to our attention to verify that they do not affect the conclusions and recommendations contained herein. We also recommend that the project plans and specifications be submitted to our office for review to verify that our recommendations have been correctly interpreted.

The analysis, conclusions, and recommendations contained within this report have been promulgated in accordance with generally accepted professional geotechnical engineering practice. No other warranty is implied or expressed.



APPENDIX A

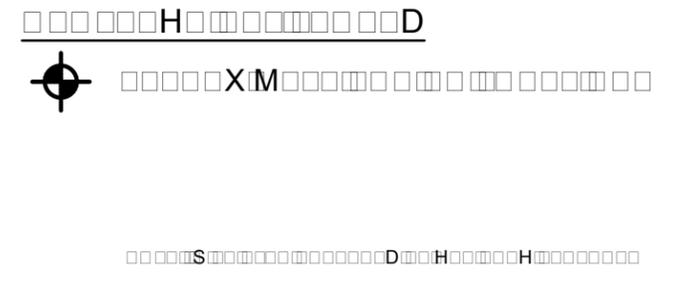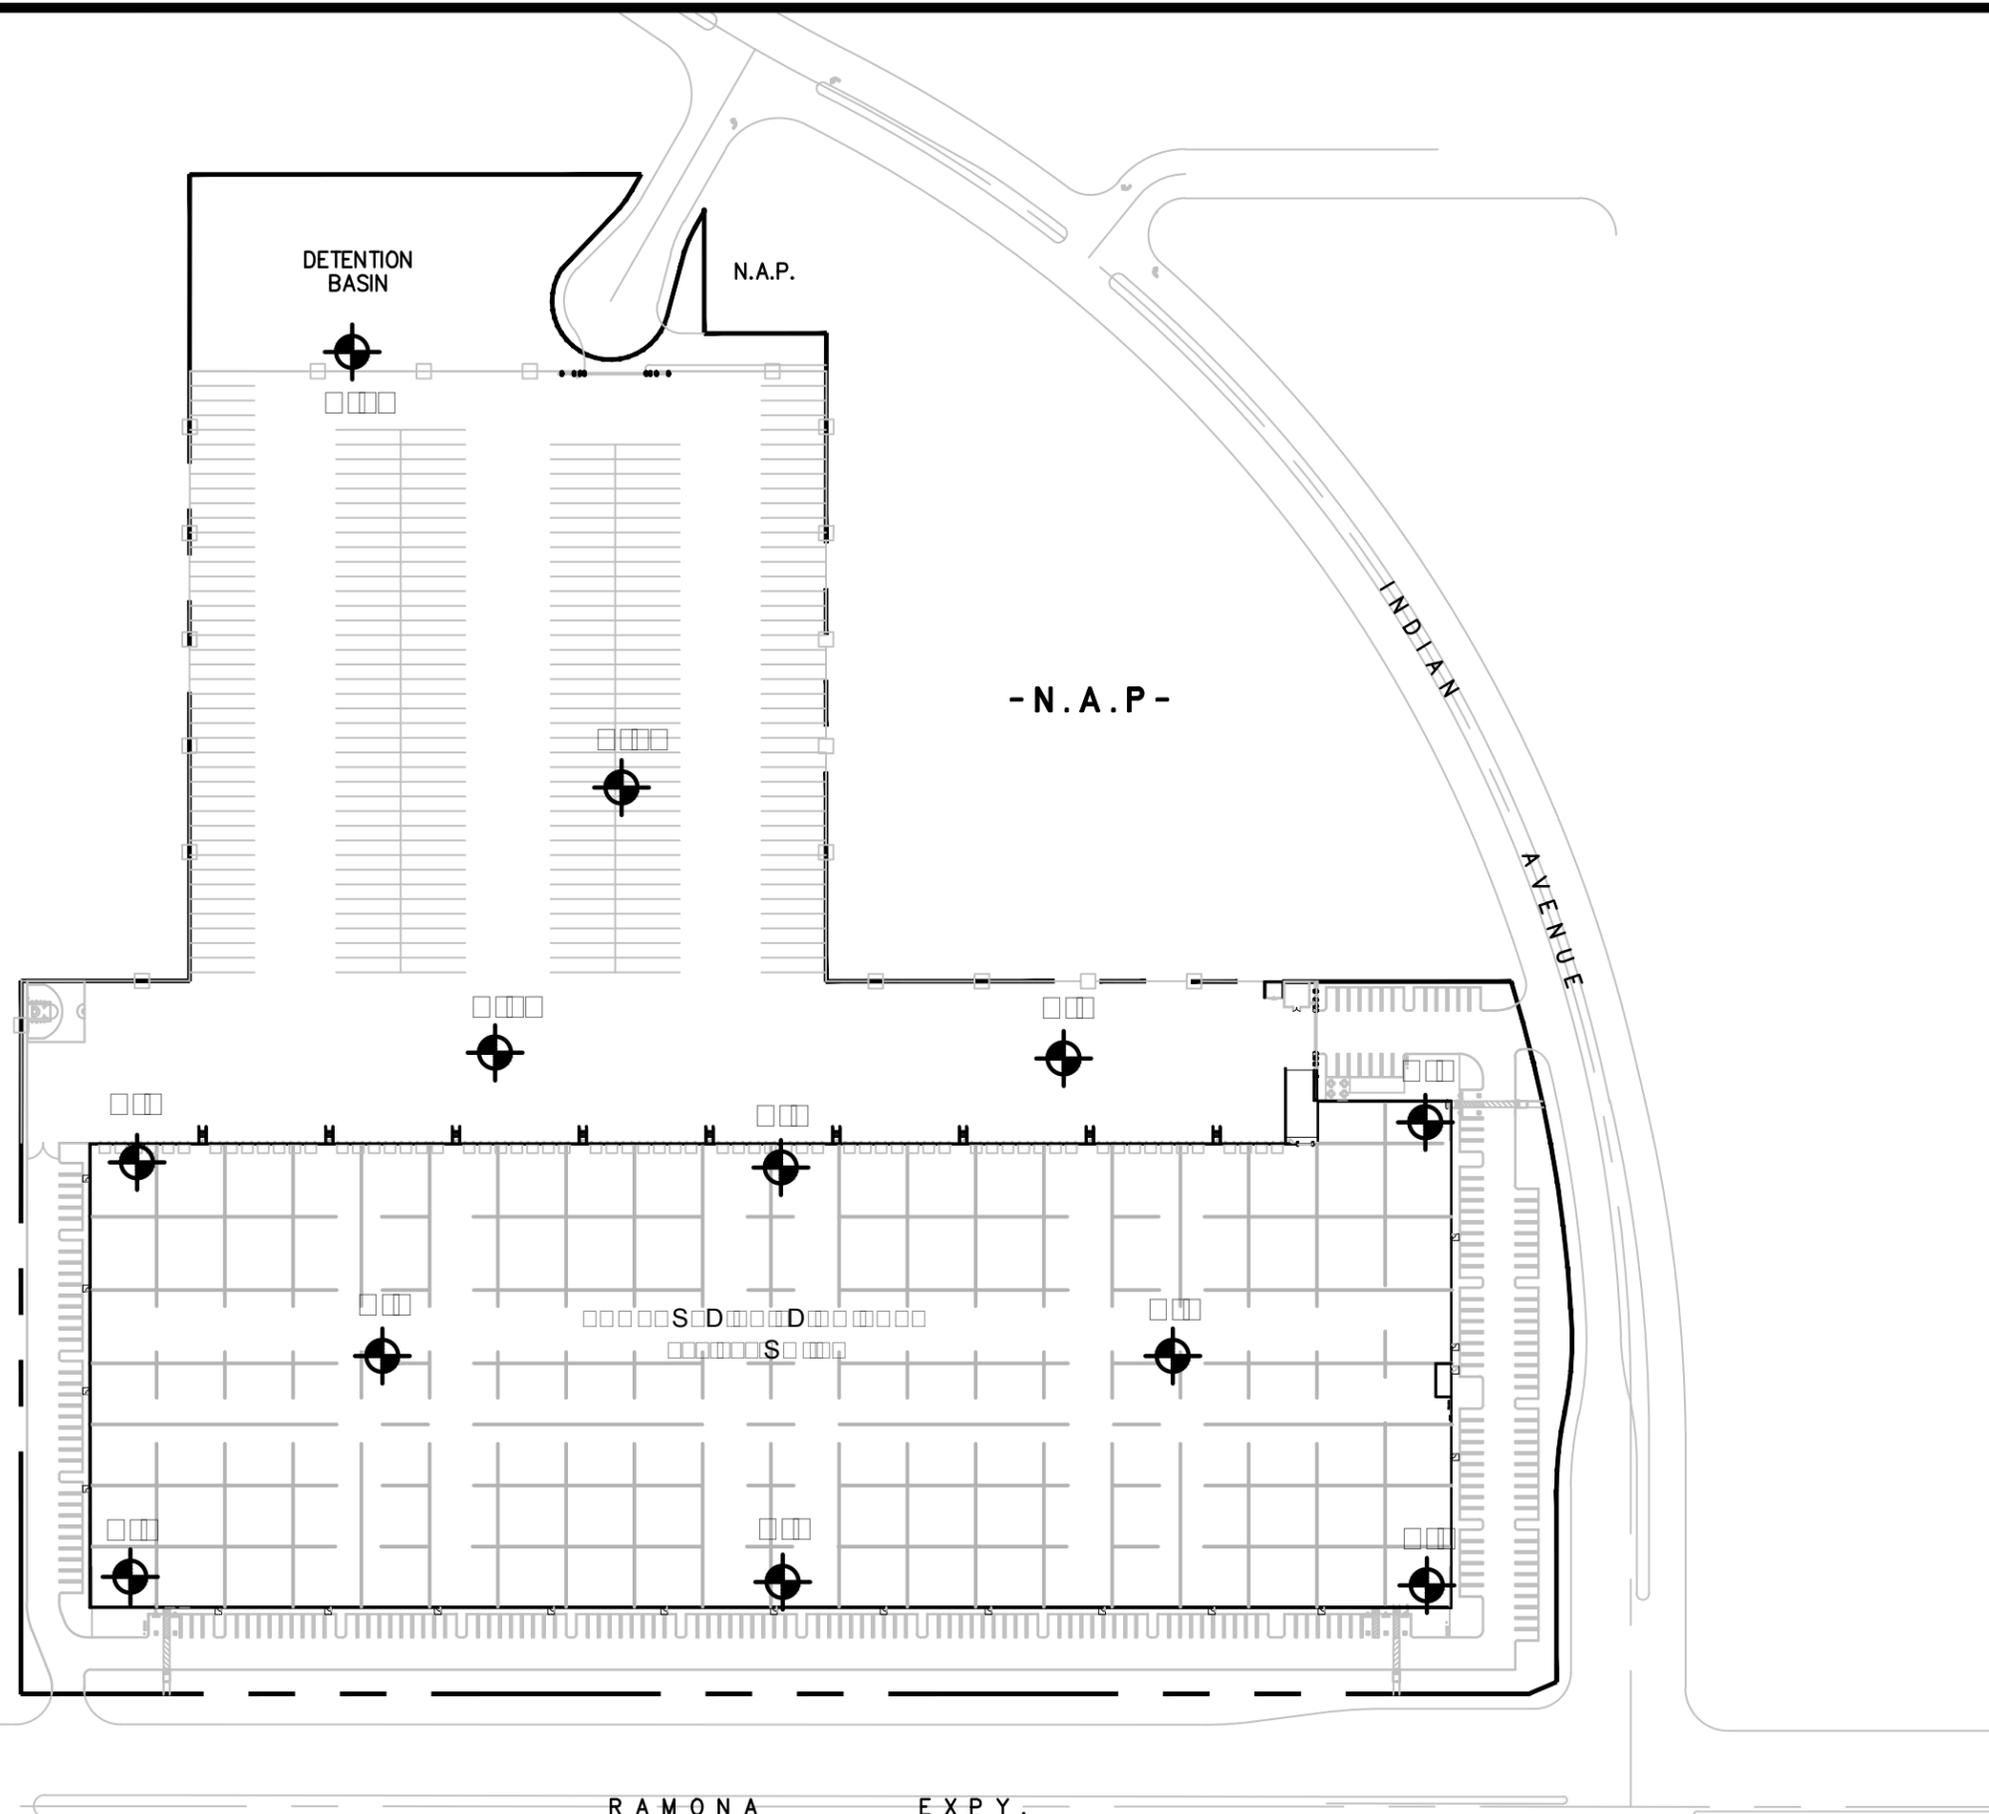

BORING LOCATION PLAN	
S D M M D S D	
S	
S	
D H	
S	
PLATE 2	
SOUTHERN CALIFORNIA GEOTECHNICAL	

APPENDIX B

BORING LOG LEGEND

SAMPLE TYPE	GRAPHICAL SYMBOL	SAMPLE DESCRIPTION
AUGER		SAMPLE COLLECTED FROM AUGER CUTTINGS, NO FIELD MEASUREMENT OF SOIL STRENGTH. (DISTURBED)
CORE		ROCK CORE SAMPLE: TYPICALLY TAKEN WITH A DIAMOND-TIPPED CORE BARREL. TYPICALLY USED ONLY IN HIGHLY CONSOLIDATED BEDROCK.
GRAB		SOIL SAMPLE TAKEN WITH NO SPECIALIZED EQUIPMENT, SUCH AS FROM A STOCKPILE OR THE GROUND SURFACE. (DISTURBED)
CS		CALIFORNIA SAMPLER: 2-1/2 INCH I.D. SPLIT BARREL SAMPLER, LINED WITH 1-INCH HIGH BRASS RINGS. DRIVEN WITH SPT HAMMER. (RELATIVELY UNDISTURBED)
NSR		NO RECOVERY: THE SAMPLING ATTEMPT DID NOT RESULT IN RECOVERY OF ANY SIGNIFICANT SOIL OR ROCK MATERIAL.
SPT		STANDARD PENETRATION TEST: SAMPLER IS A 1.4 INCH INSIDE DIAMETER SPLIT BARREL, DRIVEN 18 INCHES WITH THE SPT HAMMER. (DISTURBED)
SH		SHELBY TUBE: TAKEN WITH A THIN WALL SAMPLE TUBE, PUSHED INTO THE SOIL AND THEN EXTRACTED. (UNDISTURBED)
VANE		VANE SHEAR TEST: SOIL STRENGTH OBTAINED USING A 4 BLADED SHEAR DEVICE. TYPICALLY USED IN SOFT CLAYS-NO SAMPLE RECOVERED.

COLUMN DESCRIPTIONS

DEPTH:

Distance in feet below the ground surface.

SAMPLE:

Sample Type as depicted above.

BLOW COUNT:

Number of blows required to advance the sampler 12 inches using a 140 lb hammer with a 30-inch drop. 50/3" indicates penetration refusal (>50 blows) at 3 inches. WH indicates that the weight of the hammer was sufficient to push the sampler 6 inches or more.

POCKET PEN.:

Approximate shear strength of a cohesive soil sample as measured by pocket penetrometer.

GRAPHIC LOG:

Graphic Soil Symbol as depicted on the following page.

DRY DENSITY:

Dry density of an undisturbed or relatively undisturbed sample in lbs/ft³.

MOISTURE CONTENT:

Moisture content of a soil sample, expressed as a percentage of the dry weight.

LIQUID LIMIT:

The moisture content above which a soil behaves as a liquid.

PLASTIC LIMIT:

The moisture content above which a soil behaves as a plastic.

PASSING #200 SIEVE:

The percentage of the sample finer than the #200 standard sieve.

UNCONFINED SHEAR:

The shear strength of a cohesive soil sample, as measured in the unconfined state.

SOIL CLASSIFICATION CHART

MAJOR DIVISIONS			SYMBOLS		TYPICAL DESCRIPTIONS		
			GRAPH	LETTER			
<p>COARSE GRAINED SOILS</p> <p>MORE THAN 50% OF MATERIAL IS LARGER THAN NO. 200 SIEVE SIZE</p>	<p>GRAVEL AND GRAVELLY SOILS</p>	<p>CLEAN GRAVELS</p> <p>(LITTLE OR NO FINES)</p>		GW	WELL-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES		
		<p>GRAVELS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		GP	POORLY-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES		
		<p>MORE THAN 50% OF COARSE FRACTION RETAINED ON NO. 4 SIEVE</p>	<p>GRAVELS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		GM	SILTY GRAVELS, GRAVEL - SAND - SILT MIXTURES	
		<p>MORE THAN 50% OF COARSE FRACTION RETAINED ON NO. 4 SIEVE</p>	<p>GRAVELS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		GC	CLAYEY GRAVELS, GRAVEL - SAND - CLAY MIXTURES	
	<p>SAND AND SANDY SOILS</p>	<p>CLEAN SANDS</p> <p>(LITTLE OR NO FINES)</p>		SW	WELL-GRADED SANDS, GRAVELLY SANDS, LITTLE OR NO FINES		
				SP	POORLY-GRADED SANDS, GRAVELLY SAND, LITTLE OR NO FINES		
		<p>MORE THAN 50% OF COARSE FRACTION PASSING ON NO. 4 SIEVE</p>	<p>SANDS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		SM	SILTY SANDS, SAND - SILT MIXTURES	
					SC	CLAYEY SANDS, SAND - CLAY MIXTURES	
			<p>FINE GRAINED SOILS</p> <p>MORE THAN 50% OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE</p>	<p>SILTS AND CLAYS</p> <p>LIQUID LIMIT LESS THAN 50</p>		ML	INORGANIC SILTS AND VERY FINE SANDS, ROCK FLOUR, SILTY OR CLAYEY FINE SANDS OR CLAYEY SILTS WITH SLIGHT PLASTICITY
						CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS
	OL	ORGANIC SILTS AND ORGANIC SILTY CLAYS OF LOW PLASTICITY					
<p>SILTS AND CLAYS</p> <p>LIQUID LIMIT GREATER THAN 50</p>		MH		INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILTY SOILS			
		CH		INORGANIC CLAYS OF HIGH PLASTICITY			
		OH		ORGANIC CLAYS OF MEDIUM TO HIGH PLASTICITY, ORGANIC SILTS			
<p>HIGHLY ORGANIC SOILS</p>				PT	PEAT, HUMUS, SWAMP SOILS WITH HIGH ORGANIC CONTENTS		

NOTE: DUAL SYMBOLS ARE USED TO INDICATE BORDERLINE SOIL CLASSIFICATIONS



JOB NO.: 17G207 DRILLING DATE: 11/13/17 WATER DEPTH: Dry
 PROJECT: Proposed Commercial Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 13 feet
 LOCATION: Perris, California LOGGED BY: Jason Hiskey READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	UNCONFINED SHEAR (TSF)	
SURFACE ELEVATION: --- MSL												
5		24		4.0'	ALLUVIUM: Gray Brown Clayey fine Sand, some Silt, slightly porous, medium dense to dense-damp	8						
		32			Gray Brown Silty fine Sand, medium dense-damp	6						
		25			Gray Brown Clayey fine Sand, trace medium Sand, some Silt, medium dense-damp to moist	11						
10		25			Brown Clayey Silt, trace fine Sand, hard-moist	11						
15		34			Gray Brown Clayey fine to medium Sand, medium dense-damp to moist	11						
20		15										
25		22				16						
Boring Terminated at 25'												

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17



JOB NO.: 17G207 DRILLING DATE: 11/13/17 WATER DEPTH: Dry
 PROJECT: Proposed Commercial Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 13 feet
 LOCATION: Perris, California LOGGED BY: Jason Hiskey READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	UNCONFINED SHEAR (TSF)	
SURFACE ELEVATION: --- MSL												
					ALLUVIUM: Gray Brown Clayey fine Sand, trace Silt, slightly cemented, calcareous veining/nodules, dense-damp	120	5					EI = 28 @ 0 to 5'
						117	5					
5		48			Dark Brown Clayey fine Sand to fine Sandy Clay, trace medium Sand, medium dense to very stiff-damp to moist	122	8					
		51	4.5+		Gray Brown fine Sandy Silt, medium dense-damp	116	7					
		31				113	6					
		37										
10		26										
		28			Brown Clayey fine Sand, trace Silt, medium dense-damp		8					
15												
		24	4.5+		Brown fine Sandy Clay, trace Silt, very stiff-damp		10					
20												
		20			Gray Brown Silty fine Sand, medium dense-damp to very moist		10					
25												
Boring Terminated at 25'												

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17



JOB NO.: 17G207	DRILLING DATE: 11/13/17	WATER DEPTH: Dry
PROJECT: Proposed Commercial Development	DRILLING METHOD: Hollow Stem Auger	CAVE DEPTH: 8 feet
LOCATION: Perris, California	LOGGED BY: Jason Hiskey	READING TAKEN: At Completion

FIELD RESULTS					DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)	GRAPHIC LOG		DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	UNCONFINED SHEAR (TSF)	
SURFACE ELEVATION: --- MSL												
	X	44			ALLUVIUM: Brown Clayey fine Sand, trace Silt, trace medium Sand, medium dense to dense-damp	116	5					
	X	49				121	8					
5	X	45			Gray Brown fine Sandy Silt, trace Clay, trace calcareous veining/nodules, medium dense to dense-damp to moist	124	10					
	X	26				113	12					
10	X	30	3.0		Brown Clayey Silt, trace fine Sand, stiff to very stiff-moist	106	14					
					Brown fine Sandy Silt, trace Clay, dense-moist							
15	X	36					13					
Boring Terminated at 15'												

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17



JOB NO.: 17G207 DRILLING DATE: 11/13/17 WATER DEPTH: Dry
 PROJECT: Proposed Commercial Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 12 feet
 LOCATION: Perris, California LOGGED BY: Jason Hiskey READING TAKEN: At Completion

FIELD RESULTS					DESCRIPTION	LABORATORY RESULTS					COMMENTS	
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)	GRAPHIC LOG		DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)		UNCONFINED SHEAR (TSF)
SURFACE ELEVATION: --- MSL												
5	43				ALLUVIUM: Gray Brown Clayey fine Sand, trace Silt, medium Sand, medium dense-damp	118	4					El = 20 @ 0 to 5'
	42					113	6					
	41					121	6					
	35				Gray Brown fine Sandy Silt, medium dense-damp	111	5					
10	42	4.5+			Brown Clayey Silt, trace to little fine Sand, hard-moist	114	11					
15	23	4.0				12						
20	26				Brown Clayey fine Sand, medium dense-damp to moist		11					
Boring Terminated at 20'												

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17



JOB NO.: 17G207 DRILLING DATE: 11/13/17 WATER DEPTH: Dry
 PROJECT: Proposed Commercial Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 9 feet
 LOCATION: Perris, California LOGGED BY: Jason Hiskey READING TAKEN: At Completion

FIELD RESULTS				DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)		GRAPHIC LOG	DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	
SURFACE ELEVATION: --- MSL											
		20			ALLUVIUM: Light Brown Clayey fine Sand, trace medium Sand, trace fine root fibers, medium dense-dry to damp		3				
		8			Brown Silty fine to medium Sand, loose-damp		4				
5											
		10			Light Brown fine to medium Sand, trace Silt, loose to medium dense-dry to damp		3				
		28					3				
10											
		27	4.0		Brown Clayey Silt to Silty Clay, trace to little fine Sand, very stiff-moist		13				
15											
		19	3.0				18				
20											
Boring Terminated at 20'											

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17



JOB NO.: 17G207 DRILLING DATE: 11/13/17 WATER DEPTH: Dry
 PROJECT: Proposed Commercial Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 9 feet
 LOCATION: Perris, California LOGGED BY: Jason Hiskey READING TAKEN: At Completion

FIELD RESULTS				DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)		GRAPHIC LOG	DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	
SURFACE ELEVATION: --- MSL											
		23			ALLUVIUM: Gray Brown Clayey fine to medium Sand, medium dense-damp to moist	120	6				
		24				122	7				
5		18				113	10				
		28	4.5+			118	10				
		20				116	9				
10											
		19				5					
15											
Boring Terminated at 15'											

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17



JOB NO.: 17G207 DRILLING DATE: 11/13/17 WATER DEPTH: Dry
 PROJECT: Proposed Commercial Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 13 feet
 LOCATION: Perris, California LOGGED BY: Jason Hiskey READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	UNCONFINED SHEAR (TSF)	
SURFACE ELEVATION: --- MSL												
					ALLUVIUM: Gray Brown Clayey fine Sand, trace medium Sand, medium dense-damp	109	5					
						124	6					
5					Gray Brown Silty fine to medium Sand, dense-damp	120	5					
					Gray fine Sandy Silt, trace Clay, medium dense-damp to moist	121	11					
10						119	6					
					Brown Clayey Silt, trace fine Sand, very stiff-damp to moist							
15			3.0				12					
					Brown Silty fine Sand, medium dense-damp to moist							
20							11					
					Brown Silty Clay to Clayey Silt, trace fine Sand, very stiff-moist to very moist							
25			3.5				16					
Boring Terminated at 25'												

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17



JOB NO.: 17G207 DRILLING DATE: 11/13/17 WATER DEPTH: Dry
 PROJECT: Proposed Commercial Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 12 feet
 LOCATION: Perris, California LOGGED BY: Jason Hiskey READING TAKEN: At Completion

FIELD RESULTS				DESCRIPTION	LABORATORY RESULTS					COMMENTS	
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)		GRAPHIC LOG	DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT		PASSING #200 SIEVE (%)
SURFACE ELEVATION: --- MSL											
5		16			ALLUVIUM: Brown Clayey fine Sand, little medium Sand, medium dense-damp		5				
		19			Brown fine Sandy Silt, some Clay, medium dense-damp to moist		12				
		12			Brown Clayey fine Sand, some Silt, occasional calcareous nodules and deposits, medium dense-very moist		25				
10		11	1.0		Brown Clayey Silt, trace fine Sand, stiff-very moist		16				
15		17					16				
20		15	2.0		Gray Silty Clay, trace fine Sand, some calcareous nodules/veining, stiff to very stiff-very moist		20				
25		23			Brown Clayey fine Sand, trace medium Sand, calcareous nodules, medium dense-damp		11				
Boring Terminated at 25'											

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17



JOB NO.: 17G207	DRILLING DATE: 11/13/17	WATER DEPTH: Dry
PROJECT: Proposed Commercial Development	DRILLING METHOD: Hollow Stem Auger	CAVE DEPTH: 3.5 feet
LOCATION: Perris, California	LOGGED BY: Jason Hiskey	READING TAKEN: At Completion

FIELD RESULTS				DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)		GRAPHIC LOG	DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	
SURFACE ELEVATION: --- MSL											
	X	8			ALLUVIUM: Brown Clayey fine Sand, trace to little medium Sand, loose to medium dense-damp		9				
	X	11					9				
5					Boring Terminated at 5'						

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17



JOB NO.: 17G207	DRILLING DATE: 11/13/17	WATER DEPTH: Dry
PROJECT: Proposed Commercial Development	DRILLING METHOD: Hollow Stem Auger	CAVE DEPTH: 3.5 feet
LOCATION: Perris, California	LOGGED BY: Jason Hiskey	READING TAKEN: At Completion

FIELD RESULTS				DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)		GRAPHIC LOG	DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	
SURFACE ELEVATION: --- MSL											
	X	27		[Hatched Box]	<u>ALLUVIUM:</u> Light Brown Clayey fine Sand, trace medium Sand, medium dense-damp to moist		5				
	X	26		[Hatched Box]			12				
5					Boring Terminated at 5'						

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17



JOB NO.: 17G207	DRILLING DATE: 11/13/17	WATER DEPTH: Dry
PROJECT: Proposed Commercial Development	DRILLING METHOD: Hollow Stem Auger	CAVE DEPTH: 3.5 feet
LOCATION: Perris, California	LOGGED BY: Jason Hiskey	READING TAKEN: At Completion

FIELD RESULTS				DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)		GRAPHIC LOG	DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	
SURFACE ELEVATION: --- MSL											
5	X	7		[Hatched Box]	<u>ALLUVIUM</u> : Light Brown Clayey fine Sand, trace to little medium Sand, some Silt, loose to medium dense-damp		5				
	X	22		[Hatched Box]			7				
					Boring Terminated at 5'						

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17




JOB NO.: 17G207	DRILLING DATE: 11/13/17	WATER DEPTH: Dry
PROJECT: Proposed Commercial Development	DRILLING METHOD: Hollow Stem Auger	CAVE DEPTH: 3.5 feet
LOCATION: Perris, California	LOGGED BY: Jason Hiskey	READING TAKEN: At Completion

FIELD RESULTS				DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)		GRAPHIC LOG	DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	
SURFACE ELEVATION: --- MSL											
	X	23			ALLUVIUM: Brown Clayey fine Sand, trace Silt, trace medium Sand, medium dense-damp		6				
	X	16					6				
5					Boring Terminated at 5'						

TBL_17G207.GPJ_SOCALGEO.GDT_12/4/17

A P P E N D I X C

Consolidation/Collapse Test Results

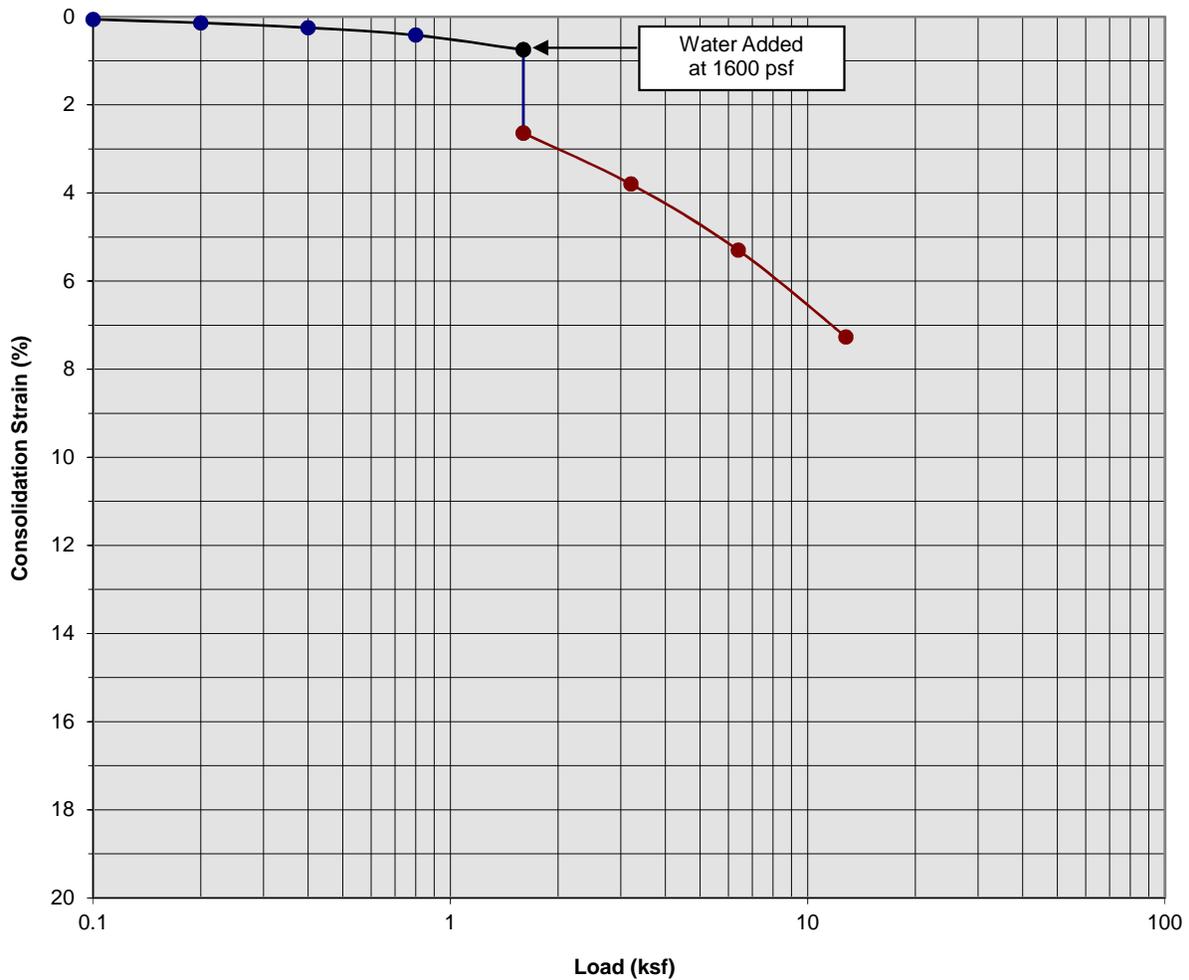

Classification: Brown Clayey fine Sand, trace Silt, trace medium Sand


Boring Number:	B-3	Initial Moisture Content (%)	8
Sample Number:	---	Final Moisture Content (%)	12
Depth (ft)	3 to 4	Initial Dry Density (pcf)	120.9
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	130.4
Specimen Thickness (in)	1.0	Percent Collapse (%)	1.89

Proposed Commercial Development
 Perris, California
 Project No. 17G207
PLATE C- 1



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

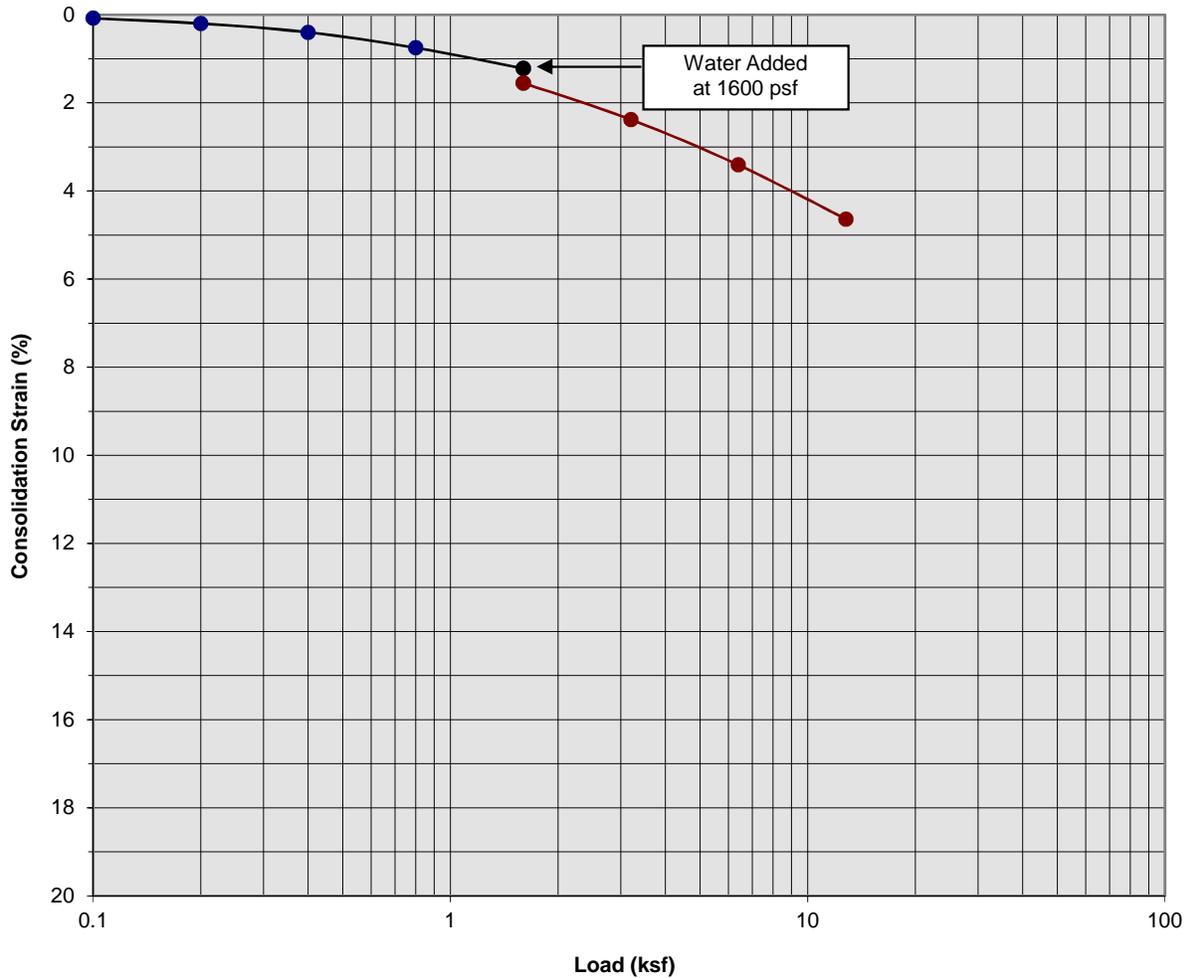

Classification: Gray Brown fine Sandy Silt, trace Clay


Boring Number:	B-3	Initial Moisture Content (%)	10
Sample Number:	---	Final Moisture Content (%)	13
Depth (ft)	5 to 6	Initial Dry Density (pcf)	122.3
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	129.0
Specimen Thickness (in)	1.0	Percent Collapse (%)	0.33

Proposed Commercial Development
 Perris, California
 Project No. 17G207
PLATE C- 2



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

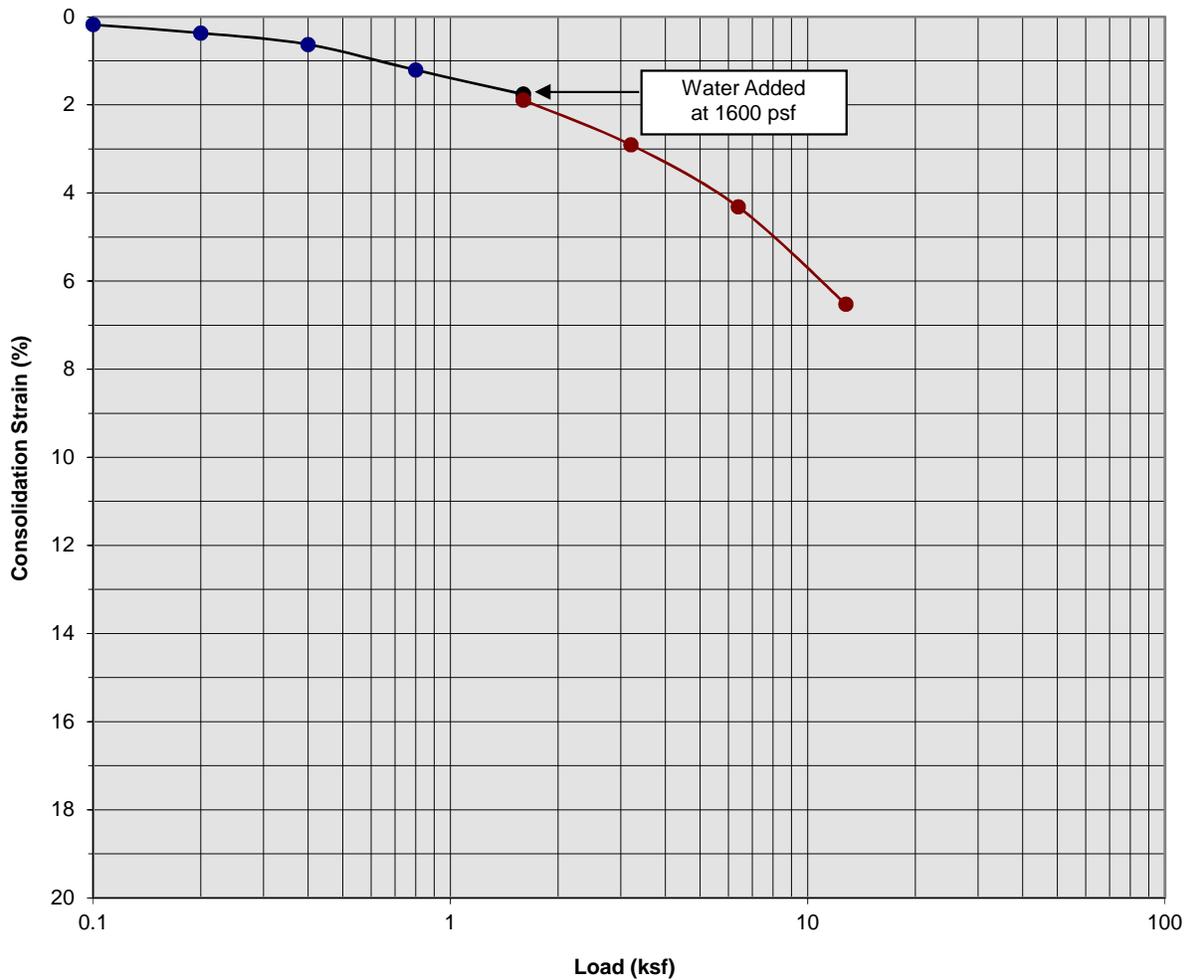

Classification: Gray Brown fine Sandy Silt, trace Clay


Boring Number:	B-3	Initial Moisture Content (%)	13
Sample Number:	---	Final Moisture Content (%)	16
Depth (ft)	7 to 8	Initial Dry Density (pcf)	112.3
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	121.1
Specimen Thickness (in)	1.0	Percent Collapse (%)	0.13

Proposed Commercial Development
 Perris, California
 Project No. 17G207
PLATE C- 3



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

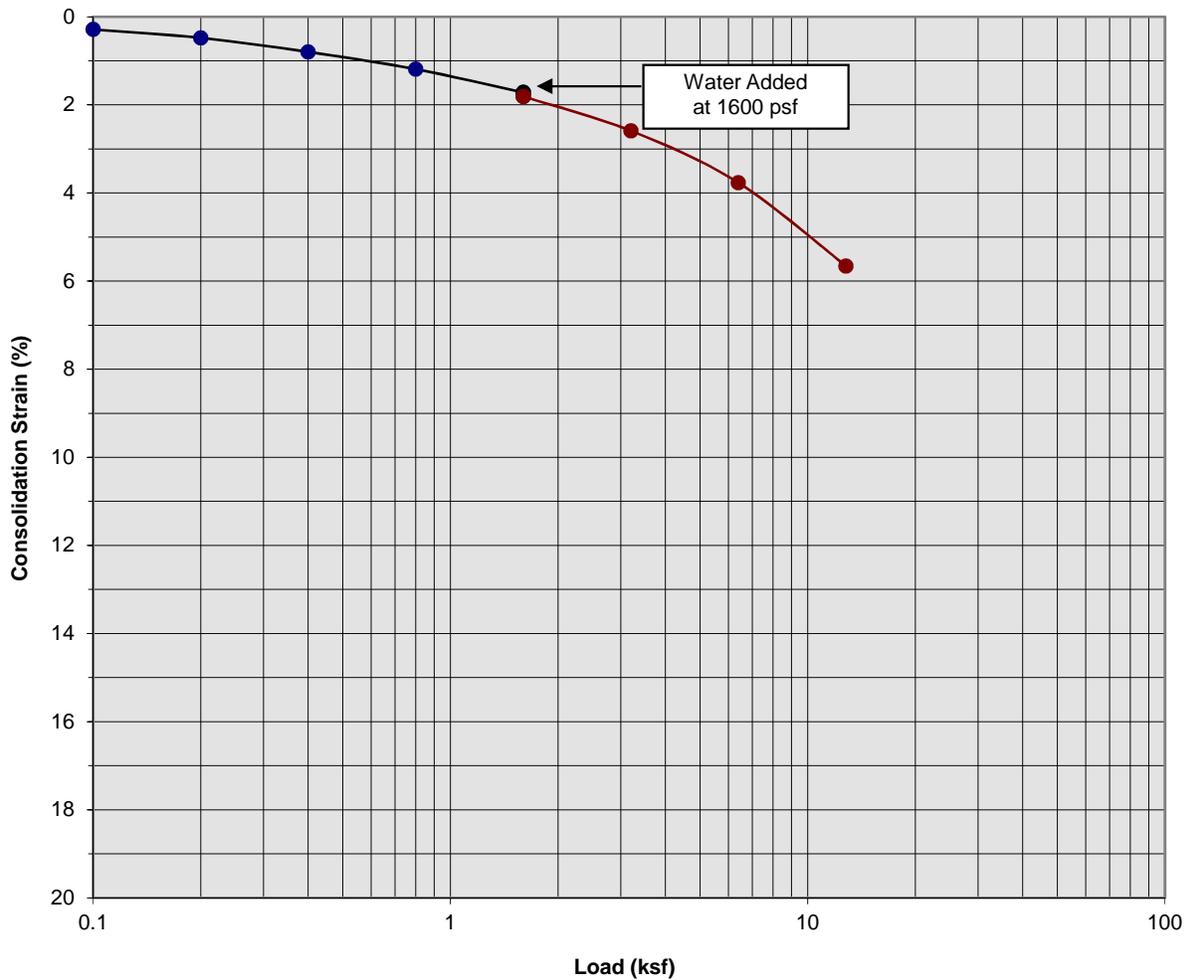

Classification: Brown Clayey Silt, trace fine Sand


Boring Number:	B-3	Initial Moisture Content (%)	15
Sample Number:	---	Final Moisture Content (%)	21
Depth (ft)	9 to 10	Initial Dry Density (pcf)	104.6
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	110.6
Specimen Thickness (in)	1.0	Percent Collapse (%)	0.09

Proposed Commercial Development
 Perris, California
 Project No. 17G207
PLATE C- 4



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

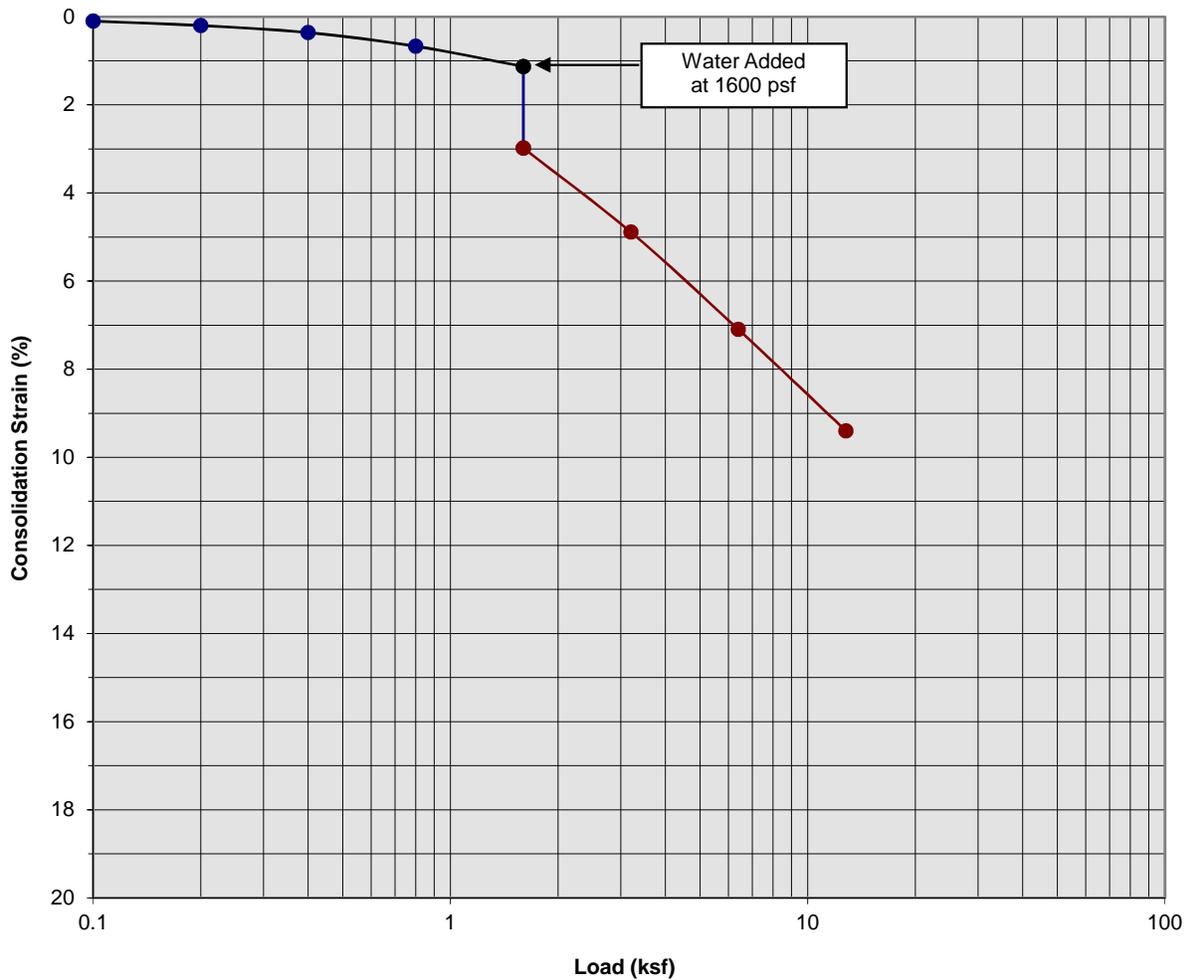

Classification: Gray Brown Clayey fine to medium Sand


Boring Number:	B-6	Initial Moisture Content (%)	7
Sample Number:	---	Final Moisture Content (%)	11
Depth (ft)	1 to 2	Initial Dry Density (pcf)	120.1
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	132.2
Specimen Thickness (in)	1.0	Percent Collapse (%)	1.85

Proposed Commercial Development
 Perris, California
 Project No. 17G207
PLATE C- 5



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

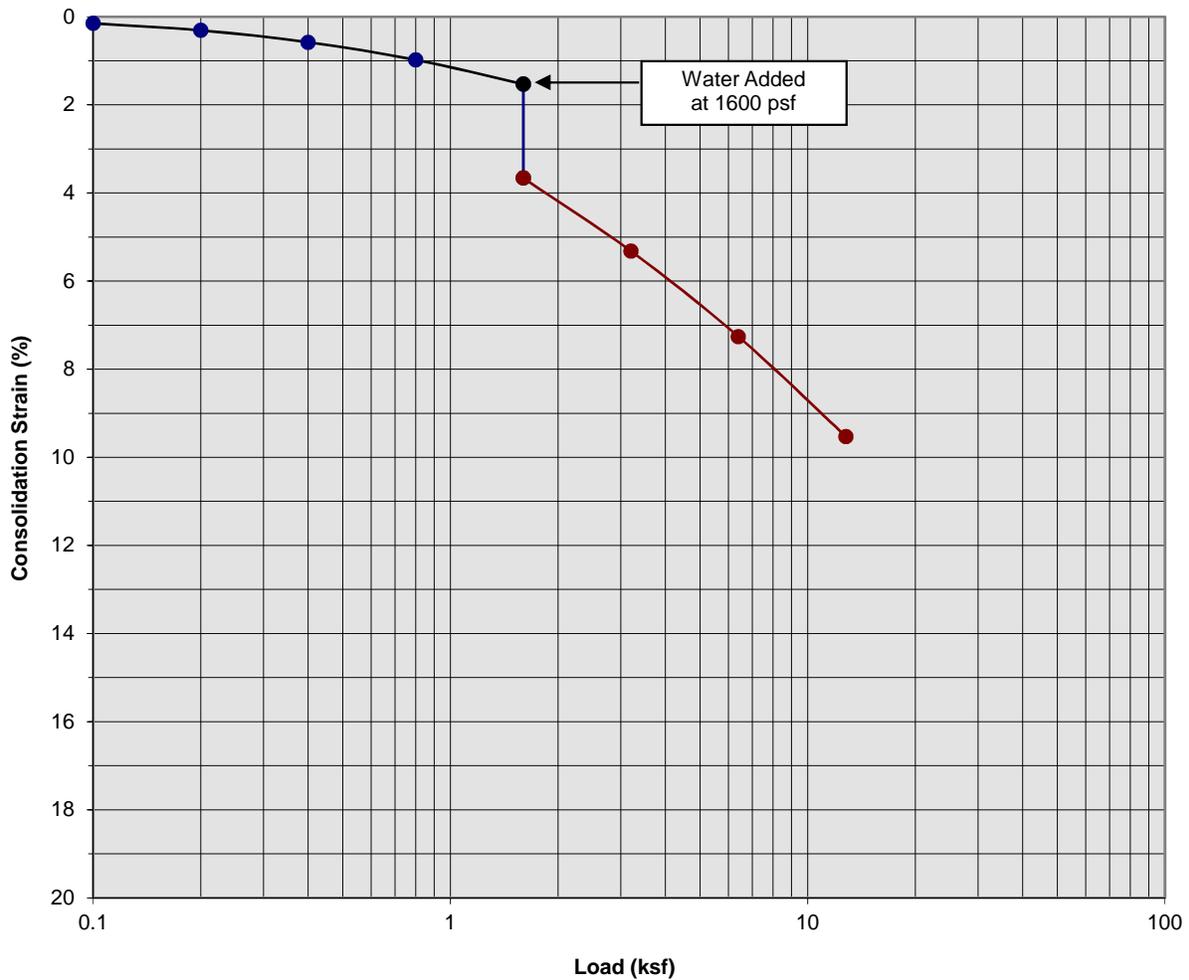

Classification: Gray Brown Clayey fine to medium Sand


Boring Number:	B-6	Initial Moisture Content (%)	8
Sample Number:	---	Final Moisture Content (%)	11
Depth (ft)	3 to 4	Initial Dry Density (pcf)	120.6
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	133.4
Specimen Thickness (in)	1.0	Percent Collapse (%)	2.13

Proposed Commercial Development
 Perris, California
 Project No. 17G207
PLATE C- 6



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

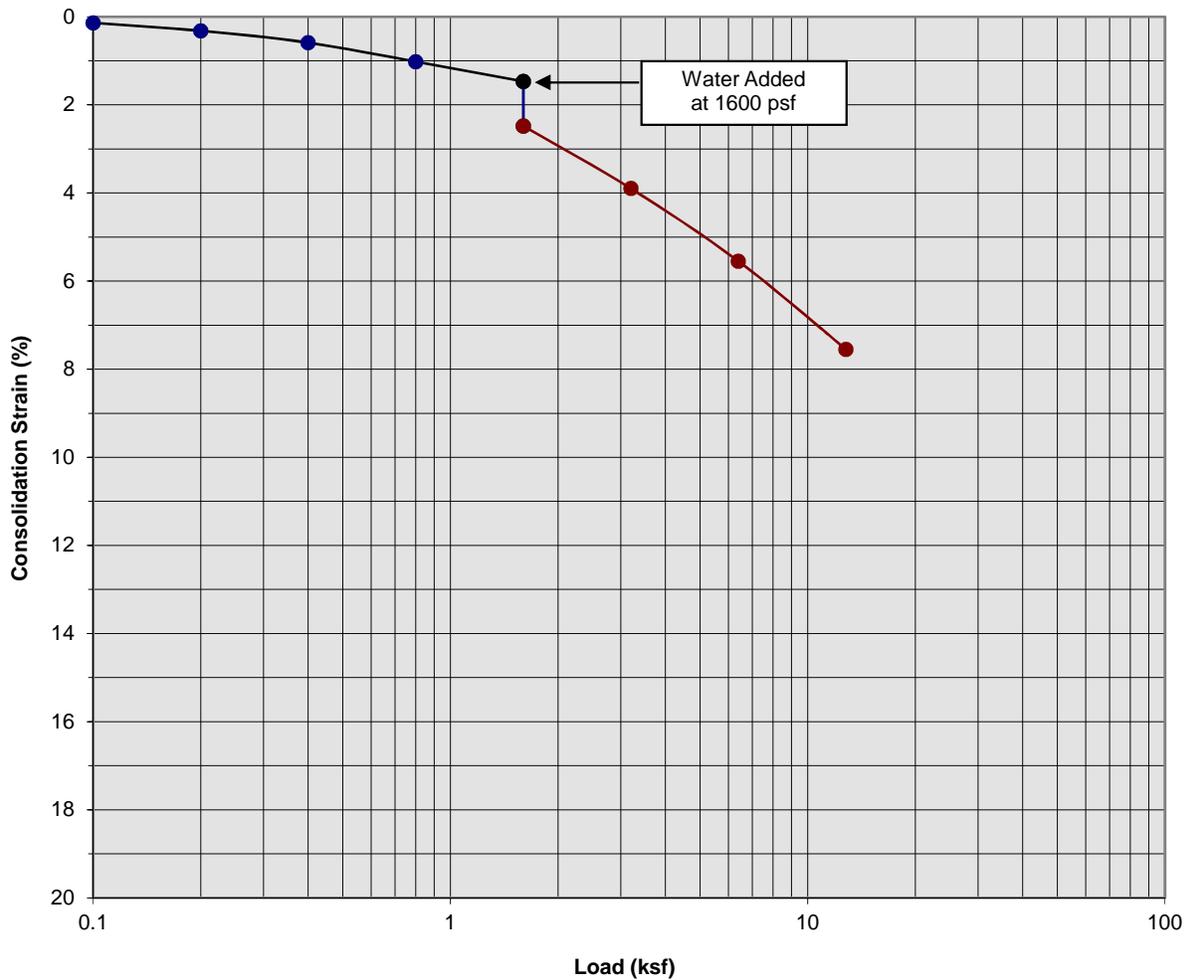

Classification: Gray Brown Clayey fine to medium Sand


Boring Number:	B-6	Initial Moisture Content (%)	10
Sample Number:	---	Final Moisture Content (%)	13
Depth (ft)	5 to 6	Initial Dry Density (pcf)	113.5
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	122.9
Specimen Thickness (in)	1.0	Percent Collapse (%)	1.01

Proposed Commercial Development
 Perris, California
 Project No. 17G207
PLATE C- 7



SOUTHERN CALIFORNIA GEOTECHNICAL
 A California Corporation

Consolidation/Collapse Test Results

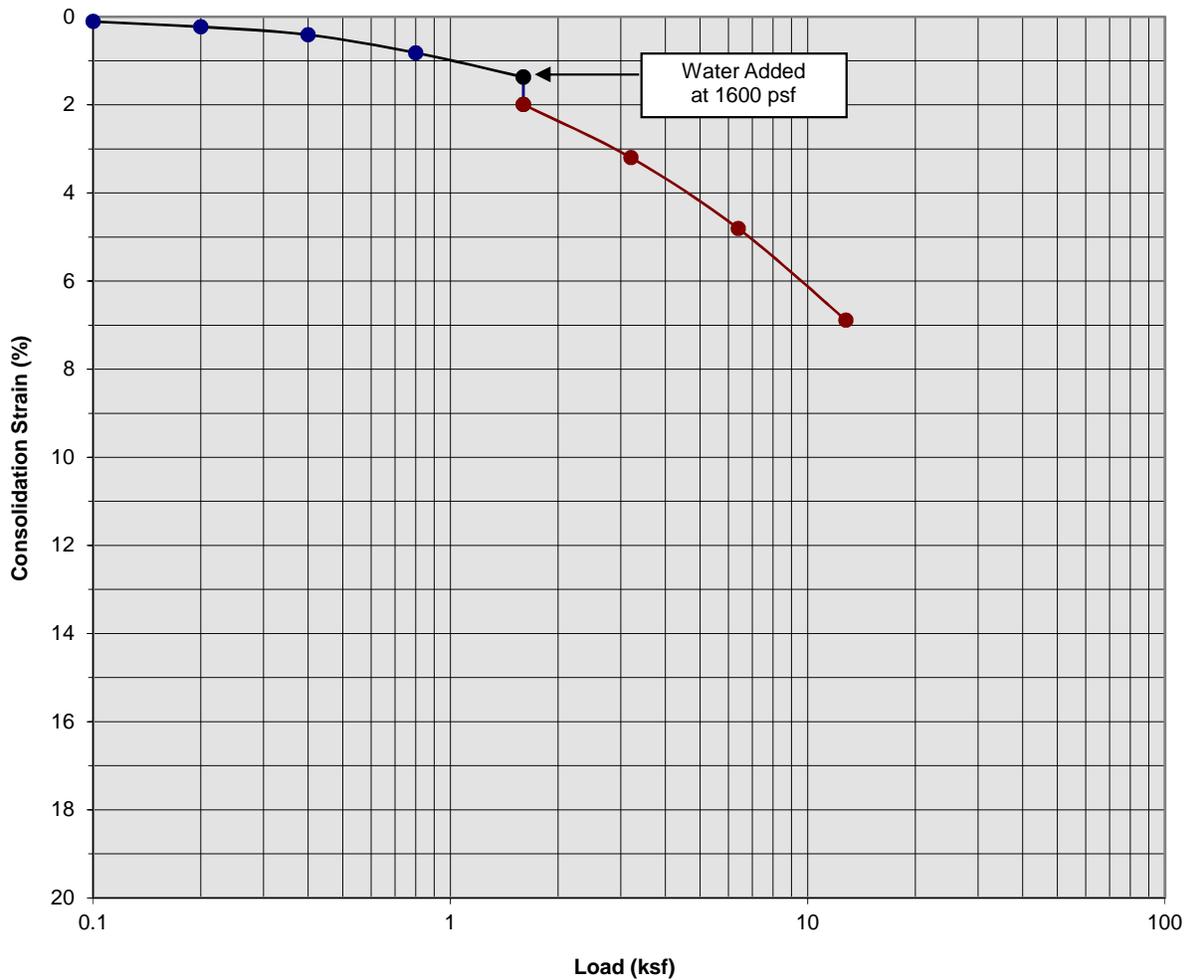

Classification: Gray Brown Clayey Silt, trace to little fine Sand


Boring Number:	B-6	Initial Moisture Content (%)	10
Sample Number:	---	Final Moisture Content (%)	12
Depth (ft)	7 to 8	Initial Dry Density (pcf)	117.8
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	126.9
Specimen Thickness (in)	1.0	Percent Collapse (%)	0.62

Proposed Commercial Development
 Perris, California
 Project No. 17G207
PLATE C- 8



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Moisture/Density Relationship ASTM D-1557

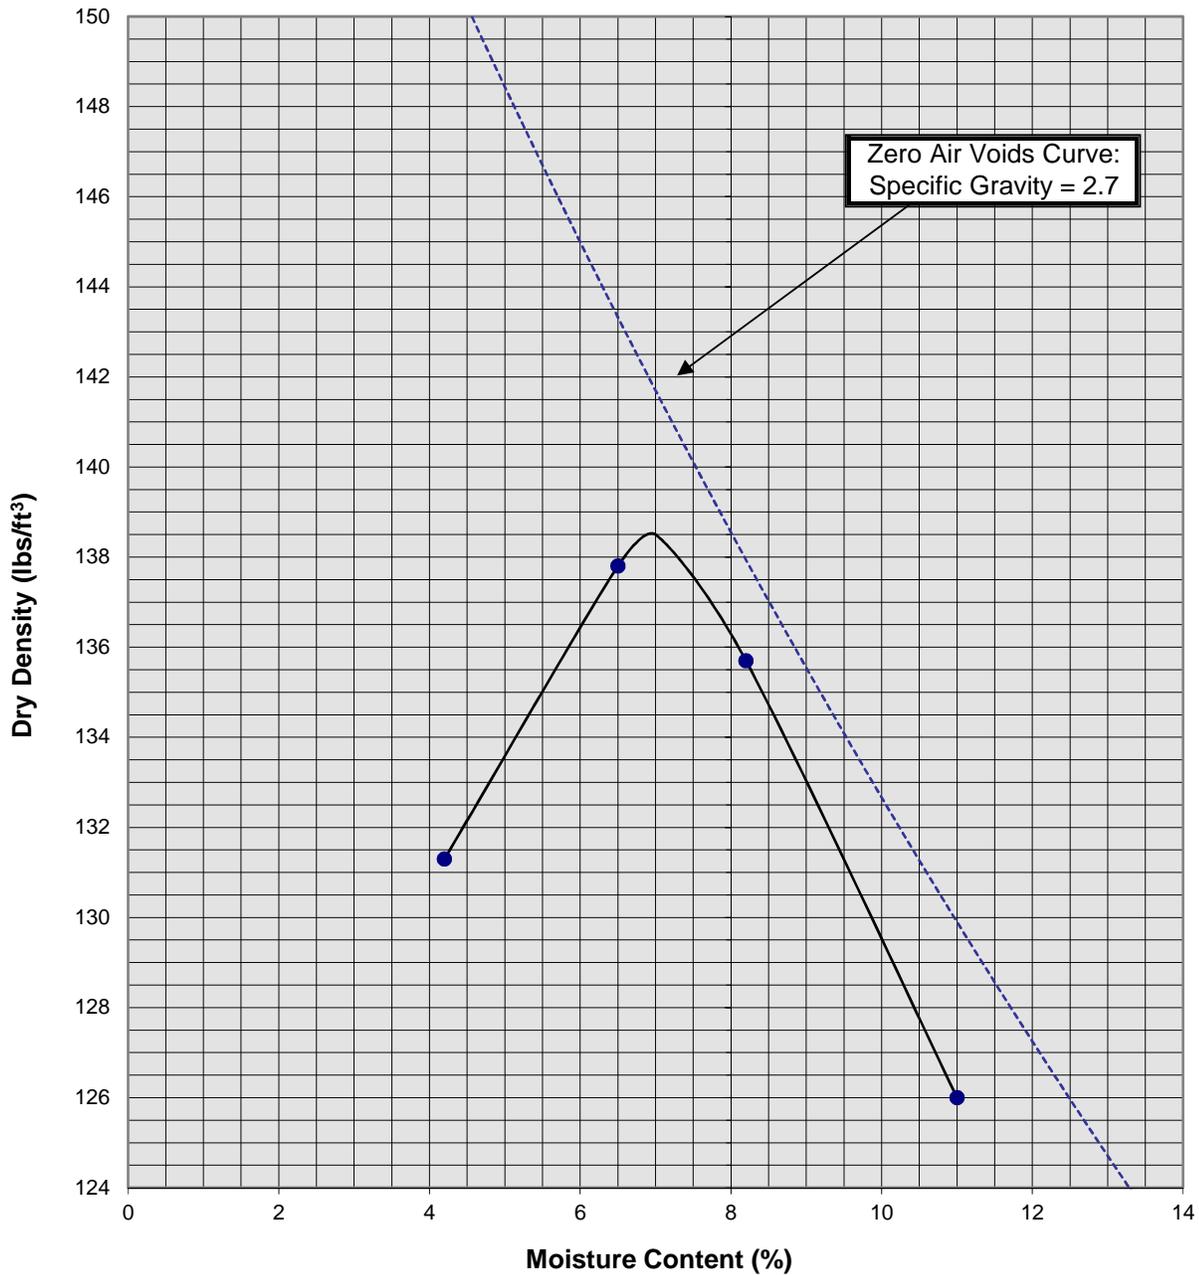

Soil ID Number		B-4 @ 0 to 5'
Optimum Moisture (%)		7
Maximum Dry Density (pcf)		138.5
Soil Classification	Gray Brown Clayey fine Sand, trace Silt, medium Sand	

Proposed Commercial Development
 Perris, California
 Project No. 17G207
PLATE C-9



SOUTHERN CALIFORNIA GEOTECHNICAL
A California Corporation

APPENDIX

GRADING GUIDE SPECIFICATIONS

These grading guide specifications are intended to provide typical procedures for grading operations. They are intended to supplement the recommendations contained in the geotechnical investigation report for this project. Should the recommendations in the geotechnical investigation report conflict with the grading guide specifications, the more site specific recommendations in the geotechnical investigation report will govern.

General

- The Earthwork Contractor is responsible for the satisfactory completion of all earthwork in accordance with the plans and geotechnical reports, and in accordance with city, county, and applicable building codes.
- The Geotechnical Engineer is the representative of the Owner/Builder for the purpose of implementing the report recommendations and guidelines. These duties are not intended to relieve the Earthwork Contractor of any responsibility to perform in a workman-like manner, nor is the Geotechnical Engineer to direct the grading equipment or personnel employed by the Contractor.
- The Earthwork Contractor is required to notify the Geotechnical Engineer of the anticipated work and schedule so that testing and inspections can be provided. If necessary, work may be stopped and redone if personnel have not been scheduled in advance.
- The Earthwork Contractor is required to have suitable and sufficient equipment on the job-site to process, moisture condition, mix and compact the amount of fill being placed to the approved compaction. In addition, suitable support equipment should be available to conform with recommendations and guidelines in this report.
- Canyon cleanouts, overexcavation areas, processed ground to receive fill, key excavations, subdrains and benches should be observed by the Geotechnical Engineer prior to placement of any fill. It is the Earthwork Contractor's responsibility to notify the Geotechnical Engineer of areas that are ready for inspection.
- Excavation, filling, and subgrade preparation should be performed in a manner and sequence that will provide drainage at all times and proper control of erosion. Precipitation, springs, and seepage water encountered shall be pumped or drained to provide a suitable working surface. The Geotechnical Engineer must be informed of springs or water seepage encountered during grading or foundation construction for possible revision to the recommended construction procedures and/or installation of subdrains.

Site Preparation

- The Earthwork Contractor is responsible for all clearing, grubbing, stripping and site preparation for the project in accordance with the recommendations of the Geotechnical Engineer.
- If any materials or areas are encountered by the Earthwork Contractor which are suspected of having toxic or environmentally sensitive contamination, the Geotechnical Engineer and Owner/Builder should be notified immediately.

- Major vegetation should be stripped and disposed of off-site. This includes trees, brush, heavy grasses and any materials considered unsuitable by the Geotechnical Engineer.
- Underground structures such as basements, cesspools or septic disposal systems, mining shafts, tunnels, wells and pipelines should be removed under the inspection of the Geotechnical Engineer and recommendations provided by the Geotechnical Engineer and/or city, county or state agencies. If such structures are known or found, the Geotechnical Engineer should be notified as soon as possible so that recommendations can be formulated.
- Any topsoil, slopewash, colluvium, alluvium and rock materials which are considered unsuitable by the Geotechnical Engineer should be removed prior to fill placement.
- Remaining voids created during site clearing caused by removal of trees, foundations basements, irrigation facilities, etc., should be excavated and filled with compacted fill.
- Subsequent to clearing and removals, areas to receive fill should be scarified to a depth of 10 to 12 inches, moisture conditioned and compacted
- The moisture condition of the processed ground should be at or slightly above the optimum moisture content as determined by the Geotechnical Engineer. Depending upon field conditions, this may require air drying or watering together with mixing and/or discing.

Compacted Fills

- Soil materials imported to or excavated on the property may be utilized in the fill, provided each material has been determined to be suitable in the opinion of the Geotechnical Engineer. Unless otherwise approved by the Geotechnical Engineer, all fill materials shall be free of deleterious, organic, or frozen matter, shall contain no chemicals that may result in the material being classified as "contaminated," and shall be very low to non-expansive with a maximum expansion index (EI) of 50. The top 12 inches of the compacted fill should have a maximum particle size of 3 inches, and all underlying compacted fill material a maximum 6-inch particle size, except as noted below.
- All soils should be evaluated and tested by the Geotechnical Engineer. Materials with high expansion potential, low strength, poor gradation or containing organic materials may require removal from the site or selective placement and/or mixing to the satisfaction of the Geotechnical Engineer.
- Rock fragments or rocks less than 6 inches in their largest dimensions, or as otherwise determined by the Geotechnical Engineer, may be used in compacted fill, provided the distribution and placement is satisfactory in the opinion of the Geotechnical Engineer.
- Rock fragments or rocks greater than 12 inches should be taken off-site or placed in accordance with recommendations and in areas designated as suitable by the Geotechnical Engineer. These materials should be placed in accordance with Plate D-8 of these Grading Guide Specifications and in accordance with the following recommendations:
 - Rocks 12 inches or more in diameter should be placed in rows at least 15 feet apart, 15 feet from the edge of the fill, and 10 feet or more below subgrade. Spaces should be left between each rock fragment to provide for placement and compaction of soil around the fragments.
 - Fill materials consisting of soil meeting the minimum moisture content requirements and free of oversize material should be placed between and over the rows of rock or

concrete. Ample water and compactive effort should be applied to the fill materials as they are placed in order that all of the voids between each of the fragments are filled and compacted to the specified density.

- Subsequent rows of rocks should be placed such that they are not directly above a row placed in the previous lift of fill. A minimum 5-foot offset between rows is recommended.
- To facilitate future trenching, oversized material should not be placed within the range of foundation excavations, future utilities or other underground construction unless specifically approved by the soil engineer and the developer/owner representative.
- Fill materials approved by the Geotechnical Engineer should be placed in areas previously prepared to receive fill and in evenly placed, near horizontal layers at about 6 to 8 inches in loose thickness, or as otherwise determined by the Geotechnical Engineer for the project.
- Each layer should be moisture conditioned to optimum moisture content, or slightly above, as directed by the Geotechnical Engineer. After proper mixing and/or drying, to evenly distribute the moisture, the layers should be compacted to at least 90 percent of the maximum dry density in compliance with ASTM D-1557-78 unless otherwise indicated.
- Density and moisture content testing should be performed by the Geotechnical Engineer at random intervals and locations as determined by the Geotechnical Engineer. These tests are intended as an aid to the Earthwork Contractor, so he can evaluate his workmanship, equipment effectiveness and site conditions. The Earthwork Contractor is responsible for compaction as required by the Geotechnical Report(s) and governmental agencies.
- Fill areas unused for a period of time may require moisture conditioning, processing and recompaction prior to the start of additional filling. The Earthwork Contractor should notify the Geotechnical Engineer of his intent so that an evaluation can be made.
- Fill placed on ground sloping at a 5-to-1 inclination (horizontal-to-vertical) or steeper should be benched into bedrock or other suitable materials, as directed by the Geotechnical Engineer. Typical details of benching are illustrated on Plates D-2, D-4, and D-5.
- Cut/fill transition lots should have the cut portion overexcavated to a depth of at least 3 feet and rebuilt with fill (see Plate D-1), as determined by the Geotechnical Engineer.
- All cut lots should be inspected by the Geotechnical Engineer for fracturing and other bedrock conditions. If necessary, the pads should be overexcavated to a depth of 3 feet and rebuilt with a uniform, more cohesive soil type to impede moisture penetration.
- Cut portions of pad areas above buttresses or stabilizations should be overexcavated to a depth of 3 feet and rebuilt with uniform, more cohesive compacted fill to impede moisture penetration.
- Non-structural fill adjacent to structural fill should typically be placed in unison to provide lateral support. Backfill along walls must be placed and compacted with care to ensure that excessive unbalanced lateral pressures do not develop. The type of fill material placed adjacent to below grade walls must be properly tested and approved by the Geotechnical Engineer with consideration of the lateral earth pressure used in the design.

Foundations

- The foundation influence zone is defined as extending one foot horizontally from the outside edge of a footing, and proceeding downward at a ½ horizontal to 1 vertical (0.5:1) inclination.
- Where overexcavation beneath a footing subgrade is necessary, it should be conducted so as to encompass the entire foundation influence zone, as described above.
- Compacted fill adjacent to exterior footings should extend at least 12 inches above foundation bearing grade. Compacted fill within the interior of structures should extend to the floor subgrade elevation.

Fill Slopes

- The placement and compaction of fill described above applies to all fill slopes. Slope compaction should be accomplished by overfilling the slope, adequately compacting the fill in even layers, including the overfilled zone and cutting the slope back to expose the compacted core
- Slope compaction may also be achieved by backrolling the slope adequately every 2 to 4 vertical feet during the filling process as well as requiring the earth moving and compaction equipment to work close to the top of the slope. Upon completion of slope construction, the slope face should be compacted with a sheepsfoot connected to a sideboom and then grid rolled. This method of slope compaction should only be used if approved by the Geotechnical Engineer.
- Sandy soils lacking in adequate cohesion may be unstable for a finished slope condition and therefore should not be placed within 15 horizontal feet of the slope face.
- All fill slopes should be keyed into bedrock or other suitable material. Fill keys should be at least 15 feet wide and inclined at 2 percent into the slope. For slopes higher than 30 feet, the fill key width should be equal to one-half the height of the slope (see Plate D-5).
- All fill keys should be cleared of loose slough material prior to geotechnical inspection and should be approved by the Geotechnical Engineer and governmental agencies prior to filling.
- The cut portion of fill over cut slopes should be made first and inspected by the Geotechnical Engineer for possible stabilization requirements. The fill portion should be adequately keyed through all surficial soils and into bedrock or suitable material. Soils should be removed from the transition zone between the cut and fill portions (see Plate D-2).

Cut Slopes


- All cut slopes should be inspected by the Geotechnical Engineer to determine the need for stabilization. The Earthwork Contractor should notify the Geotechnical Engineer when slope cutting is in progress at intervals of 10 vertical feet. Failure to notify may result in a delay in recommendations.
- Cut slopes exposing loose, cohesionless sands should be reported to the Geotechnical Engineer for possible stabilization recommendations.
- All stabilization excavations should be cleared of loose slough material prior to geotechnical inspection. Stakes should be provided by the Civil Engineer to verify the location and dimensions of the key. A typical stabilization fill detail is shown on Plate D-5.

- Stabilization key excavations should be provided with subdrains. Typical subdrain details are shown on Plates D-6.


Subdrains

- Subdrains may be required in canyons and swales where fill placement is proposed. Typical subdrain details for canyons are shown on Plate D-3. Subdrains should be installed after approval of removals and before filling, as determined by the Soils Engineer.
- Plastic pipe may be used for subdrains provided it is Schedule 40 or SDR 35 or equivalent. Pipe should be protected against breakage, typically by placement in a square-cut (backhoe) trench or as recommended by the manufacturer.
- Filter material for subdrains should conform to CALTRANS Specification 68-1.025 or as approved by the Geotechnical Engineer for the specific site conditions. Clean $\frac{3}{4}$ -inch crushed rock may be used provided it is wrapped in an acceptable filter cloth and approved by the Geotechnical Engineer. Pipe diameters should be 6 inches for runs up to 500 feet and 8 inches for the downstream continuations of longer runs. Four-inch diameter pipe may be used in buttress and stabilization fills.

CUT LOT

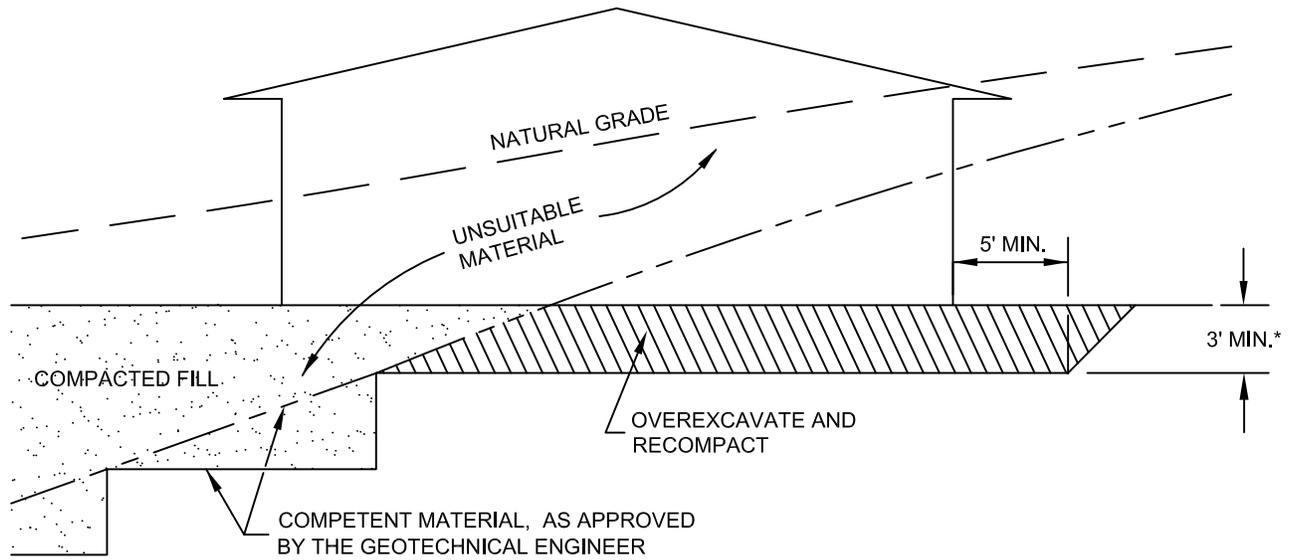


CUT/FILL LOT (TRANSITION)

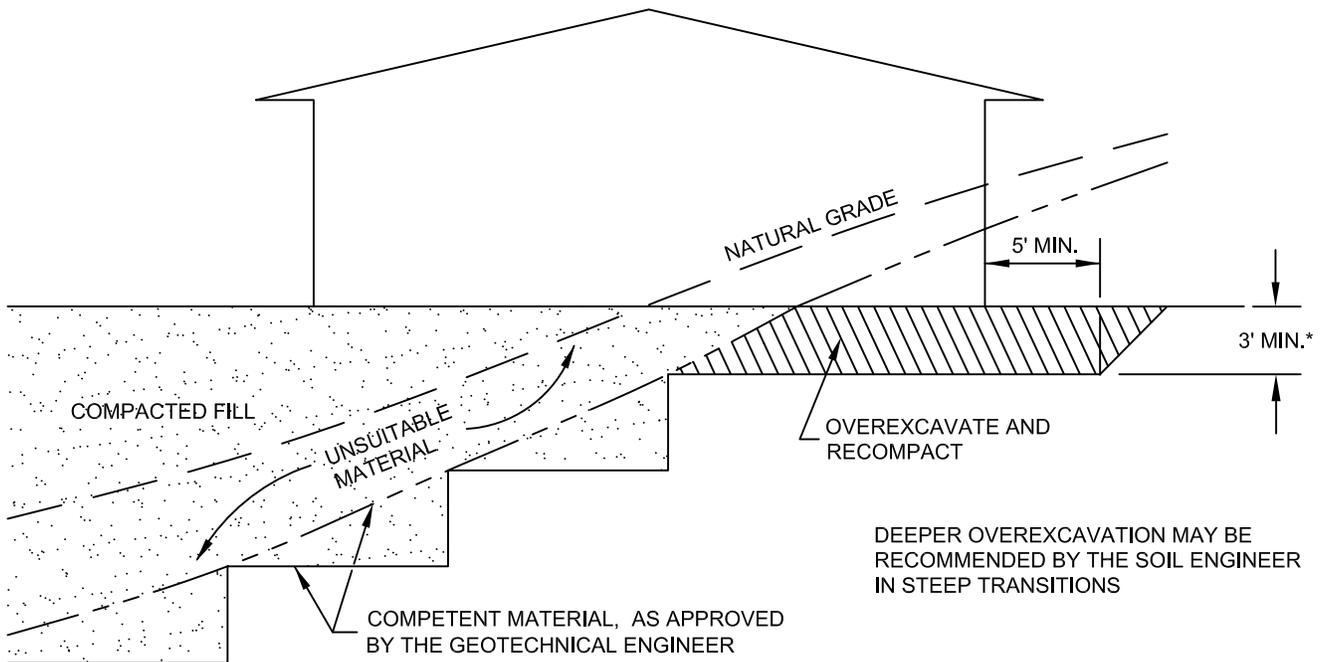

*SEE TEXT OF REPORT FOR SPECIFIC RECOMMENDATION. ACTUAL DEPTH OF OVEREXCAVATION MAY BE GREATER.


TRANSITION LOT DETAIL	
GRADING GUIDE SPECIFICATIONS	
NOT TO SCALE	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAS CHKD: GKM	
PLATE D-1	

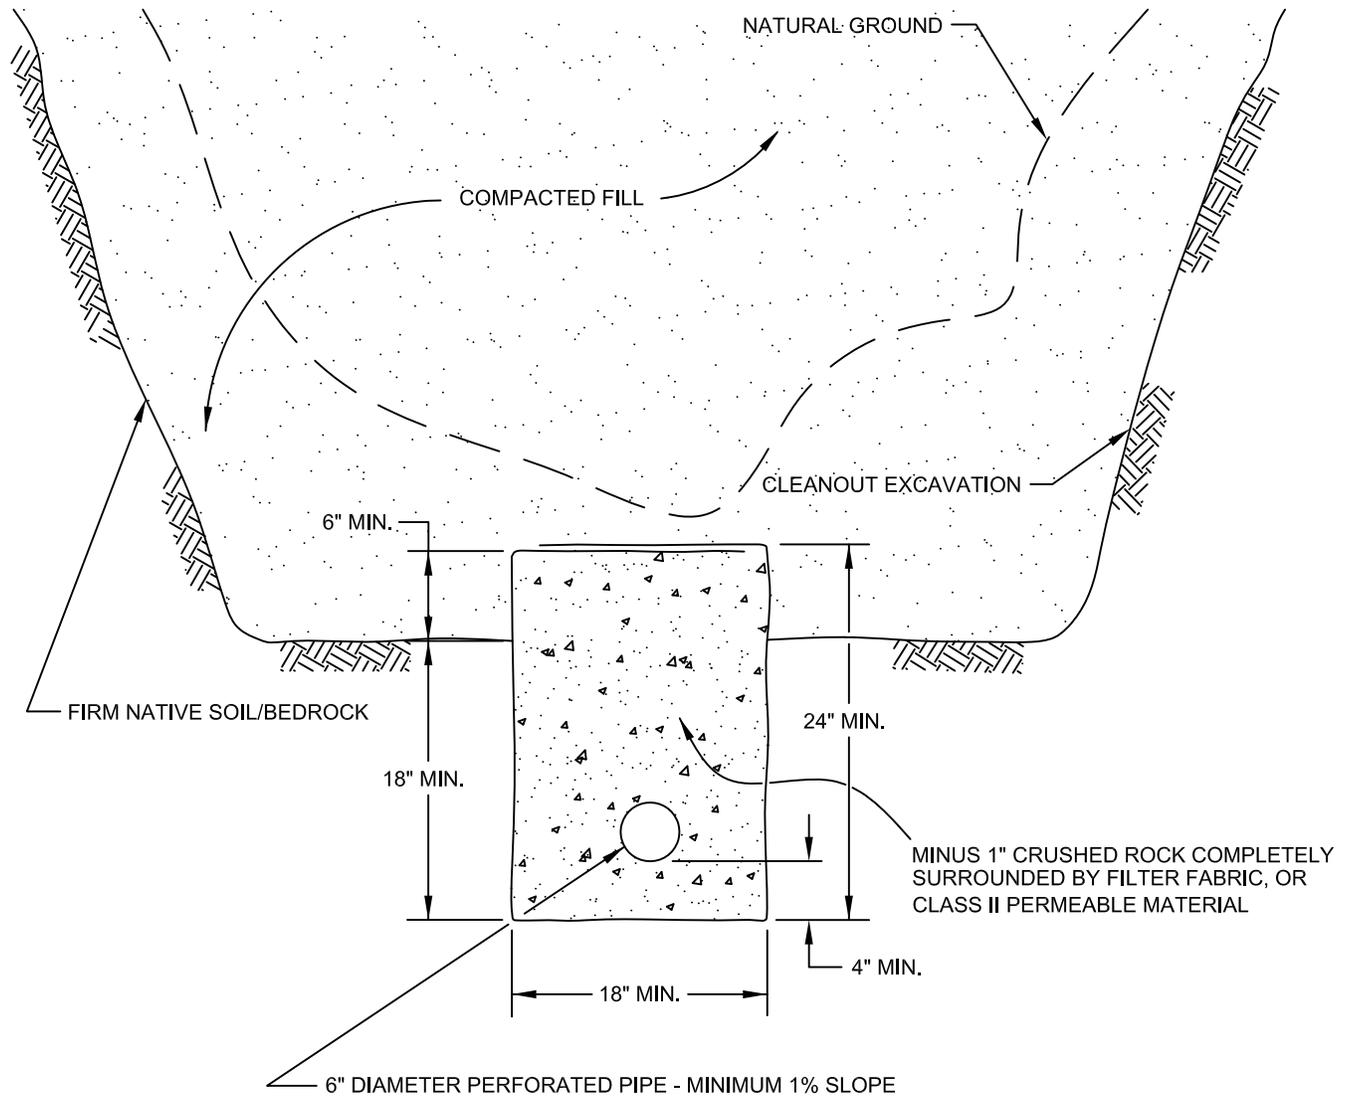

PIPE MATERIAL	DEPTH OF FILL OVER SUBDRAIN
ADS (CORRUGATED POLETHYLENE)	8
TRANSITE UNDERDRAIN	20
PVC OR ABS: SDR 35	35
SDR 21	100

**SCHEMATIC ONLY
NOT TO SCALE**

CANYON SUBDRAIN DETAIL	
GRADING GUIDE SPECIFICATIONS	
NOT TO SCALE	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAS CHKD: GKM	
PLATE D-3	

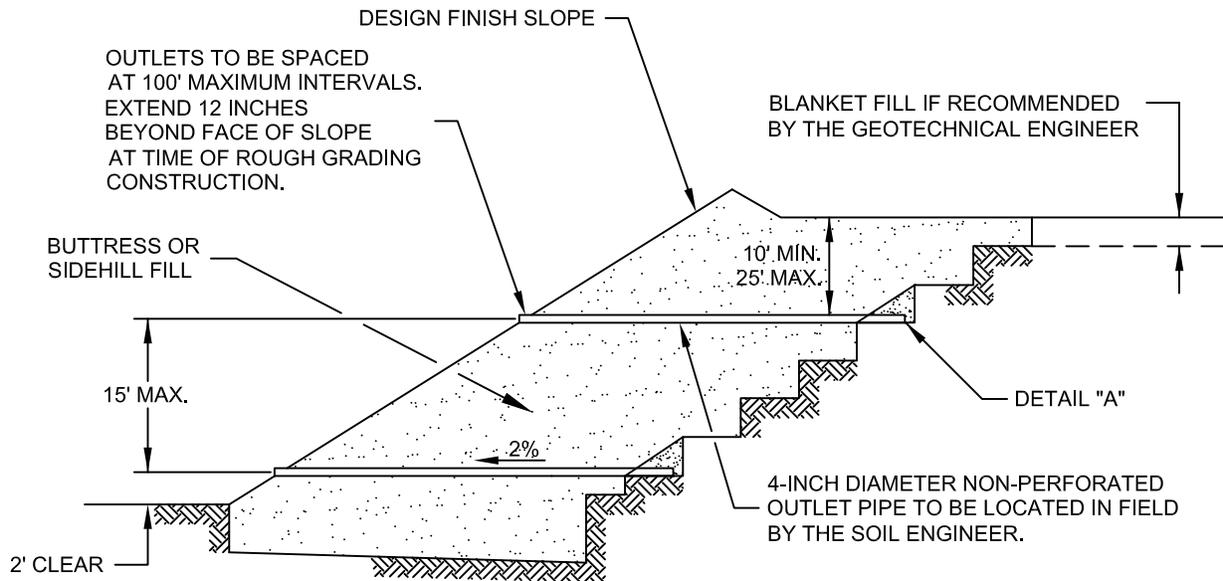


"FILTER MATERIAL" TO MEET FOLLOWING SPECIFICATION OR APPROVED EQUIVALENT: (CONFORMS TO EMA STD. PLAN 323)

SIEVE SIZE	PERCENTAGE PASSING
1"	100
3/4"	90-100
3/8"	40-100
NO. 4	25-40
NO. 8	18-33
NO. 30	5-15
NO. 50	0-7
NO. 200	0-3

"GRAVEL" TO MEET FOLLOWING SPECIFICATION OR APPROVED EQUIVALENT:

SIEVE SIZE	MAXIMUM PERCENTAGE PASSING
1 1/2"	100
NO. 4	50
NO. 200	8
SAND EQUIVALENT = MINIMUM OF 50	

OUTLET PIPE TO BE CONNECTED TO SUBDRAIN PIPE WITH TEE OR ELBOW

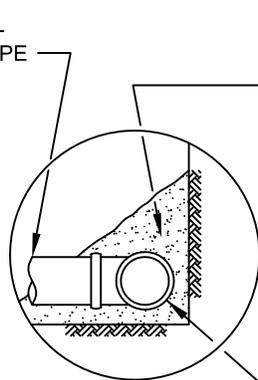

DETAIL "A"

FILTER MATERIAL - MINIMUM OF FIVE CUBIC FEET PER FOOT OF PIPE. SEE ABOVE FOR FILTER MATERIAL SPECIFICATION.

ALTERNATIVE: IN LIEU OF FILTER MATERIAL FIVE CUBIC FEET OF GRAVEL PER FOOT OF PIPE MAY BE ENCASED IN FILTER FABRIC. SEE ABOVE FOR GRAVEL SPECIFICATION.

FILTER FABRIC SHALL BE MIRAFI 140 OR EQUIVALENT. FILTER FABRIC SHALL BE LAPPED A MINIMUM OF 12 INCHES ON ALL JOINTS.

MINIMUM 4-INCH DIAMETER PVC SCH 40 OR ABS CLASS SDR 35 WITH A CRUSHING STRENGTH OF AT LEAST 1,000 POUNDS, WITH A MINIMUM OF 8 UNIFORMLY SPACED PERFORATIONS PER FOOT OF PIPE INSTALLED WITH PERFORATIONS ON BOTTOM OF PIPE. PROVIDE CAP AT UPSTREAM END OF PIPE. SLOPE AT 2 PERCENT TO OUTLET PIPE.

NOTES:

1. TRENCH FOR OUTLET PIPES TO BE BACKFILLED WITH ON-SITE SOIL.

SLOPE FILL SUBDRAINS	
GRADING GUIDE SPECIFICATIONS	
NOT TO SCALE	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAS CHKD: GKM	
PLATE D-6	

MINIMUM ONE FOOT THICK LAYER OF LOW PERMEABILITY SOIL IF NOT COVERED WITH AN IMPERMEABLE SURFACE


MINIMUM ONE FOOT WIDE LAYER OF FREE DRAINING MATERIAL (LESS THAN 5% PASSING THE #200 SIEVE) OR PROPERLY INSTALLED PREFABRICATED DRAINAGE COMPOSITE (MiraDRAIN 6000 OR APPROVED EQUIVALENT).

FILTER MATERIAL - MINIMUM OF TWO CUBIC FEET PER FOOT OF PIPE. SEE BELOW FOR FILTER MATERIAL SPECIFICATION.

ALTERNATIVE: IN LIEU OF FILTER MATERIAL TWO CUBIC FEET OF GRAVEL PER FOOT OF PIPE MAY BE ENCASED IN FILTER FABRIC. SEE BELOW FOR GRAVEL SPECIFICATION.

FILTER FABRIC SHALL BE MIRAFI 140 OR EQUIVALENT. FILTER FABRIC SHALL BE LAPPED A MINIMUM OF 6 INCHES ON ALL JOINTS.

MINIMUM 4-INCH DIAMETER PVC SCH 40 OR ABS CLASS SDR 35 WITH A CRUSHING STRENGTH OF AT LEAST 1,000 POUNDS, WITH A MINIMUM OF 8 UNIFORMLY SPACED PERFORATIONS PER FOOT OF PIPE INSTALLED WITH PERFORATIONS ON BOTTOM OF PIPE. PROVIDE CAP AT UPSTREAM END OF PIPE. SLOPE AT 2 PERCENT TO OUTLET PIPE.

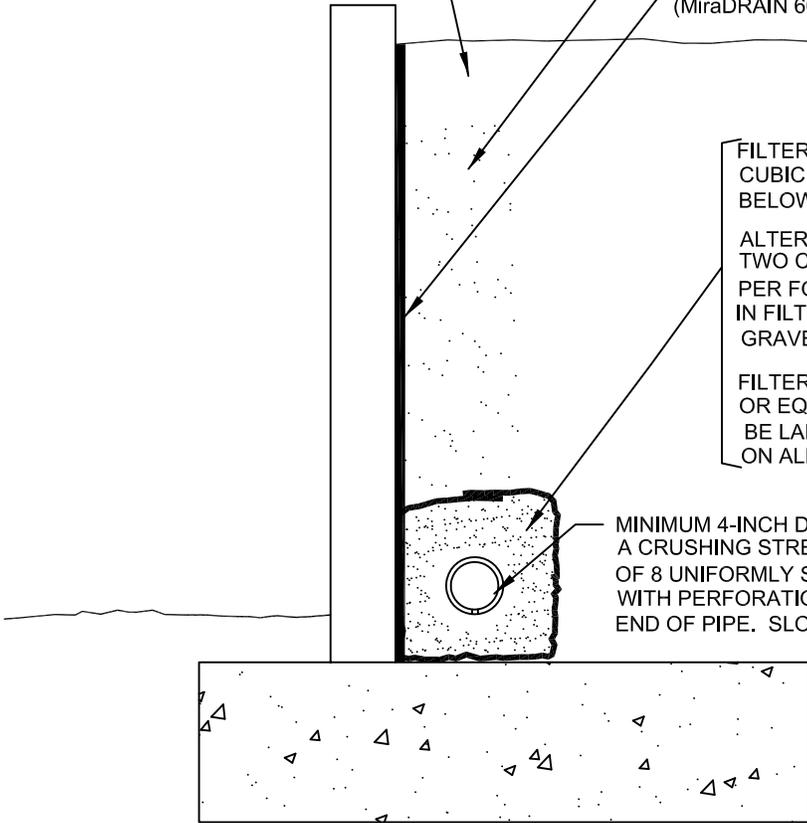



"FILTER MATERIAL" TO MEET FOLLOWING SPECIFICATION OR APPROVED EQUIVALENT: (CONFORMS TO EMA STD. PLAN 323)

SIEVE SIZE	PERCENTAGE PASSING
1"	100
3/4"	90-100
3/8"	40-100
NO. 4	25-40
NO. 8	18-33
NO. 30	5-15
NO. 50	0-7
NO. 200	0-3

"GRAVEL" TO MEET FOLLOWING SPECIFICATION OR APPROVED EQUIVALENT:

SIEVE SIZE	MAXIMUM PERCENTAGE PASSING
1 1/2"	100
NO. 4	50
NO. 200	8
SAND EQUIVALENT = MINIMUM OF 50	

RETAINING WALL BACKDRAINS	
GRADING GUIDE SPECIFICATIONS	
NOT TO SCALE	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAS CHKD: GKM	
PLATE D-7	

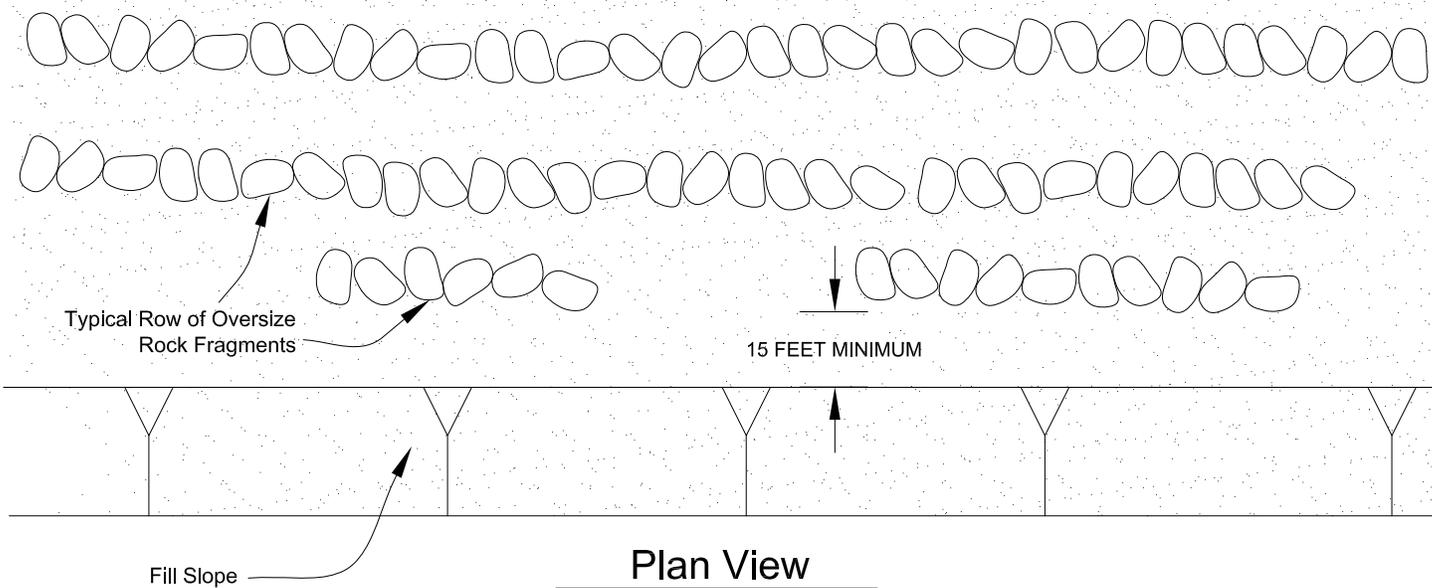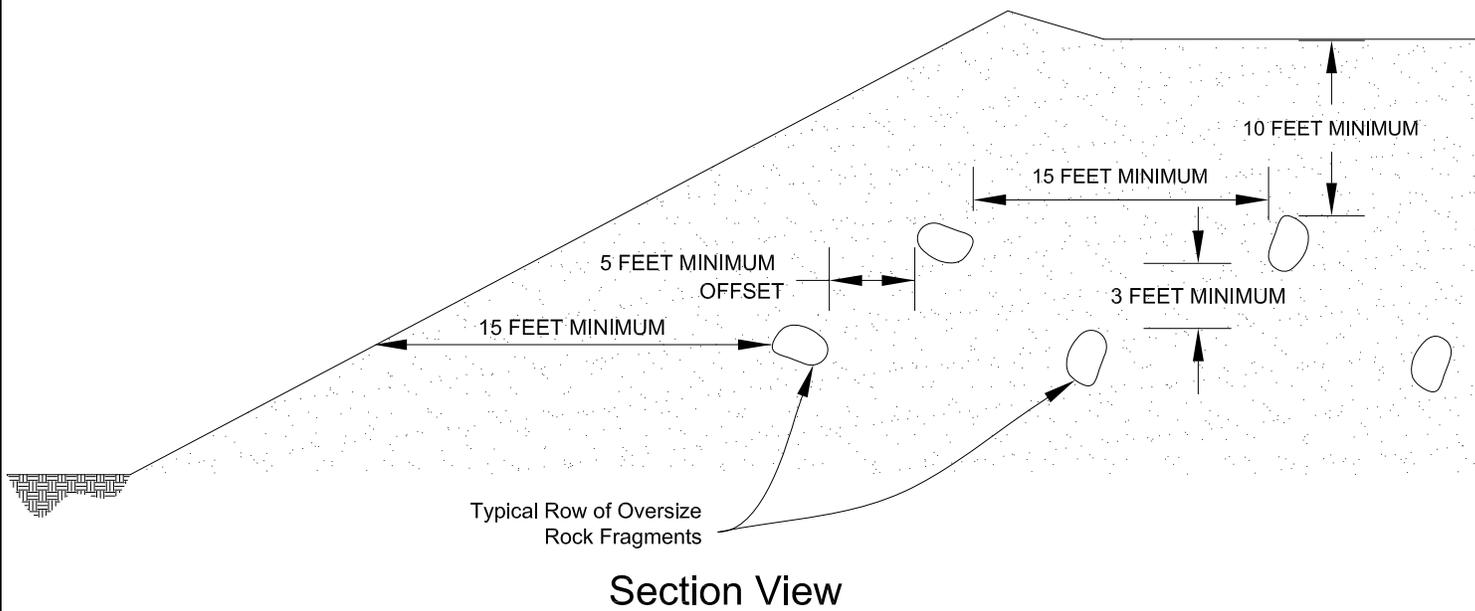

**PLACEMENT OF OVERSIZED MATERIAL
GRADING GUIDE SPECIFICATIONS**

NOT TO SCALE

DRAWN: PM
CHKD: GKM

PLATE D-8



**SOUTHERN
CALIFORNIA
GEOTECHNICAL**

APPENDIX E

Appendix 4: Historical Site Conditions

Phase I Environmental Site Assessment or Other Information on Past Site Use

***N/A**


Appendix 5: LID Infeasibility

LID Technical Infeasibility Analysis

***N/A**

Appendix 6: BMP Design Details

BMP Sizing, Design Details and other Supporting Documentation

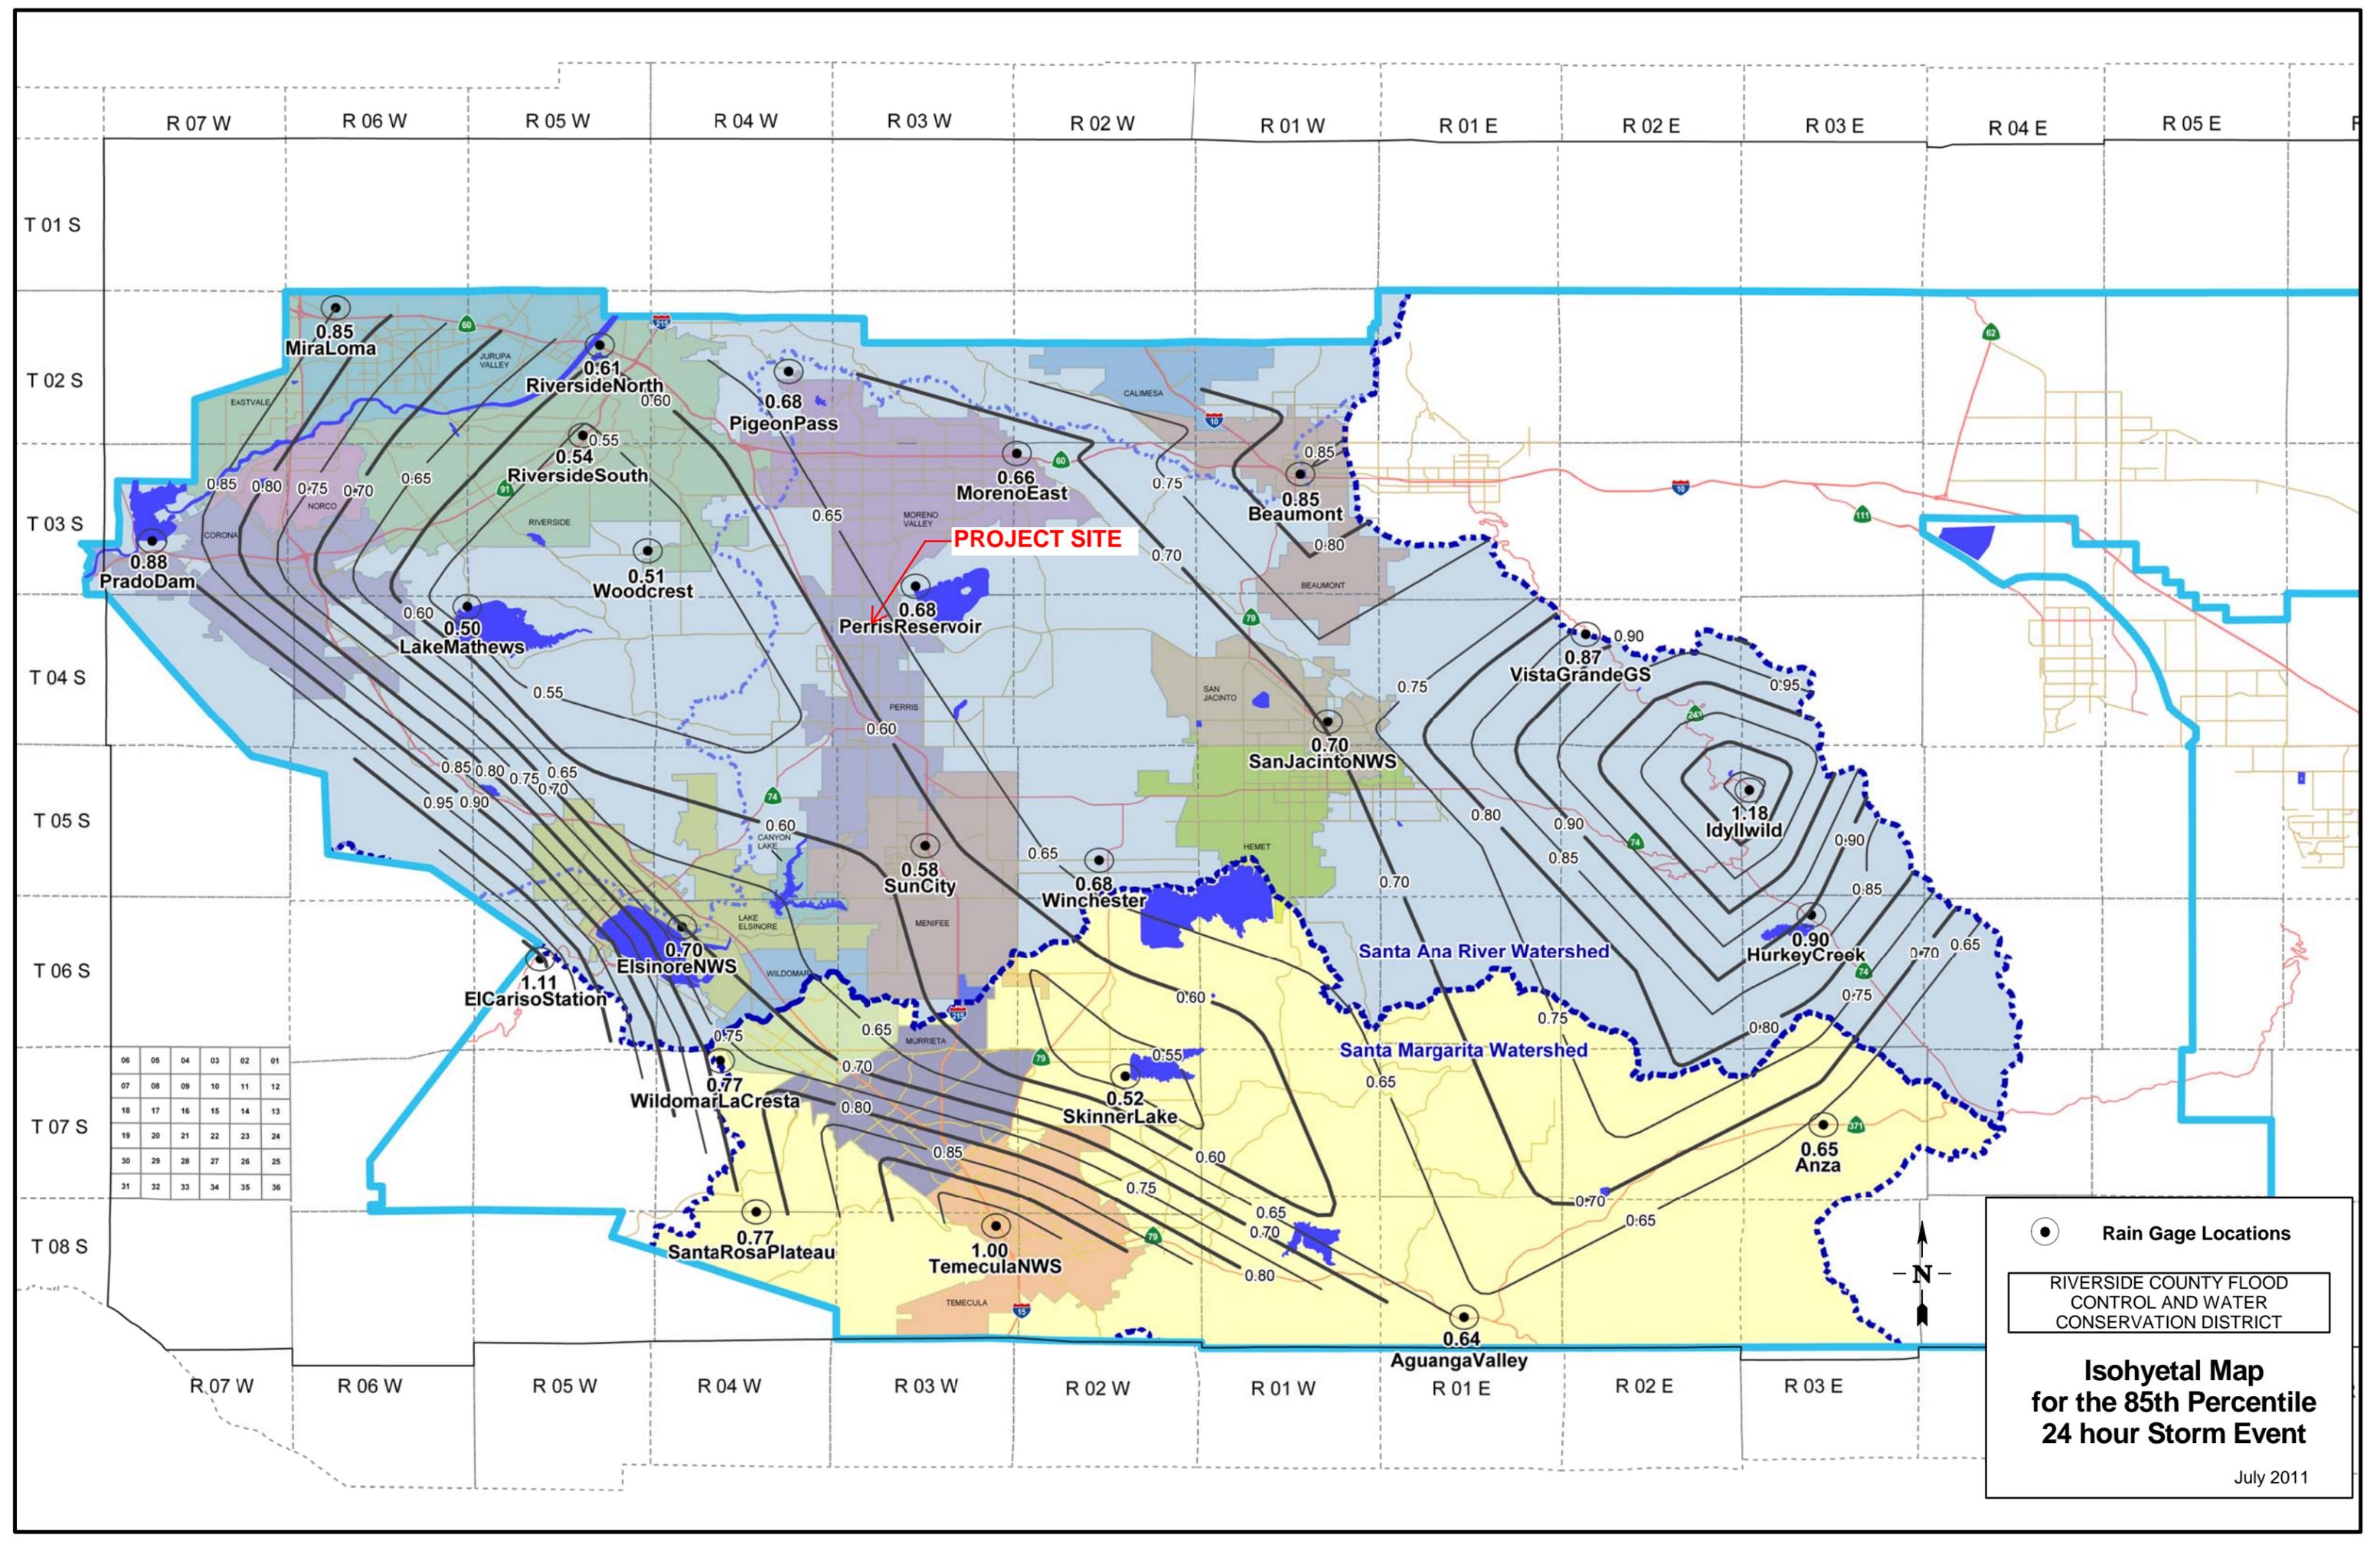

06	05	04	03	02	01
07	08	09	10	11	12
18	17	16	15	14	13
19	20	21	22	23	24
30	29	28	27	26	25
31	32	33	34	35	36

Rain Gage Locations
 RIVERSIDE COUNTY FLOOD CONTROL AND WATER CONSERVATION DISTRICT
Isohyetal Map for the 85th Percentile 24 hour Storm Event
 July 2011

Bioretention Facility - Design Procedure		BMP ID Basin A	Legend:	Required Entries
				Calculated Cells
Company Name:	Albert A. Webb Associates		Date:	8/20/2018
Designed by:	MJS		County/City Case No.:	P18-00002
Design Volume				
Enter the area tributary to this feature			$A_T =$	24.2 acres
Enter V_{BMP} determined from Section 2.1 of this Handbook			$V_{BMP} =$	44,291 ft ³
Type of Bioretention Facility Design				
<input checked="" type="radio"/> Side slopes required (parallel to parking spaces or adjacent to walkways) <input type="radio"/> No side slopes required (perpendicular to parking space or Planter Boxes)				
Bioretention Facility Surface Area				
Depth of Soil Filter Media Layer			$d_S =$	3.0 ft
Top Width of Bioretention Facility, excluding curb			$w_T =$	150.0 ft
Total Effective Depth, d_E $d_E = (0.3) \times d_S + (0.4) \times 1 - (0.7/w_T) + 0.5$			$d_E =$	1.80 ft
Minimum Surface Area, A_m $A_M (ft^2) = \frac{V_{BMP} (ft^3)}{d_E (ft)}$			$A_M =$	24,671 ft ²
Proposed Surface Area			$A =$	24,030 ft ²
ERROR, the proposed surface area must be equal to or greater than the minimum surface area				
Bioretention Facility Properties				
Side Slopes in Bioretention Facility			$z =$	3 :1
ERROR, side slopes too steep for Bioretention Facility design				
Diameter of Underdrain				6 inches
Longitudinal Slope of Site (3% maximum)				0 %
6" Check Dam Spacing				0 feet
Describe Vegetation:			Other	
Notes: EFFECTIVE DEPTH = 3 FT.(0.3) + 1 FT.(0.4) + 0.6 FT. = 1.9 FT.				
REQUIRED BOTTOM AREA = 44,291 FT3 / 1.9 FT. = 23,311 FT2				
Basin slopes are stabilized using ornamental landscape and hydroseeding. See Appendix 2 for Landscape Plan.				

Weir Inlet Ponding Depth Calculation



Designer: MJS

Date: 12/4/2017

Project: Indian & Ramona Distribution Center

Location: Outlet Structure for WQ Basin A


OUTLET STRUCTURE PONDING DEPTH SPPWC 305-3

DISCHARGE (cfs)	45.3
NUMBER OF GRATES	4
LENGTH (ft)	23.146

$$Q = CL(h)^{3/2}$$

WEIR COEFFICIENT	C	3	
WEIR LENGTH	L	23.146	ft ²
HEAD	h	0.75	ft
Flow	Q	45.30	cfs

Top of Weir Elevation: 1452.1
Water Surface Elevation: 1452.9

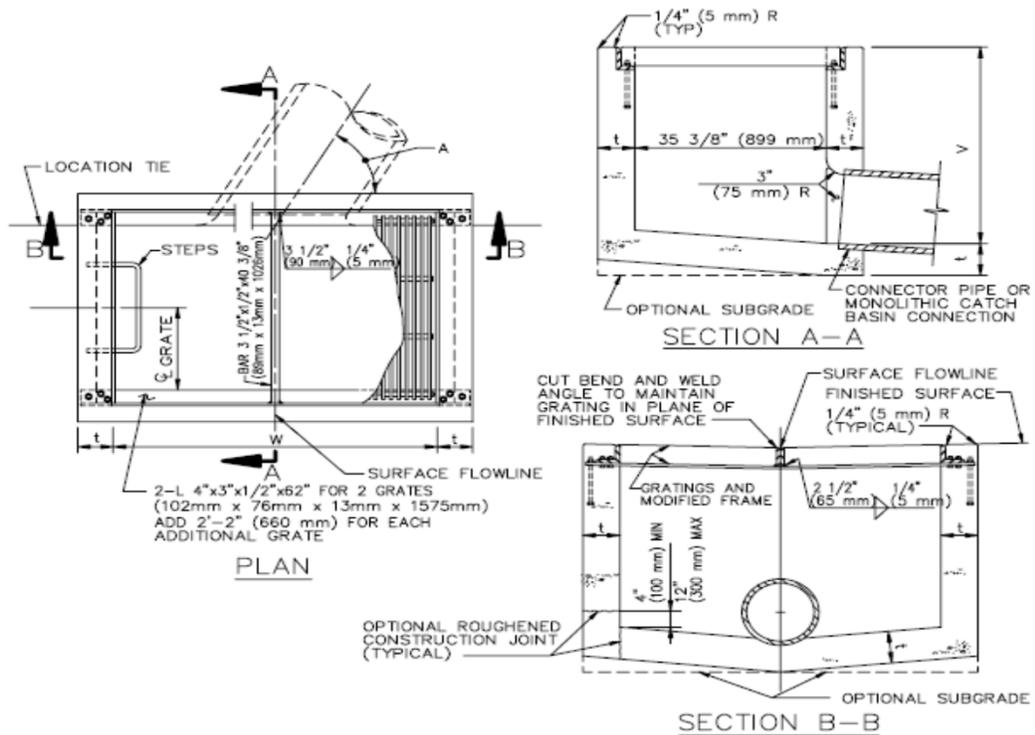

Basin Stage-Storage-Outflow Table
17-0108 Indian & Ramona Distribution Center
Bioretention/Detention Basin

Basin A			Max Pump Rate**		
	Basin Top	1460.5	5 cfs		
	Basin Top of Media	1451.5			
	Basin Bottom	1447.5			
	Basin Bottom Area	24030			

#	Elevation (FT)	Depth (FT)	Total Storage (AC-FT)	Q (CFS)	Qtotal (CFS)
1.00	1,451.50	0.00	0.000	0.00	0.000
2.00	1,452.00	0.50	0.280	0.00	0.000
3.00	1,452.10	0.60	0.337	5.00	5.000
4.00	1,452.50	1.00	0.568	5.00	5.000
5.00	1,453.00	1.50	0.864	5.00	5.000
6.00	1,453.50	2.00	1.169	5.00	5.000
7.00	1,454.00	2.50	1.482	5.00	5.000
8.00	1,454.50	3.00	1.804	5.00	5.000
9.00	1,455.00	3.50	2.134	5.00	5.000
10.00	1,455.50	4.00	2.474	5.00	5.000
11.00	1,456.00	4.50	2.822	5.00	5.000
12.00	1,456.50	5.00	3.184	5.00	5.000
13.00	1,457.50	6.00	3.918	5.00	5.000
14.00	1,458.50	7.00	4.667	5.00	5.000
15.00	1,459.50	8.00	5.429	5.00	5.000
16.00	1,460.50	9.00	6.207	5.00	5.000

*The pump will operate when the volume in the basin exceeds water quality depth of 0.6'. The pump station will discharge a max flow rate of 5 cfs.

**A small amount of flow was assume to leave the basin through the proposed media in the basin and the underdrain system

 17-0108 INDIAN & RAMONA DISTRIBUTION CENTER
 ROUTING CALCULATION
 100-YR 1-HR STORM EVENT
 MJS

Program License Serial Number 4010

***** HYDROGRAPH INFORMATION *****

From study/file name: PROP1100.rte
 *****HYDROGRAPH DATA*****
 Number of intervals = 17
 Time interval = 5.0 (Min.)
 Maximum/Peak flow rate = 65.076 (CFS)
 Total volume = 2.369 (Ac.Ft)
 Status of hydrographs being held in storage
 Stream 1 Stream 2 Stream 3 Stream 4 Stream 5
 Peak (CFS) 0.000 0.000 0.000 0.000 0.000
 Vol (Ac.Ft) 0.000 0.000 0.000 0.000 0.000

+++++
 Process from Point/Station 100.000 to Point/Station 101.000
 **** RETARDING BASIN ROUTING ****

 User entry of depth-outflow-storage data

Total number of inflow hydrograph intervals = 17
 Hydrograph time unit = 5.000 (Min.)
 Initial depth in storage basin = 0.00(Ft.)

Initial basin depth = 0.00 (Ft.)
 Initial basin storage = 0.00 (Ac.Ft)
 Initial basin outflow = 0.00 (CFS)

Depth vs. Storage and Depth vs. Discharge data:

Basin Depth (Ft.)	Storage (Ac.Ft)	Outflow (CFS)	(S-0*dt/2) (Ac.Ft)	(S+0*dt/2) (Ac.Ft)
0.000	0.000	0.000	0.000	0.000
0.500	0.280	0.000	0.280	0.280
0.600	0.337	5.000	0.320	0.354
1.000	0.568	5.000	0.551	0.585
1.500	0.864	5.000	0.847	0.881
2.000	1.169	5.000	1.152	1.186
2.500	1.482	5.000	1.465	1.499
3.000	1.804	5.000	1.787	1.821
3.500	2.134	5.000	2.117	2.151
4.000	2.474	5.000	2.457	2.491
4.500	2.822	5.000	2.805	2.839
5.000	3.184	5.000	3.167	3.201
6.000	3.918	5.000	3.901	3.935
7.000	4.667	5.000	4.650	4.684
8.000	5.429	5.000	5.412	5.446
9.000	6.207	5.000	6.190	6.224

 Hydrograph Detention Basin Routing

Graph values: 'I'= unit inflow; 'O'=outflow at time shown

Time (Hours)	Inflow (CFS)	Outflow (CFS)	Storage (Ac.Ft)						Depth (Ft.)
0.083	3.97	0.00	0.014	OI		16.3	32.54	48.81	65.08
0.167	10.58	0.00	0.064	O	I				
0.250	13.15	0.00	0.146	O	I				
0.333	15.16	0.00	0.243	O	I				
0.417	16.74	4.91	0.336	O	I				
0.500	19.34	5.00	0.426	O	I				
0.583	21.98	5.00	0.534	O	I				
0.667	25.37	5.00	0.663	O	I				

ROUTE1100.out

0.750	32.08	5.00	0.826	O					1.44
0.833	57.48	5.00	1.100	O		I			1.89
0.917	65.08	5.00	1.488	O			I		2.51
1.000	32.35	5.00	1.789	O		I			2.98
1.083	18.25	5.00	1.928	O	I				3.19
1.167	7.24	5.00	1.982	O	IO				3.27
1.250	3.82	5.00	1.985	IO					3.27
1.333	0.98	5.00	1.968	IO					3.25
1.417	0.36	5.00	1.938	IO					3.20
1.500	0.00	5.00	1.904	IO					3.15
1.583	0.00	5.00	1.870	IO					3.10
1.667	0.00	5.00	1.836	IO					3.05
1.750	0.00	5.00	1.801	IO					3.00
1.833	0.00	5.00	1.767	IO					2.94
1.917	0.00	5.00	1.732	IO					2.89
2.000	0.00	5.00	1.698	IO					2.84
2.083	0.00	5.00	1.663	IO					2.78
2.167	0.00	5.00	1.629	IO					2.73
2.250	0.00	5.00	1.595	IO					2.67
2.333	0.00	5.00	1.560	IO					2.62
2.417	0.00	5.00	1.526	IO					2.57
2.500	0.00	5.00	1.491	IO					2.51
2.583	0.00	5.00	1.457	IO					2.46
2.667	0.00	5.00	1.422	IO					2.40
2.750	0.00	5.00	1.388	IO					2.35
2.833	0.00	5.00	1.354	IO					2.29
2.917	0.00	5.00	1.319	IO					2.24
3.000	0.00	5.00	1.285	IO					2.18
3.083	0.00	5.00	1.250	IO					2.13
3.167	0.00	5.00	1.216	IO					2.07
3.250	0.00	5.00	1.181	IO					2.02
3.333	0.00	5.00	1.147	IO					1.96
3.417	0.00	5.00	1.112	IO					1.91
3.500	0.00	5.00	1.078	IO					1.85
3.583	0.00	5.00	1.044	IO					1.79
3.667	0.00	5.00	1.009	IO					1.74
3.750	0.00	5.00	0.975	IO					1.68
3.833	0.00	5.00	0.940	IO					1.63
3.917	0.00	5.00	0.906	IO					1.57
4.000	0.00	5.00	0.871	IO					1.51
4.083	0.00	5.00	0.837	IO					1.45
4.167	0.00	5.00	0.803	IO					1.40
4.250	0.00	5.00	0.768	IO					1.34
4.333	0.00	5.00	0.734	IO					1.28
4.417	0.00	5.00	0.699	IO					1.22
4.500	0.00	5.00	0.665	IO					1.16
4.583	0.00	5.00	0.630	IO					1.11
4.667	0.00	5.00	0.596	IO					1.05
4.750	0.00	5.00	0.562	IO					0.99
4.833	0.00	5.00	0.527	IO					0.93
4.917	0.00	5.00	0.493	IO					0.87
5.000	0.00	5.00	0.458	IO					0.81
5.083	0.00	5.00	0.424	IO					0.75
5.167	0.00	5.00	0.389	IO					0.69
5.250	0.00	5.00	0.355	IO					0.63
5.333	0.00	3.89	0.324	IO					0.58
5.417	0.00	2.08	0.304	IO					0.54
5.500	0.00	1.12	0.293	O					0.52
5.583	0.00	0.60	0.287	O					0.51
5.667	0.00	0.32	0.284	O					0.51
5.750	0.00	0.17	0.282	O					0.50
5.833	0.00	0.09	0.281	O					0.50
5.917	0.00	0.05	0.281	O					0.50
6.000	0.00	0.03	0.280	O					0.50
6.083	0.00	0.01	0.280	O					0.50
6.167	0.00	0.01	0.280	O					0.50
6.250	0.00	0.00	0.280	O					0.50
6.333	0.00	0.00	0.280	O					0.50
6.417	0.00	0.00	0.280	O					0.50
6.500	0.00	0.00	0.280	O					0.50

Remaining water in basin = 0.28 (Ac.Ft)

*****HYDROGRAPH DATA*****

Number of intervals = 78
 Time interval = 5.0 (Min.)
 Maximum/Peak flow rate = 5,000 (CFS)
 Total volume = 2.089 (Ac.Ft)
 Status of hydrographs being held in storage
 Stream 1 Stream 2 Stream 3 Stream 4 Stream 5
 Peak (CFS) 0.000 0.000 0.000 0.000 0.000
 Vol (Ac.Ft) 0.000 0.000 0.000 0.000 0.000

 17-0108 INDIAN & RAMONA DISTRIBUTION CENTER
 ROUTING CALCULATION
 100-YR 3-HR STORM EVENT
 MJS

Program License Serial Number 4010

***** HYDROGRAPH INFORMATION *****

From study/file name: PROP3100.rte
 *****HYDROGRAPH DATA*****
 Number of intervals = 41
 Time interval = 5.0 (Min.)
 Maximum/Peak flow rate = 38.022 (CFS)
 Total volume = 3.410 (Ac.Ft)
 Status of hydrographs being held in storage
 Stream 1 Stream 2 Stream 3 Stream 4 Stream 5
 Peak (CFS) 0.000 0.000 0.000 0.000 0.000
 Vol (Ac.Ft) 0.000 0.000 0.000 0.000 0.000

+++++
 Process from Point/Station 100.000 to Point/Station 101.000
 **** RETARDING BASIN ROUTING ****

 User entry of depth-outflow-storage data

Total number of inflow hydrograph intervals = 41
 Hydrograph time unit = 5.000 (Min.)
 Initial depth in storage basin = 0.00(Ft.)

Initial basin depth = 0.00 (Ft.)
 Initial basin storage = 0.00 (Ac.Ft)
 Initial basin outflow = 0.00 (CFS)

Depth vs. Storage and Depth vs. Discharge data:

Basin Depth (Ft.)	Storage (Ac.Ft)	Outflow (CFS)	(S-0*dt/2) (Ac.Ft)	(S+0*dt/2) (Ac.Ft)
0.000	0.000	0.000	0.000	0.000
0.500	0.280	0.000	0.280	0.280
0.600	0.337	5.000	0.320	0.354
1.000	0.568	5.000	0.551	0.585
1.500	0.864	5.000	0.847	0.881
2.000	1.169	5.000	1.152	1.186
2.500	1.482	5.000	1.465	1.499
3.000	1.804	5.000	1.787	1.821
3.500	2.134	5.000	2.117	2.151
4.000	2.474	5.000	2.457	2.491
4.500	2.822	5.000	2.805	2.839
5.000	3.184	5.000	3.167	3.201
6.000	3.918	5.000	3.901	3.935
7.000	4.667	5.000	4.650	4.684
8.000	5.429	5.000	5.412	5.446
9.000	6.207	5.000	6.190	6.224

 Hydrograph Detention Basin Routing

Graph values: 'I'= unit inflow; 'O'=outflow at time shown

Time (Hours)	Inflow (CFS)	Outflow (CFS)	Storage (Ac.Ft)						Depth (Ft.)
0.083	1.74	0.00	0.006	O	I				0.01
0.167	4.59	0.00	0.028	O	I				0.05
0.250	5.04	0.00	0.061	O	I				0.11
0.333	5.46	0.00	0.097	O	I				0.17
0.417	6.40	0.00	0.138	O	I				0.25
0.500	7.10	0.00	0.184	O	I				0.33
0.583	7.43	0.00	0.234	O	I				0.42
0.667	7.37	0.36	0.284	O	I				0.51

ROUTE3100.out					
8.083	0.00	5.00	0.368	I 0	0.65
8.167	0.00	4.77	0.334	I 0	0.60
8.250	0.00	2.56	0.309	I 0	0.55
8.333	0.00	1.37	0.296	IO	0.53
8.417	0.00	0.74	0.288	O	0.51
8.500	0.00	0.39	0.284	O	0.51
8.583	0.00	0.21	0.282	O	0.50
8.667	0.00	0.11	0.281	O	0.50
8.750	0.00	0.06	0.281	O	0.50
8.833	0.00	0.03	0.280	O	0.50
8.917	0.00	0.02	0.280	O	0.50
9.000	0.00	0.01	0.280	O	0.50
9.083	0.00	0.01	0.280	O	0.50
9.167	0.00	0.00	0.280	O	0.50
9.250	0.00	0.00	0.280	O	0.50
9.333	0.00	0.00	0.280	O	0.50

Remaining water in basin = 0.28 (Ac.Ft)

```

*****HYDROGRAPH DATA*****
      Number of intervals = 112
      Time interval = 5.0 (Min.)
      Maximum/Peak flow rate = 5.000 (CFS)
      Total volume = 3.130 (Ac.Ft)
      Status of hydrographs being held in storage
      Stream 1 Stream 2 Stream 3 Stream 4 Stream 5
      Peak (CFS) 0.000 0.000 0.000 0.000 0.000
      Vol (Ac.Ft) 0.000 0.000 0.000 0.000 0.000
*****

```

 17-0108 INDIAN & RAMONA DISTRIBUTION CENTER
 ROUTING CALCULATION
 100-YR 6-HR STORM EVENT
 MJS

Program License Serial Number 4010

***** HYDROGRAPH INFORMATION *****

From study/file name: PROP6100.rte
 *****HYDROGRAPH DATA*****
 Number of intervals = 77
 Time interval = 5.0 (Min.)
 Maximum/Peak flow rate = 33.255 (CFS)
 Total volume = 4.381 (Ac.Ft)
 Status of hydrographs being held in storage
 Stream 1 Stream 2 Stream 3 Stream 4 Stream 5
 Peak (CFS) 0.000 0.000 0.000 0.000 0.000
 Vol (Ac.Ft) 0.000 0.000 0.000 0.000 0.000

+++++
 Process from Point/Station 100.000 to Point/Station 101.000
 **** RETARDING BASIN ROUTING ****

 User entry of depth-outflow-storage data

Total number of inflow hydrograph intervals = 77
 Hydrograph time unit = 5.000 (Min.)
 Initial depth in storage basin = 0.00(Ft.)

Initial basin depth = 0.00 (Ft.)
 Initial basin storage = 0.00 (Ac.Ft)
 Initial basin outflow = 0.00 (CFS)

Depth vs. Storage and Depth vs. Discharge data:

Basin Depth (Ft.)	Storage (Ac.Ft)	Outflow (CFS)	(S-0*dt/2) (Ac.Ft)	(S+0*dt/2) (Ac.Ft)
0.000	0.000	0.000	0.000	0.000
0.500	0.280	0.000	0.280	0.280
0.600	0.337	5.000	0.320	0.354
1.000	0.568	5.000	0.551	0.585
1.500	0.864	5.000	0.847	0.881
2.000	1.169	5.000	1.152	1.186
2.500	1.482	5.000	1.465	1.499
3.000	1.804	5.000	1.787	1.821
3.500	2.134	5.000	2.117	2.151
4.000	2.474	5.000	2.457	2.491
4.500	2.822	5.000	2.805	2.839
5.000	3.184	5.000	3.167	3.201
6.000	3.918	5.000	3.901	3.935
7.000	4.667	5.000	4.650	4.684
8.000	5.429	5.000	5.412	5.446
9.000	6.207	5.000	6.190	6.224

 Hydrograph Detention Basin Routing

Graph values: 'I'= unit inflow; 'O'=outflow at time shown

Time (Hours)	Inflow (CFS)	Outflow (CFS)	Storage (Ac.Ft)	Depth (Ft.)
0.083	0.88	0.00	0.003	0.01
0.167	2.50	0.00	0.015	0.03
0.250	3.15	0.00	0.034	0.06
0.333	3.39	0.00	0.057	0.10
0.417	3.51	0.00	0.080	0.14
0.500	3.76	0.00	0.105	0.19
0.583	4.07	0.00	0.132	0.24
0.667	4.14	0.00	0.161	0.29

ROUTE6100.out

8.083	0.00	5.00	1.532	I	0	2.58
8.167	0.00	5.00	1.498	I	0	2.52
8.250	0.00	5.00	1.464	I	0	2.47
8.333	0.00	5.00	1.429	I	0	2.42
8.417	0.00	5.00	1.395	I	0	2.36
8.500	0.00	5.00	1.360	I	0	2.31
8.583	0.00	5.00	1.326	I	0	2.25
8.667	0.00	5.00	1.291	I	0	2.20
8.750	0.00	5.00	1.257	I	0	2.14
8.833	0.00	5.00	1.222	I	0	2.09
8.917	0.00	5.00	1.188	I	0	2.03
9.000	0.00	5.00	1.154	I	0	1.97
9.083	0.00	5.00	1.119	I	0	1.92
9.167	0.00	5.00	1.085	I	0	1.86
9.250	0.00	5.00	1.050	I	0	1.81
9.333	0.00	5.00	1.016	I	0	1.75
9.417	0.00	5.00	0.981	I	0	1.69
9.500	0.00	5.00	0.947	I	0	1.64
9.583	0.00	5.00	0.913	I	0	1.58
9.667	0.00	5.00	0.878	I	0	1.52
9.750	0.00	5.00	0.844	I	0	1.47
9.833	0.00	5.00	0.809	I	0	1.41
9.917	0.00	5.00	0.775	I	0	1.35
10.000	0.00	5.00	0.740	I	0	1.29
10.083	0.00	5.00	0.706	I	0	1.23
10.167	0.00	5.00	0.672	I	0	1.17
10.250	0.00	5.00	0.637	I	0	1.12
10.333	0.00	5.00	0.603	I	0	1.06
10.417	0.00	5.00	0.568	I	0	1.00
10.500	0.00	5.00	0.534	I	0	0.94
10.583	0.00	5.00	0.499	I	0	0.88
10.667	0.00	5.00	0.465	I	0	0.82
10.750	0.00	5.00	0.430	I	0	0.76
10.833	0.00	5.00	0.396	I	0	0.70
10.917	0.00	5.00	0.362	I	0	0.64
11.000	0.00	4.34	0.329	I	0	0.59
11.083	0.00	2.33	0.307	I	0	0.55
11.167	0.00	1.25	0.294	IO		0.52
11.250	0.00	0.67	0.288	O		0.51
11.333	0.00	0.36	0.284	O		0.51
11.417	0.00	0.19	0.282	O		0.50
11.500	0.00	0.10	0.281	O		0.50
11.583	0.00	0.06	0.281	O		0.50
11.667	0.00	0.03	0.280	O		0.50
11.750	0.00	0.02	0.280	O		0.50
11.833	0.00	0.01	0.280	O		0.50
11.917	0.00	0.00	0.280	O		0.50
12.000	0.00	0.00	0.280	O		0.50
12.083	0.00	0.00	0.280	O		0.50
12.167	0.00	0.00	0.280	O		0.50

Remaining water in basin = 0.28 (Ac.Ft)

*****HYDROGRAPH DATA*****

Number of intervals = 146
 Time interval = 5.0 (Min.)
 Maximum/Peak flow rate = 5.000 (CFS)
 Total volume = 4.101 (Ac.Ft)
 Status of hydrographs being held in storage
 Stream 1 Stream 2 Stream 3 Stream 4 Stream 5
 Peak (CFS) 0.000 0.000 0.000 0.000 0.000
 Vol (Ac.Ft) 0.000 0.000 0.000 0.000 0.000

 17-0108 INDIAN & RAMONA DISTRIBUTION CENTER
 ROUTING CALCULATION
 100-YR 24-HR STORM EVENT
 MJS

Program License Serial Number 4010

***** HYDROGRAPH INFORMATION *****

From study/file name: PROP24100.rte
 *****HYDROGRAPH DATA*****
 Number of intervals = 293
 Time interval = 5.0 (Min.)
 Maximum/Peak flow rate = 13.354 (CFS)
 Total volume = 7.609 (Ac.Ft)
 Status of hydrographs being held in storage
 Stream 1 Stream 2 Stream 3 Stream 4 Stream 5
 Peak (CFS) 0.000 0.000 0.000 0.000 0.000
 Vol (Ac.Ft) 0.000 0.000 0.000 0.000 0.000

+++++
 Process from Point/Station 100.000 to Point/Station 101.000
 **** RETARDING BASIN ROUTING ****

 User entry of depth-outflow-storage data

Total number of inflow hydrograph intervals = 293
 Hydrograph time unit = 5.000 (Min.)
 Initial depth in storage basin = 0.00(Ft.)

Initial basin depth = 0.00 (Ft.)
 Initial basin storage = 0.00 (Ac.Ft)
 Initial basin outflow = 0.00 (CFS)

Depth vs. Storage and Depth vs. Discharge data:

Basin Depth (Ft.)	Storage (Ac.Ft)	Outflow (CFS)	(S-0*dt/2) (Ac.Ft)	(S+0*dt/2) (Ac.Ft)
0.000	0.000	0.000	0.000	0.000
0.500	0.280	0.000	0.280	0.280
0.600	0.337	5.000	0.320	0.354
1.000	0.568	5.000	0.551	0.585
1.500	0.864	5.000	0.847	0.881
2.000	1.169	5.000	1.152	1.186
2.500	1.482	5.000	1.465	1.499
3.000	1.804	5.000	1.787	1.821
3.500	2.134	5.000	2.117	2.151
4.000	2.474	5.000	2.457	2.491
4.500	2.822	5.000	2.805	2.839
5.000	3.184	5.000	3.167	3.201
6.000	3.918	5.000	3.901	3.935
7.000	4.667	5.000	4.650	4.684
8.000	5.429	5.000	5.412	5.446
9.000	6.207	5.000	6.190	6.224

 Hydrograph Detention Basin Routing

Graph values: 'I'= unit inflow; 'O'=outflow at time shown

Time (Hours)	Inflow (CFS)	Outflow (CFS)	Storage (Ac.Ft)	0	3.3	6.68	10.02	13.35	Depth (Ft.)
0.083	0.21	0.00	0.001	O					0.00
0.167	0.56	0.00	0.003	O I					0.01
0.250	0.64	0.00	0.008	O I					0.01
0.333	0.79	0.00	0.012	O I					0.02
0.417	0.98	0.00	0.019	O I					0.03
0.500	1.04	0.00	0.026	O I					0.05
0.583	1.06	0.00	0.033	O I					0.06
0.667	1.07	0.00	0.040	O I					0.07

0.750	1.08	0.00	0.048	O I		0.08
0.833	1.19	0.00	0.055	O I		0.10
0.917	1.36	0.00	0.064	O I		0.11
1.000	1.40	0.00	0.074	O I		0.13
1.083	1.32	0.00	0.083	O I		0.15
1.167	1.15	0.00	0.092	O I		0.16
1.250	1.12	0.00	0.099	O I		0.18
1.333	1.10	0.00	0.107	O I		0.19
1.417	1.09	0.00	0.114	O I		0.20
1.500	1.08	0.00	0.122	O I		0.22
1.583	1.08	0.00	0.129	O I		0.23
1.667	1.08	0.00	0.137	O I		0.24
1.750	1.08	0.00	0.144	O I		0.26
1.833	1.19	0.00	0.152	O I		0.27
1.917	1.36	0.00	0.161	O I		0.29
2.000	1.40	0.00	0.170	O I		0.30
2.083	1.42	0.00	0.180	O I		0.32
2.167	1.43	0.00	0.190	O I		0.34
2.250	1.44	0.00	0.200	O I		0.36
2.333	1.44	0.00	0.210	O I		0.37
2.417	1.44	0.00	0.220	O I		0.39
2.500	1.44	0.00	0.230	O I		0.41
2.583	1.55	0.00	0.240	O I		0.43
2.667	1.72	0.00	0.251	O I		0.45
2.750	1.76	0.00	0.263	O I		0.47
2.833	1.78	0.00	0.275	O I		0.49
2.917	1.79	0.51	0.286	O I		0.51
3.000	1.80	1.11	0.293	O I		0.52
3.083	1.80	1.43	0.296	O I		0.53
3.167	1.80	1.60	0.298	O I		0.53
3.250	1.80	1.69	0.299	O		0.53
3.333	1.80	1.74	0.300	O		0.53
3.417	1.80	1.77	0.300	O		0.54
3.500	1.80	1.78	0.300	O		0.54
3.583	1.80	1.79	0.300	O		0.54
3.667	1.80	1.80	0.300	O		0.54
3.750	1.80	1.80	0.300	O		0.54
3.833	1.91	1.82	0.301	O		0.54
3.917	2.08	1.90	0.302	O		0.54
4.000	2.12	1.99	0.303	O I		0.54
4.083	2.14	2.06	0.303	O I		0.54
4.167	2.15	2.10	0.304	O		0.54
4.250	2.16	2.13	0.304	O		0.54
4.333	2.27	2.17	0.305	O		0.54
4.417	2.44	2.25	0.306	O		0.55
4.500	2.48	2.35	0.307	O		0.55
4.583	2.50	2.42	0.308	O		0.55
4.667	2.51	2.46	0.308	O I		0.55
4.750	2.52	2.49	0.308	O I		0.55
4.833	2.63	2.53	0.309	O		0.55
4.917	2.80	2.61	0.310	O		0.55
5.000	2.84	2.71	0.311	O		0.55
5.083	2.65	2.73	0.311	O		0.55
5.167	2.32	2.61	0.310	O I		0.55
5.250	2.24	2.46	0.308	O		0.55
5.333	2.30	2.37	0.307	O		0.55
5.417	2.46	2.37	0.307	O		0.55
5.500	2.48	2.42	0.308	O		0.55
5.583	2.61	2.48	0.308	O I		0.55
5.667	2.79	2.58	0.309	O		0.55
5.750	2.84	2.69	0.311	O		0.55
5.833	2.86	2.77	0.312	O		0.56
5.917	2.87	2.81	0.312	O		0.56
6.000	2.88	2.84	0.312	O		0.56
6.083	2.99	2.89	0.313	O I		0.56
6.167	3.16	2.97	0.314	O		0.56
6.250	3.20	3.07	0.315	O		0.56
6.333	3.22	3.14	0.316	O		0.56
6.417	3.23	3.18	0.316	O		0.56
6.500	3.24	3.21	0.317	O		0.56
6.583	3.35	3.25	0.317	O I		0.56
6.667	3.52	3.33	0.318	O I		0.57
6.750	3.56	3.43	0.319	O		0.57
6.833	3.58	3.50	0.320	O		0.57
6.917	3.59	3.54	0.320	O		0.57
7.000	3.60	3.57	0.321	O		0.57
7.083	3.60	3.58	0.321	O		0.57
7.167	3.60	3.59	0.321	O		0.57
7.250	3.60	3.60	0.321	O		0.57
7.333	3.71	3.62	0.321	O		0.57
7.417	3.88	3.70	0.322	O I		0.57
7.500	3.92	3.79	0.323	O		0.58
7.583	4.05	3.88	0.324	O		0.58
7.667	4.23	4.00	0.326	O I		0.58
7.750	4.28	4.12	0.327	O I		0.58
7.833	4.41	4.23	0.328	O		0.58
7.917	4.59	4.35	0.330	O I		0.59
8.000	4.64	4.48	0.331	O I		0.59

				ROUTE24100.out			
8.083	4.88	4.61	0.333	O			0.59
8.167	5.23	4.81	0.335	OI			0.60
8.250	5.33	5.00	0.337	OI			0.60
8.333	5.37	5.00	0.340	OI			0.60
8.417	5.39	5.00	0.342	OI			0.61
8.500	5.40	5.00	0.345	OI			0.61
8.583	5.51	5.00	0.348	O I			0.62
8.667	5.68	5.00	0.352	O I			0.63
8.750	5.72	5.00	0.357	O I			0.63
8.833	5.85	5.00	0.363	O I			0.64
8.917	6.03	5.00	0.369	O I			0.66
9.000	6.08	5.00	0.376	O I			0.67
9.083	6.32	5.00	0.385	O I			0.68
9.167	6.67	5.00	0.395	O I			0.70
9.250	6.77	5.00	0.407	O I			0.72
9.333	6.91	5.00	0.419	O I			0.74
9.417	7.11	5.00	0.433	O I			0.77
9.500	7.17	5.00	0.448	O I			0.79
9.583	7.29	5.00	0.463	O I			0.82
9.667	7.47	5.00	0.480	O I			0.85
9.750	7.53	5.00	0.497	O I			0.88
9.833	7.65	5.00	0.515	O I			0.91
9.917	7.83	5.00	0.534	O I			0.94
10.000	7.89	5.00	0.553	O I			0.97
10.083	7.16	5.00	0.571	O I			1.00
10.167	5.96	5.00	0.582	O I			1.02
10.250	5.67	5.00	0.587	O I			1.03
10.333	5.53	5.00	0.591	O I			1.04
10.417	5.46	5.00	0.595	O I			1.05
10.500	5.40	5.00	0.598	OI			1.05
10.583	5.93	5.00	0.602	O I			1.06
10.667	6.80	5.00	0.612	O I			1.07
10.750	7.01	5.00	0.625	O I			1.10
10.833	7.11	5.00	0.639	O I			1.12
10.917	7.16	5.00	0.654	O I			1.14
11.000	7.20	5.00	0.669	O I			1.17
11.083	7.10	5.00	0.684	O I			1.20
11.167	6.92	5.00	0.697	O I			1.22
11.250	6.88	5.00	0.710	O I			1.24
11.333	6.86	5.00	0.723	O I			1.26
11.417	6.85	5.00	0.736	O I			1.28
11.500	6.84	5.00	0.749	O I			1.31
11.583	6.63	5.00	0.761	O I			1.33
11.667	6.29	5.00	0.771	O I			1.34
11.750	6.20	5.00	0.779	O I			1.36
11.833	6.26	5.00	0.788	O I			1.37
11.917	6.42	5.00	0.797	O I			1.39
12.000	6.44	5.00	0.807	O I			1.40
12.083	7.28	5.00	0.820	O I			1.43
12.167	8.63	5.00	0.840	O I	I		1.46
12.250	8.99	5.00	0.866	O I	I		1.50
12.333	9.27	5.00	0.895	O I	I		1.55
12.417	9.57	5.00	0.925	O I	I		1.60
12.500	9.69	5.00	0.957	O I	I		1.65
12.583	9.98	5.00	0.991	O I	I		1.71
12.667	10.43	5.00	1.026	O I	I		1.77
12.750	10.55	5.00	1.064	O I	I		1.83
12.833	10.74	5.00	1.103	O I	I		1.89
12.917	10.98	5.00	1.143	O I	I		1.96
13.000	11.06	5.00	1.185	O I	I		2.03
13.083	11.74	5.00	1.229	O I	I		2.10
13.167	12.81	5.00	1.279	O I	I		2.18
13.250	13.10	5.00	1.334	O I	I		2.26
13.333	13.23	5.00	1.390	O I	I		2.35
13.417	13.30	5.00	1.447	O I	I		2.44
13.500	13.35	5.00	1.504	O I	I		2.53
13.583	11.94	5.00	1.557	O I	I		2.62
13.667	9.63	5.00	1.597	O I	I		2.68
13.750	9.05	5.00	1.627	O I	I		2.72
13.833	8.80	5.00	1.654	O I	I		2.77
13.917	8.67	5.00	1.680	O I	I		2.81
14.000	8.57	5.00	1.705	O I	I		2.85
14.083	9.09	5.00	1.731	O I	I		2.89
14.167	9.95	5.00	1.762	O I	I		2.93
14.250	10.17	5.00	1.797	O I	I		2.99
14.333	10.14	5.00	1.832	O I	I		3.04
14.417	9.99	5.00	1.867	O I	I		3.10
14.500	9.98	5.00	1.902	O I	I		3.15
14.583	9.96	5.00	1.936	O I	I		3.20
14.667	9.96	5.00	1.970	O I	I		3.25
14.750	9.96	5.00	2.004	O I	I		3.30
14.833	9.84	5.00	2.038	O I	I		3.35
14.917	9.63	5.00	2.070	O I	I		3.40
15.000	9.59	5.00	2.102	O I	I		3.45
15.083	9.44	5.00	2.133	O I	I		3.50
15.167	9.22	5.00	2.163	O I	I		3.54
15.250	9.17	5.00	2.192	O I	I		3.59
15.333	9.02	5.00	2.220	O I	I		3.63

ROUTE24100.out

15.417	8.81	5.00	2.247		0		I		3.67
15.500	8.75	5.00	2.273		0		I		3.70
15.583	8.22	5.00	2.297		0		I		3.74
15.667	7.37	5.00	2.316		0		I		3.77
15.750	7.15	5.00	2.332		0		I		3.79
15.833	7.07	5.00	2.347		0		I		3.81
15.917	7.02	5.00	2.361		0		I		3.83
16.000	6.99	5.00	2.374		0		I		3.85
16.083	5.36	5.00	2.383		0	I			3.87
16.167	2.70	5.00	2.376		0		I		3.86
16.250	2.02	5.00	2.358		0		I		3.83
16.333	1.72	5.00	2.336		0		I		3.80
16.417	1.56	5.00	2.313		0		I		3.76
16.500	1.44	5.00	2.289		0		I		3.73
16.583	1.33	5.00	2.264		0		I		3.69
16.667	1.16	5.00	2.238		0		I		3.65
16.750	1.12	5.00	2.212		0		I		3.61
16.833	1.10	5.00	2.185		0		I		3.57
16.917	1.09	5.00	2.158		0		I		3.54
17.000	1.08	5.00	2.131		0		I		3.50
17.083	1.29	5.00	2.105		0		I		3.46
17.167	1.64	5.00	2.080		0		I		3.42
17.250	1.73	5.00	2.057		0		I		3.38
17.333	1.76	5.00	2.035		0		I		3.35
17.417	1.79	5.00	2.013		0		I		3.32
17.500	1.80	5.00	1.991		0		I		3.28
17.583	1.80	5.00	1.969		0		I		3.25
17.667	1.80	5.00	1.947		0		I		3.22
17.750	1.80	5.00	1.925		0		I		3.18
17.833	1.70	5.00	1.902		0		I		3.15
17.917	1.52	5.00	1.879		0		I		3.11
18.000	1.48	5.00	1.855		0		I		3.08
18.083	1.46	5.00	1.830		0		I		3.04
18.167	1.45	5.00	1.806		0		I		3.00
18.250	1.44	5.00	1.782		0		I		2.97
18.333	1.44	5.00	1.757		0		I		2.93
18.417	1.44	5.00	1.733		0		I		2.89
18.500	1.44	5.00	1.708		0		I		2.85
18.583	1.33	5.00	1.683		0		I		2.81
18.667	1.16	5.00	1.657		0		I		2.77
18.750	1.12	5.00	1.631		0		I		2.73
18.833	0.99	5.00	1.604		0		I		2.69
18.917	0.81	5.00	1.575		0		I		2.64
19.000	0.76	5.00	1.546		0		I		2.60
19.083	0.84	5.00	1.517		0		I		2.55
19.167	1.01	5.00	1.489		0		I		2.51
19.250	1.04	5.00	1.462		0		I		2.47
19.333	1.17	5.00	1.435		0		I		2.43
19.417	1.35	5.00	1.409		0		I		2.38
19.500	1.40	5.00	1.384		0		I		2.34
19.583	1.32	5.00	1.359		0		I		2.30
19.667	1.15	5.00	1.333		0		I		2.26
19.750	1.12	5.00	1.307		0		I		2.22
19.833	0.99	5.00	1.280		0		I		2.18
19.917	0.81	5.00	1.251		0		I		2.13
20.000	0.76	5.00	1.222		0		I		2.09
20.083	0.84	5.00	1.193		0		I		2.04
20.167	1.01	5.00	1.165		0		I		1.99
20.250	1.04	5.00	1.138		0		I		1.95
20.333	1.06	5.00	1.111		0		I		1.90
20.417	1.07	5.00	1.084		0		I		1.86
20.500	1.08	5.00	1.057		0		I		1.82
20.583	1.08	5.00	1.030		0		I		1.77
20.667	1.08	5.00	1.003		0		I		1.73
20.750	1.08	5.00	0.976		0		I		1.68
20.833	0.97	5.00	0.948		0		I		1.64
20.917	0.80	5.00	0.920		0		I		1.59
21.000	0.76	5.00	0.891		0		I		1.54
21.083	0.84	5.00	0.862		0		I		1.50
21.167	1.01	5.00	0.834		0		I		1.45
21.250	1.04	5.00	0.807		0		I		1.40
21.333	0.96	5.00	0.779		0		I		1.36
21.417	0.79	5.00	0.751		0		I		1.31
21.500	0.76	5.00	0.722		0		I		1.26
21.583	0.84	5.00	0.693		0		I		1.21
21.667	1.01	5.00	0.665		0		I		1.16
21.750	1.04	5.00	0.637		0		I		1.12
21.833	0.96	5.00	0.610		0		I		1.07
21.917	0.79	5.00	0.581		0		I		1.02
22.000	0.76	5.00	0.552		0		I		0.97
22.083	0.84	5.00	0.523		0		I		0.92
22.167	1.01	5.00	0.495		0		I		0.87
22.250	1.04	5.00	0.468		0		I		0.83
22.333	0.96	5.00	0.440		0		I		0.78
22.417	0.79	5.00	0.412		0		I		0.73
22.500	0.76	5.00	0.383		0		I		0.68
22.583	0.74	5.00	0.354		0		I		0.63
22.667	0.73	4.13	0.327		0		I		0.58

ROUTE24100.out


22.750	0.72	2.55	0.309	I	0				0.55
22.833	0.72	1.70	0.299	I	0				0.53
22.917	0.72	1.25	0.294	IO					0.52
23.000	0.72	1.00	0.291	IO					0.52
23.083	0.72	0.87	0.290	IO					0.52
23.167	0.72	0.80	0.289	O					0.52
23.250	0.72	0.76	0.289	O					0.52
23.333	0.72	0.74	0.288	O					0.51
23.417	0.72	0.73	0.288	O					0.51
23.500	0.72	0.73	0.288	O					0.51
23.583	0.72	0.72	0.288	O					0.51
23.667	0.72	0.72	0.288	O					0.51
23.750	0.72	0.72	0.288	O					0.51
23.833	0.72	0.72	0.288	O					0.51
23.917	0.72	0.72	0.288	O					0.51
24.000	0.72	0.72	0.288	O					0.51
24.083	0.51	0.67	0.288	O					0.51
24.167	0.16	0.52	0.286	IO					0.51
24.250	0.08	0.33	0.284	O					0.51
24.333	0.04	0.20	0.282	O					0.50
24.417	0.02	0.12	0.281	O					0.50
24.500	0.00	0.07	0.281	O					0.50
24.583	0.00	0.04	0.280	O					0.50
24.667	0.00	0.02	0.280	O					0.50
24.750	0.00	0.01	0.280	O					0.50
24.833	0.00	0.01	0.280	O					0.50
24.917	0.00	0.00	0.280	O					0.50
25.000	0.00	0.00	0.280	O					0.50
25.083	0.00	0.00	0.280	O					0.50

Remaining water in basin = 0.28 (Ac.Ft)

*****HYDROGRAPH DATA*****
 Number of intervals = 301
 Time interval = 5.0 (Min.)
 Maximum/Peak flow rate = 5.000 (CFS)
 Total volume = 7.329 (Ac.Ft)
 Status of hydrographs being held in storage
 Stream 1 Stream 2 Stream 3 Stream 4 Stream 5
 Peak (CFS) 0.000 0.000 0.000 0.000 0.000
 Vol (Ac.Ft) 0.000 0.000 0.000 0.000 0.000

Appendix 7: Hydromodification

Supporting Detail Relating to Hydrologic Conditions of Concern

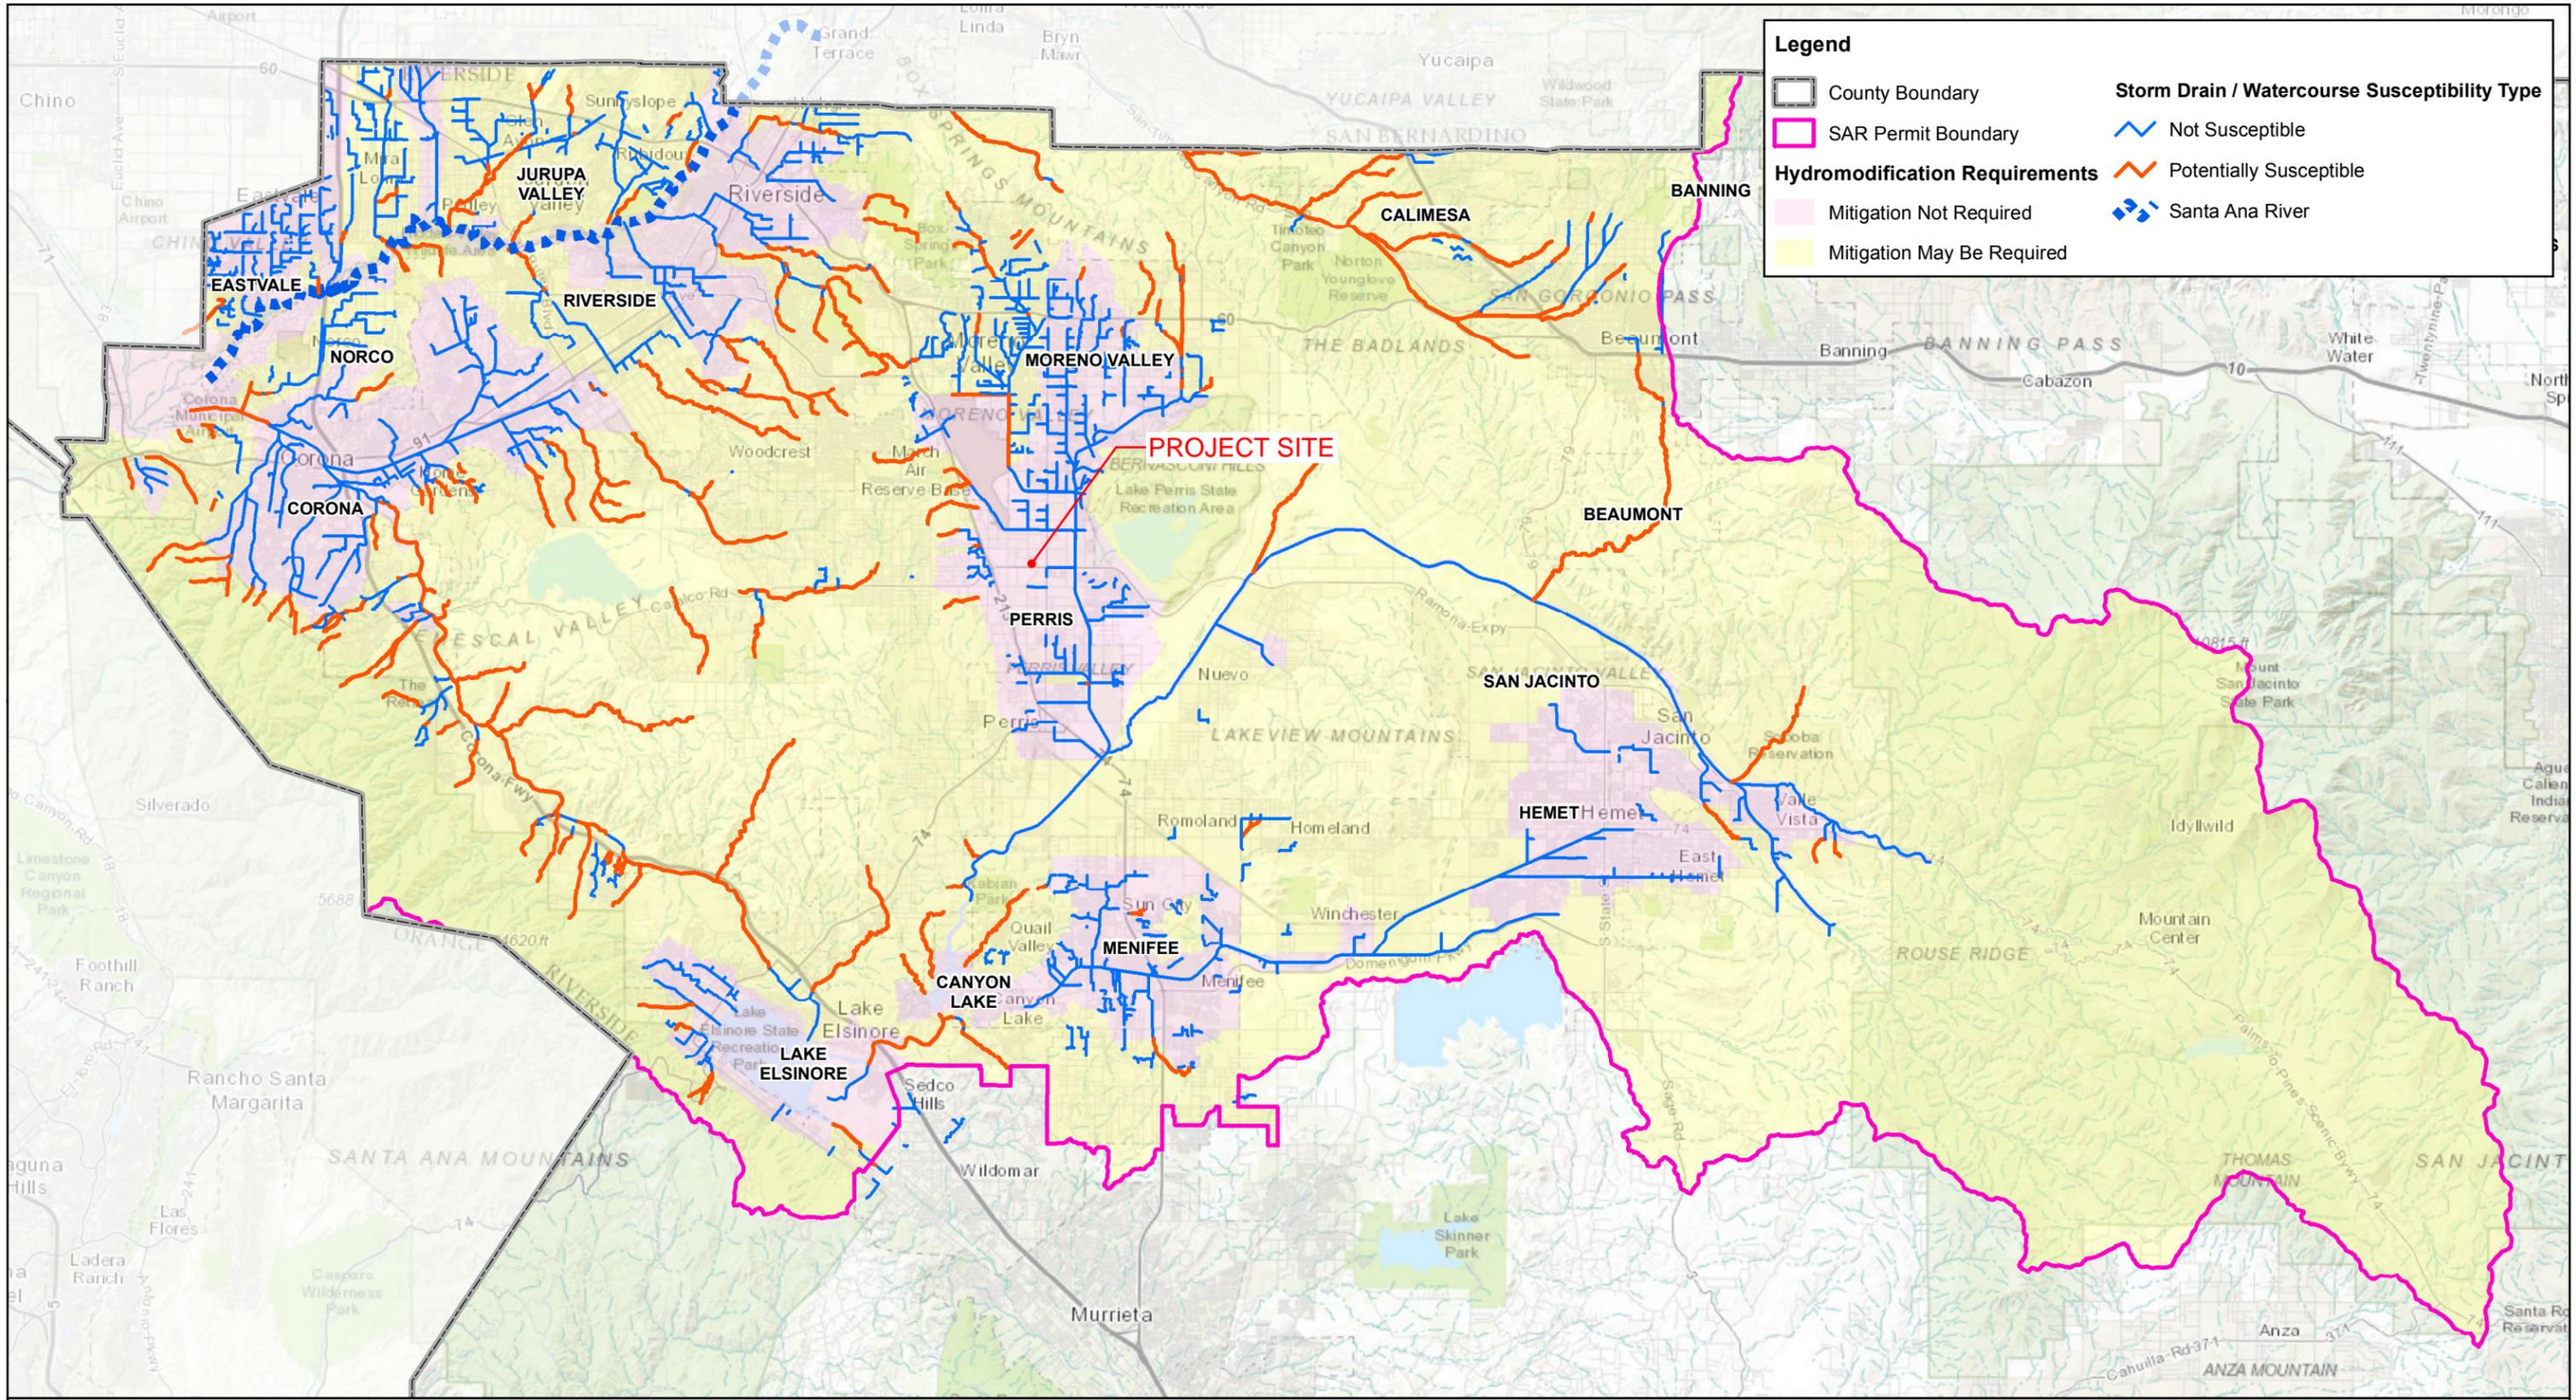

Legend

County Boundary	Storm Drain / Watercourse Susceptibility Type
SAR Permit Boundary	Not Susceptible
Hydromodification Requirements	Potentially Susceptible
Mitigation Not Required	Santa Ana River
Mitigation May Be Required	



Updated February 2017

**HCOC Applicability Map
SAR Permittees**

Appendix 8: Source Control

Pollutant Sources/Source Control Checklist

****To be provided during Final Engineering***

Appendix 9: O&M

Operation and Maintenance Plan and Documentation of Finance, Maintenance and Recording Mechanisms

****To be provided during Final Engineering***

Appendix 10: Educational Materials

BMP Fact Sheets, Maintenance Guidelines and Other End-User BMP Information

****To be provided during Final Engineering***



Memorandum

To: Mary Blais

From: Tyler Webb

Date: April 11, 2019

Re: P18-00002 Indian Ramona PWQMP per Updated Site Plan

Mary,

This memo is being sent per Cynthia Gabaldon's email on April 10, 2019 regarding the Indian Ramona PWQMP and corresponding site plan changes.

There are no site changes that negatively impact the water quality site design and sizing. The only site change was the access at Indian Avenue and Perry Street. The proposed cul-de-sac was revised per city comments to a full service signalized intersection and driveway leading to and from the northern on-site truck parking lot.

This change allowed the basin to extend all the way to the adjacent property line next to the EMWD facility on the corner of Indian and Perry – roughly 150 feet. The extension provided more bottom area and volume storage for the proposed basin with the tributary areas and drainage points remaining the same.