

**Eastern Municipal Water District**

2270 Trumble Road  
P.O. Box 8300  
Perris, CA 92572-8300



**Notice of Exemption**

**To:** Riverside County Clerk  
2724 Gateway Drive  
Riverside, CA 92507

**Project Title:** 4th Street Lift Station Decommission and Sewer Upgrade Project  
**Project Location:** Located along 4<sup>th</sup> Street, Wilkerson Avenue and Redlands Avenue  
**City:** Perris  
**County:** Riverside

**Description of Nature, Purpose, and Beneficiaries of Project:**

To coordinate the consolidation and transfer of the City of Perris’s (City) water and sewer utility systems to Eastern Municipal Water District (EMWD), a joint study was completed in 2020 between the City and EMWD. This study determined that the 4<sup>th</sup> Street and 7<sup>th</sup> Street Lift Stations needed upgrades and modifications to meet EMWD’s safety standards and site access requirements. The project consists of the installation of a new gravity sewer adjacent to 4<sup>th</sup> Street, which will carry the influent sewer flow to the 7<sup>th</sup> Street sewerage lift station. Owner furnished materials will be used to construct 830 linear feet of 8-inch and 10-inch sewer lines. This would lead to the decommissioning of the 4<sup>th</sup> Street Lift Station, an existing in-manhole lift station. The lift station’s above ground improvements, pumps, wet well, force main, electrical and instrumentation would be removed. Beneficiaries of the project are EMWD residents and businesses.

**Public Agency Approving and Carrying Out Project:** Eastern Municipal Water District

**Exempt Status:**

Statutory Exemption (Section 21080.21), Categorical Exemption (Section 15304)

**Reasons why project is exempt:**


Implementation of the project consists of the installation of a new pipeline as well as the maintenance, reparation, restoration, removal, or demolition of an existing pipeline, where both the removal and installation of the pipelines do not exceed one mile in length. The project also includes minor alterations to land, with the in-manhole lift station being decommissioned and existing above ground components being removed.


**EMWD Contact:** Joe Broadhead

**Phone:** (951) 928-3777, ext 4545

\_\_\_\_\_  
Joe Broadhead  
Principal Water Resources Specialist

3-6-25  
\_\_\_\_\_  
Date

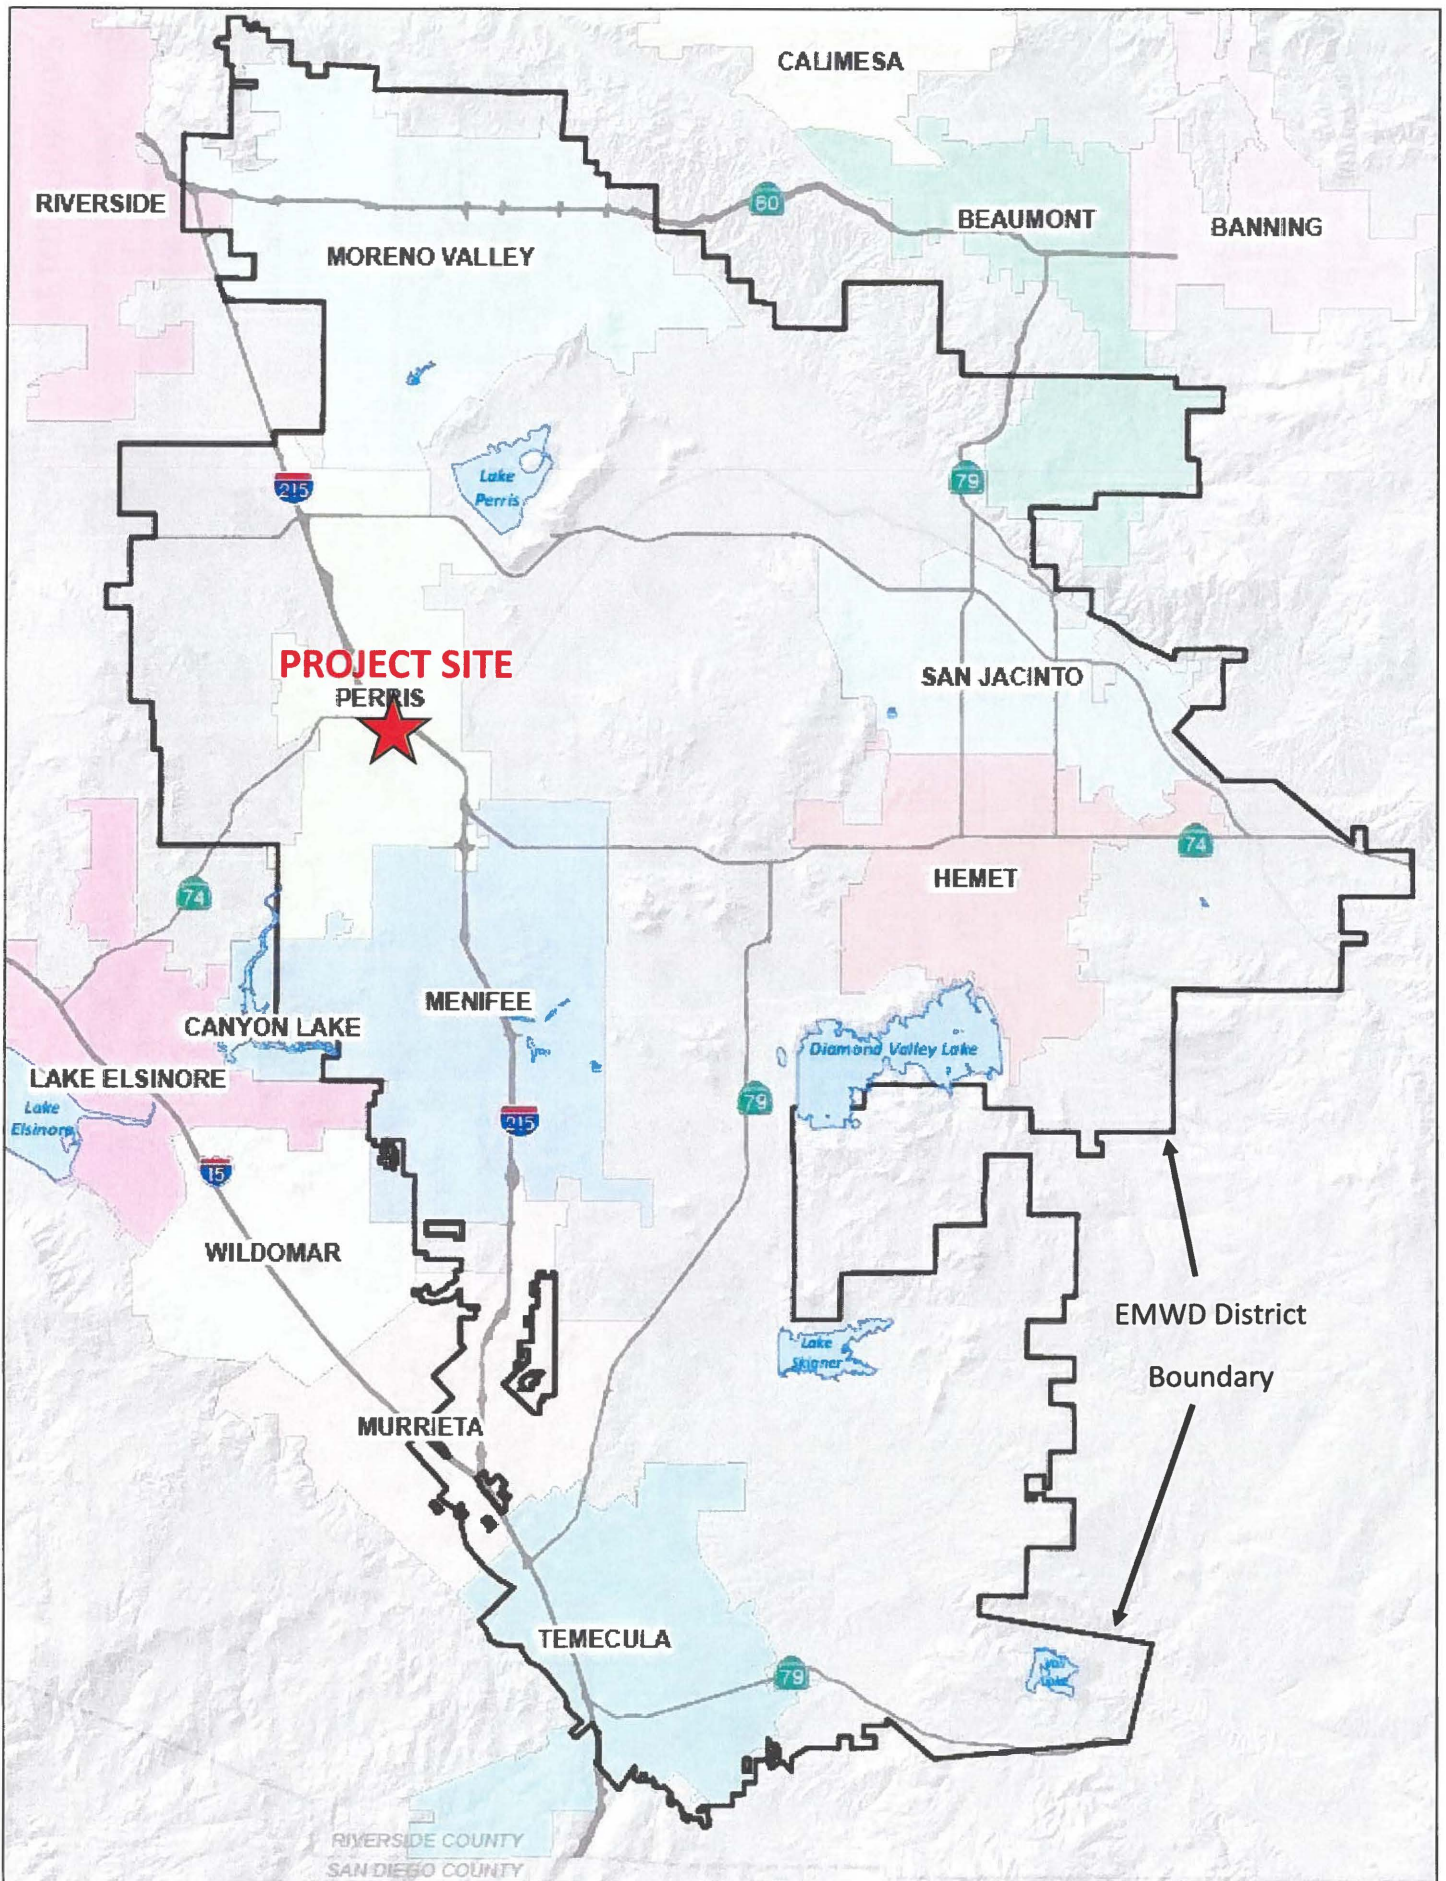

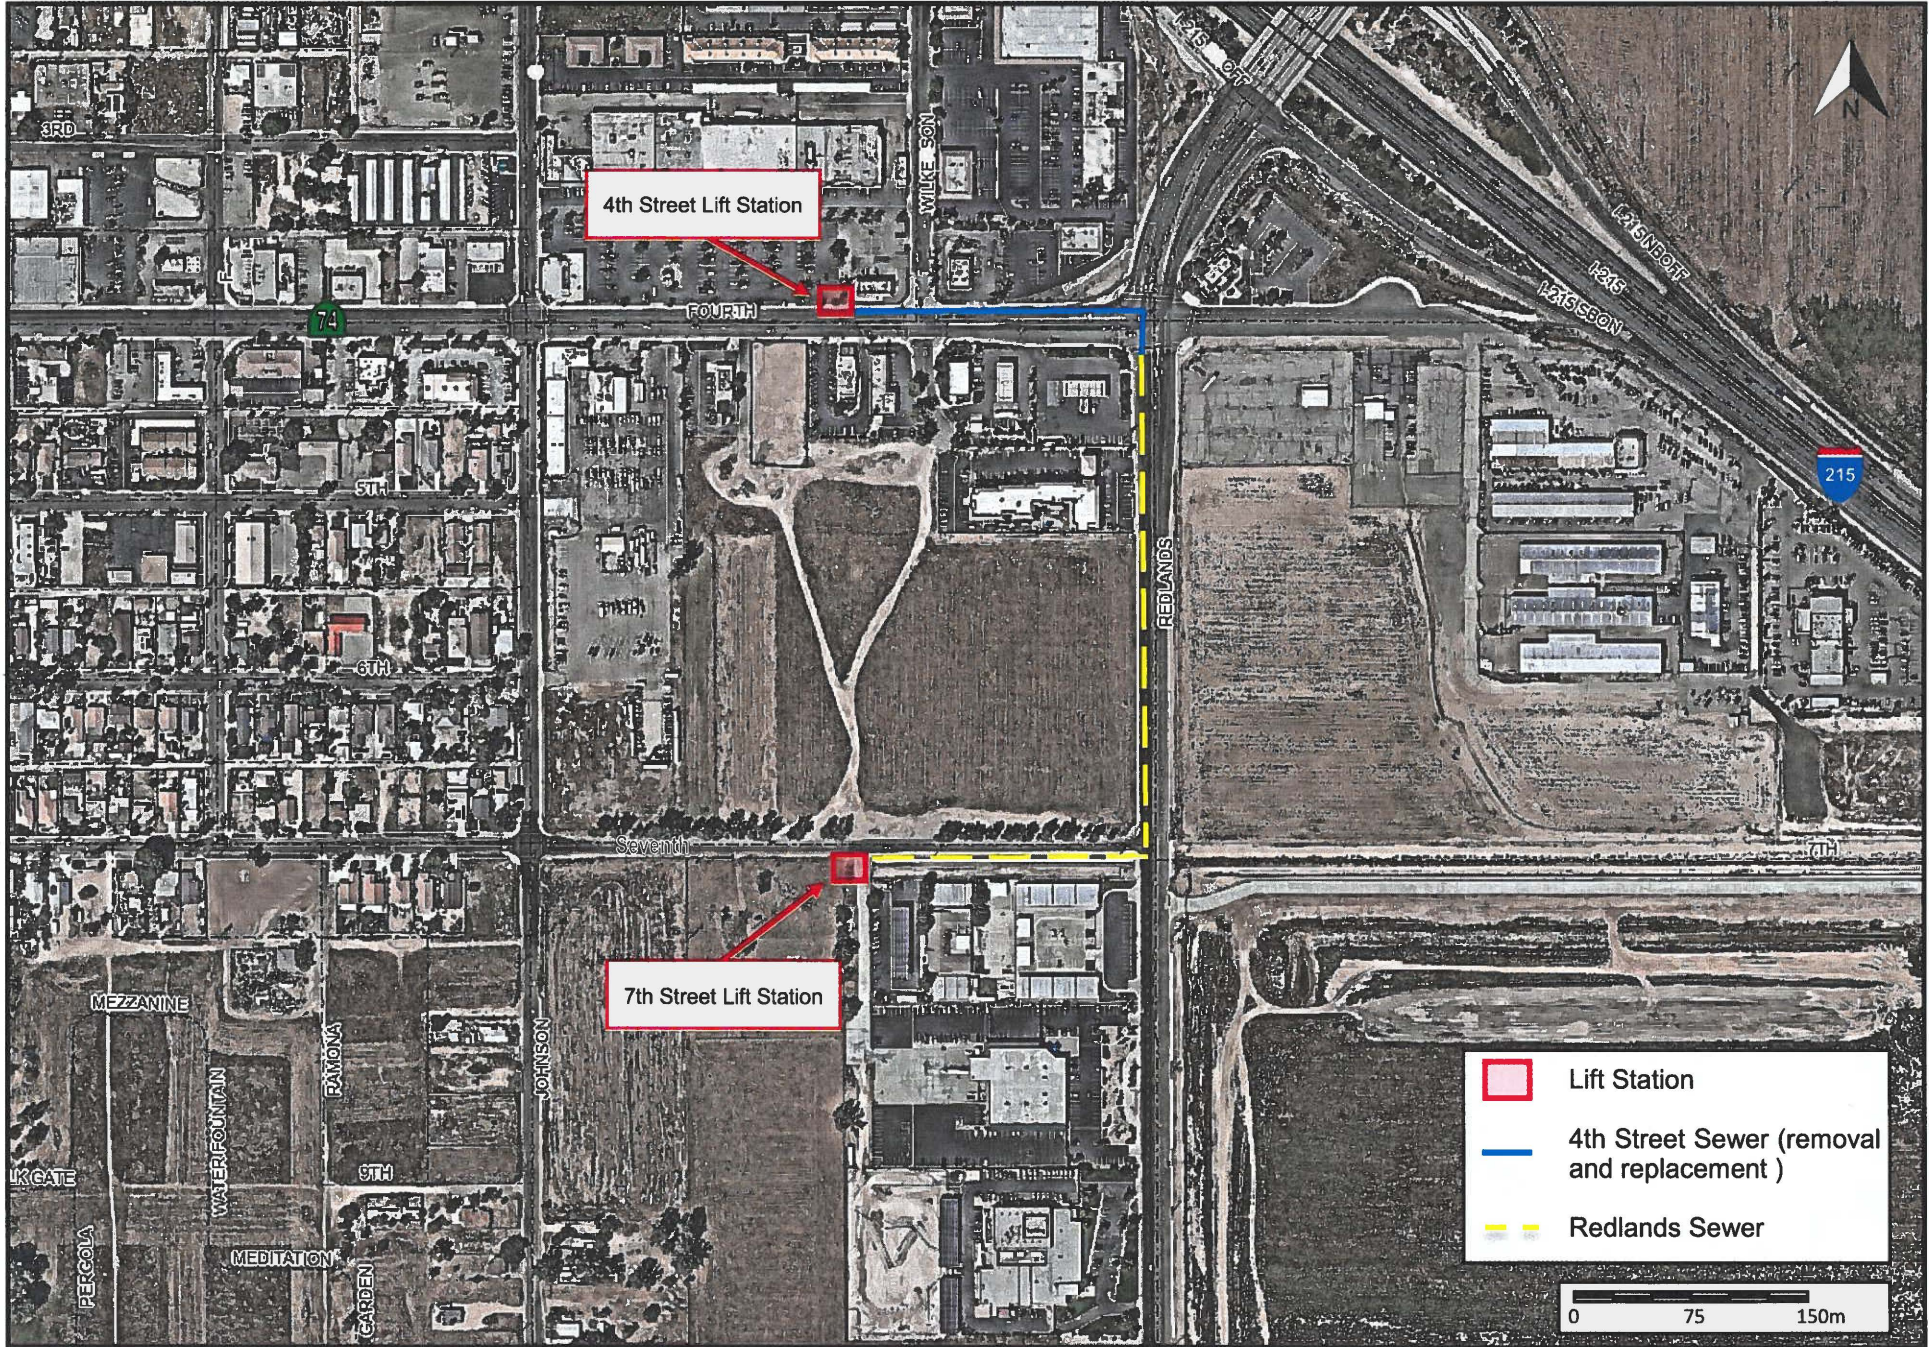

4th Street Lift Station Decommission and Sewer Upgrade Project

**EXHIBIT 2: SITE LOCATION MAP**