

**MITIGATED NEGATIVE DECLARATION
OF
BOARD OF DIRECTORS
OF THE
IVANHOE PUBLIC UTILITY DISTRICT**

**COUNTY CLERK
COUNTY OF TULARE**

The Project hereafter described will, in our evaluation, have no significant effect on the environment and does not, therefore, require the filing of an Environmental Impact Report.

Board of Directors
Ivanhoe Public Utility District

By: _____
Carol Fina, Secretary

Dated: _____

Project Location:

See Figure 1, attached.

Brief description of Project:

The Project addresses 1,2,3-TCP contamination of Well No. 6. The Project consists of the construction and operation of a granular activated carbon (GAC) treatment system to reduce 1,2,3-TCP contamination from extracted groundwater. Construction includes the installation of two (2) 12-foot diameter treatment vessels, a 50,000 gallon above-ground storage tank, booster pump and associated piping and appurtenances on the Well No. 6 site.

Reason(s) for mitigated negative declaration finding:


The construction and operation of the Project will result in no adverse long-term environmental impacts. Short-term construction related potential impacts will be mitigated to a less than significant level by use of construction specifications requiring defined mitigation measures.

Initial Study prepared by:

Dennis R. Keller, Consulting Civil Engineer
Ivanhoe Public Utility District

Initial Study available at:

Ivanhoe Public Utility District
15859 Azalea Avenue
Ivanhoe, California 93235

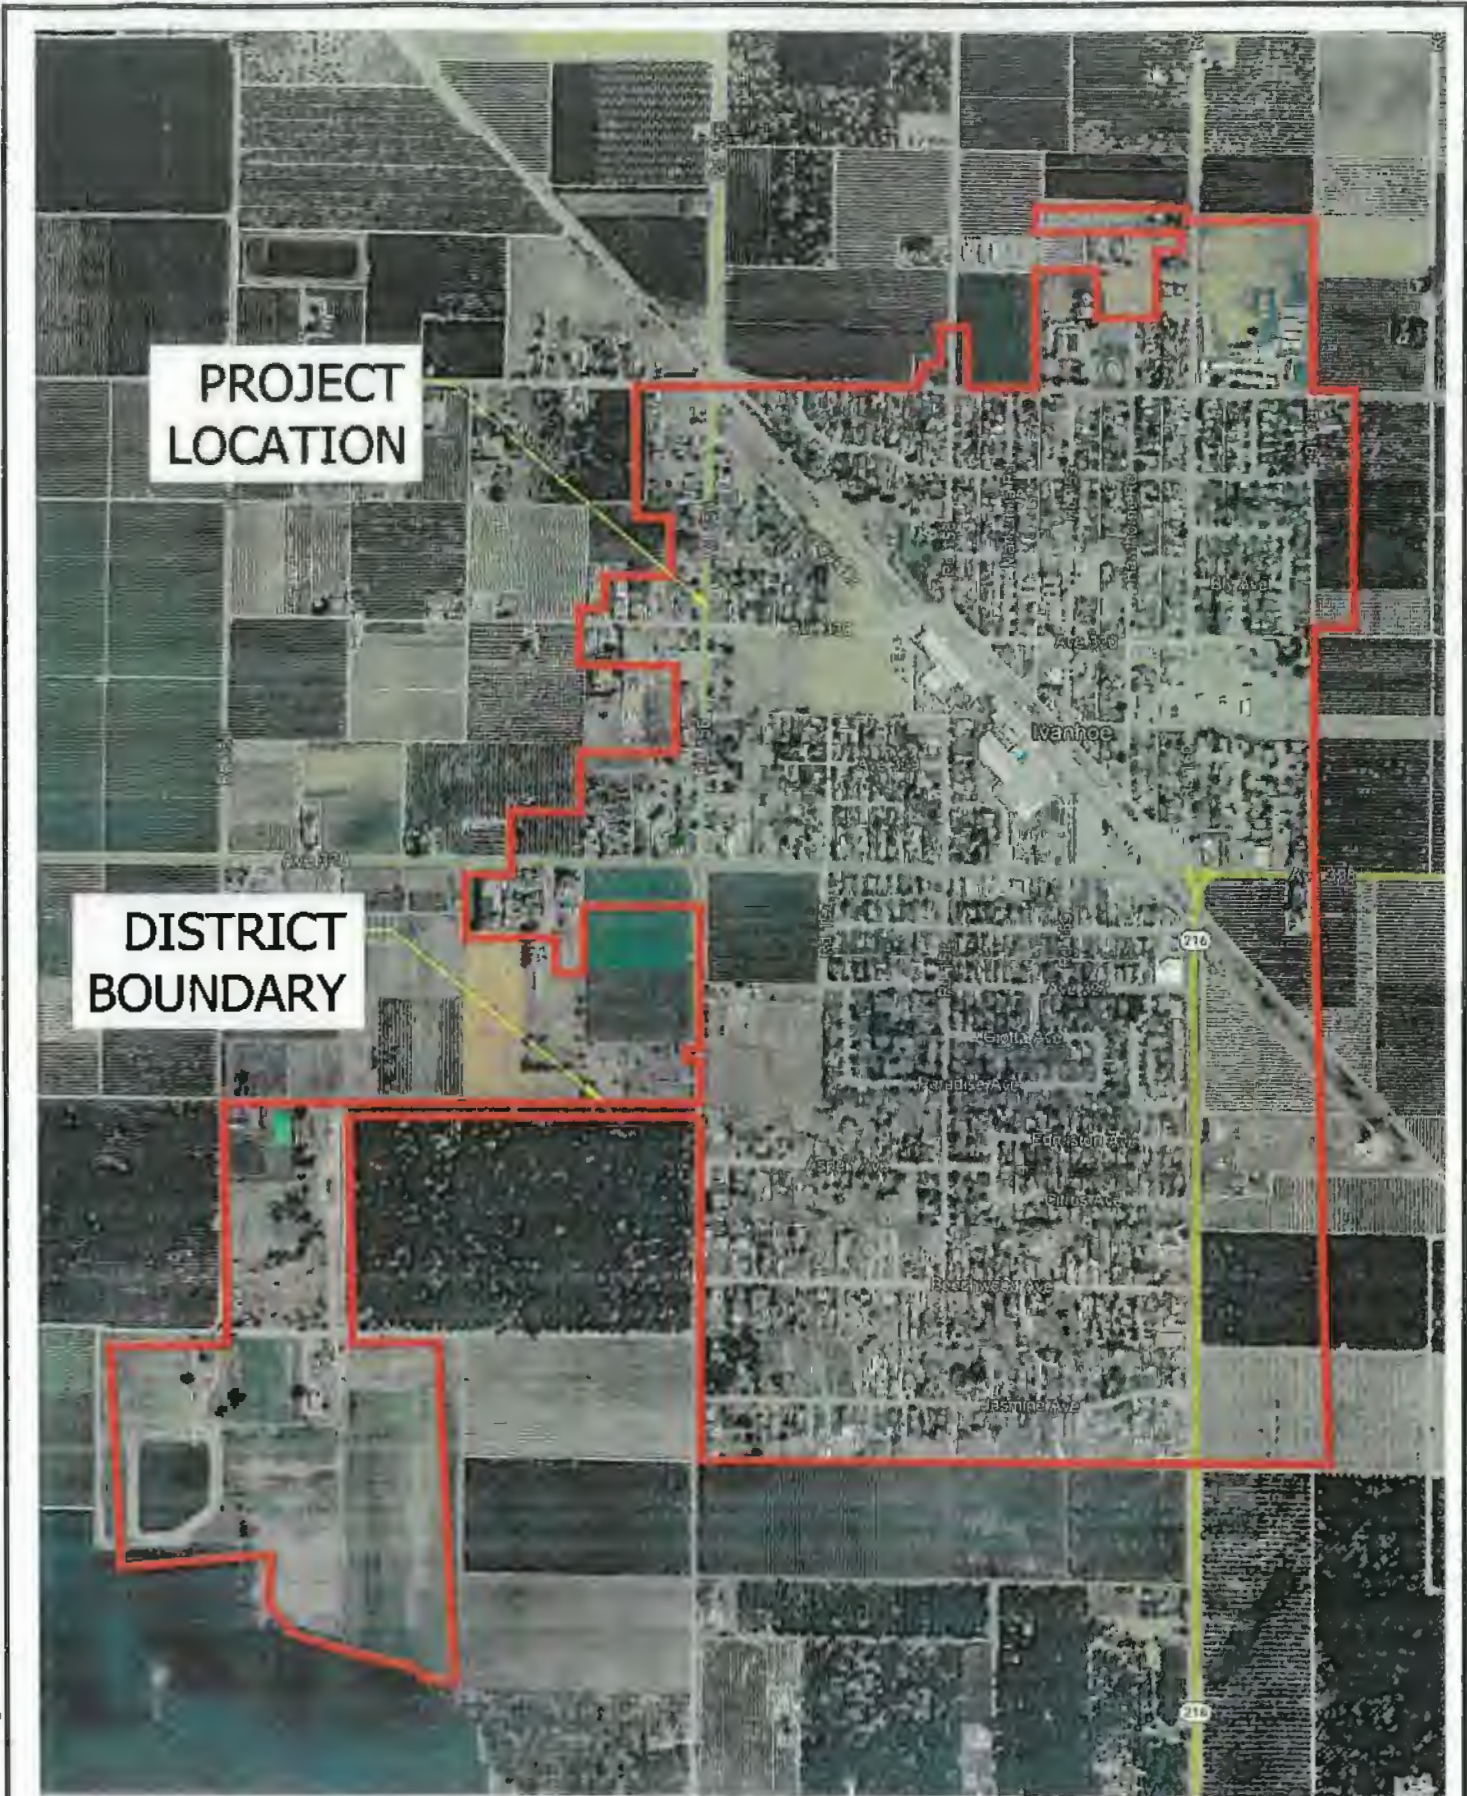

PROJECT LOCATION

DISTRICT BOUNDARY

PROJECT AREA
WELL NO. 6 IMPROVEMENTS
IVANHOE PUBLIC UTILITY DISTRICT


 SCALE: 1"=1000'

L:\IPUD\dwg\Well 6\FIGURE 1.dwg