

**MITIGATED NEGATIVE DECLARATION  
OF  
BOARD OF DIRECTORS  
OF THE  
IVANHOE PUBLIC UTILITY DISTRICT**

**COUNTY CLERK  
COUNTY OF TULARE**

The Project hereafter described will, in our evaluation, have no significant effect on the environment and does not, therefore, require the filing of an Environmental Impact Report.

Board of Directors  
Ivanhoe Public Utility District

By: Carol Fina  
Carol Fina, Secretary

Dated: 4-7-2025

**Project Location:**

See Figure 1, attached.

**Brief description of Project:**

The Project addresses existing 1,2,3-TCP contamination of Well No. 6. The Project consists of the construction and operation of a granular activated carbon (GAC) treatment system to reduce 1,2,3-TCP contamination from extracted groundwater. Construction includes the installation of two (2) 12-foot diameter treatment vessels, a 50,000 gallon above-ground storage tank, booster pump and associated piping and appurtenances on the existing Well No. 6 site.

**Reason(s) for mitigated negative declaration finding:**


The construction and operation of the Project will result in no adverse long-term environmental impacts. Short-term construction related potential impacts will be mitigated to a less than significant level by use of construction specifications requiring defined mitigation measures.

**Initial Study prepared by:**

Dennis R. Keller, Consulting Civil Engineer  
Ivanhoe Public Utility District

**Initial Study available at:**

Ivanhoe Public Utility District  
15859 Azalea Avenue  
Ivanhoe, California 93235

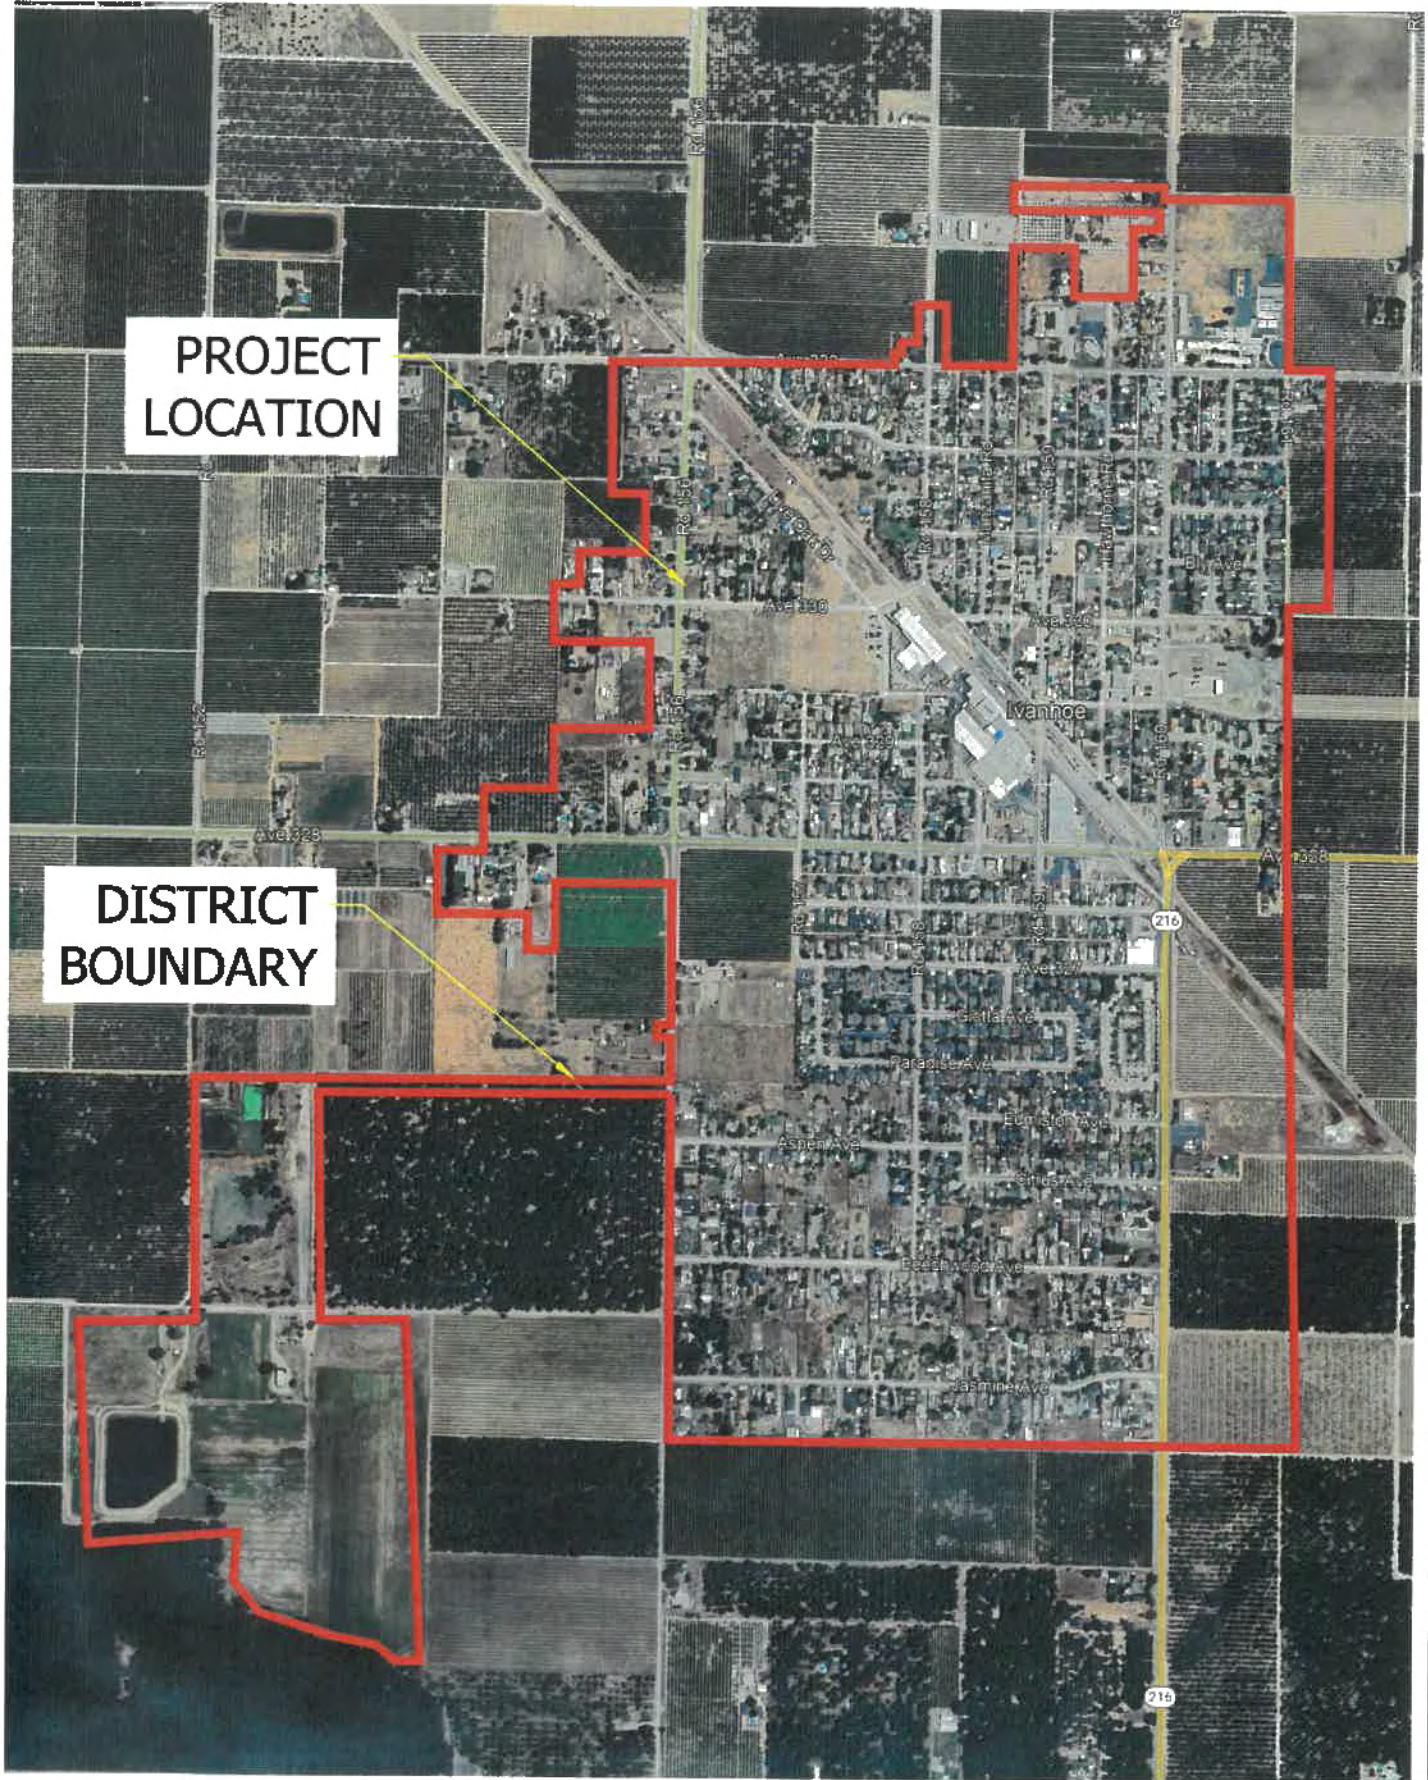

**PROJECT  
LOCATION**

**DISTRICT  
BOUNDARY**

<b>PROJECT AREA</b>
<b>WELL NO. 6 IMPROVEMENTS</b>
<b>IVANHOE PUBLIC UTILITY DISTRICT</b>



SCALE: 1"=1000'